

ROCKWOOL® FIREPRO®

Comprehensive range of passive fire protection
products and solutions





Contents

	Page No.
Introducing ROCKWOOL® FIREPRO®	4
Fire stopping	
Section 1 - Penetration seals / Core products	6
▪ FIREPRO® 50mm Ablative Coated Batt	8
▪ FIREPRO® 60mm Ablative Coated Batt	12
▪ FIREPRO® Ablative Coating	16
▪ FIREPRO® Firestop Compound	18
▪ FIREPRO® High Strength Firestop Compound	22
▪ FIREPRO® Intumescent Pillows CE	28
▪ FIREPRO® Multi-Cable Firestop	34
▪ FIREPRO® Intumescent Putty Pads	38
▪ FIREPRO® Firestop Pipe Collars CE	42
▪ FIREPRO® Intumescent Pipe Wraps CE	50
▪ FIREPRO® Insulated Fire Sleeves	56
▪ FIREPRO® Intumescent Pipe Wrap Roll	60
▪ FIREPRO® High Expansion Intumescent Sealant	66
▪ FIREPRO® Speedseal	70
Section 2 - Cavity barriers & cavity firestops / Core products	74
▪ Fire Barrier System	76
▪ Fire Barrier Slab	92
▪ TCB & PWCB Cavity Barriers	96
▪ FIREPRO® SP Firestop System	102
Section 3 - Linear joint seals / Core products	108
▪ FIREPRO® SoftSeal System	110
▪ FIREPRO® Linear & Trapezoidal Firestops	116
▪ FIREPRO® Intumescent Expansion Joint Seal	122
▪ FIREPRO® Acoustic Intumescent Sealant	126
▪ FIREPRO® Fire Resistant Silicone Sealant	132
▪ SP Firestop OSCB	136
Fire protection	
Section 1 - Structural steel / concrete / Core products	142
▪ Soffit Slab	144
▪ FIREPRO® Glue	148
▪ FIREPRO® BEAMCLAD® Systems	152
FIREPRO® BEAMCLAD® Fixing Guide	158
Section 2 - Building services / Core products	174
▪ Fire Duct Systems	176
▪ RockLap H&V Pipe Sections	188
▪ FIREPRO® DuctRock	196
▪ FIREPRO® Fire Tube	208
ROCKWOOL® Firestopping Principles	212
Other information	214
Legal disclaimer	215

Introducing ROCKWOOL® FIREPRO®


Passive fire protection is a critical component of any fire safety strategy.

Usually unseen but always at work, passive fire protection systems are built into the structure of the building to safeguard the lives of the building occupants. When properly installed, passive fire protection measures will protect the building's structure and limit the spread of fire and smoke by containing it within the compartment.

The ROCKWOOL® FIREPRO® range of passive fire protection products provides firestopping and fire

resistance throughout the building's construction, ensuring the building and its occupants are safer in the event of a fire. Our specialist range of products support architects, contractors and developers to conform to current building regulations.

In the ROCKWOOL® FIREPRO® Book you can find products for a range of specialist passive fire protection applications which include:

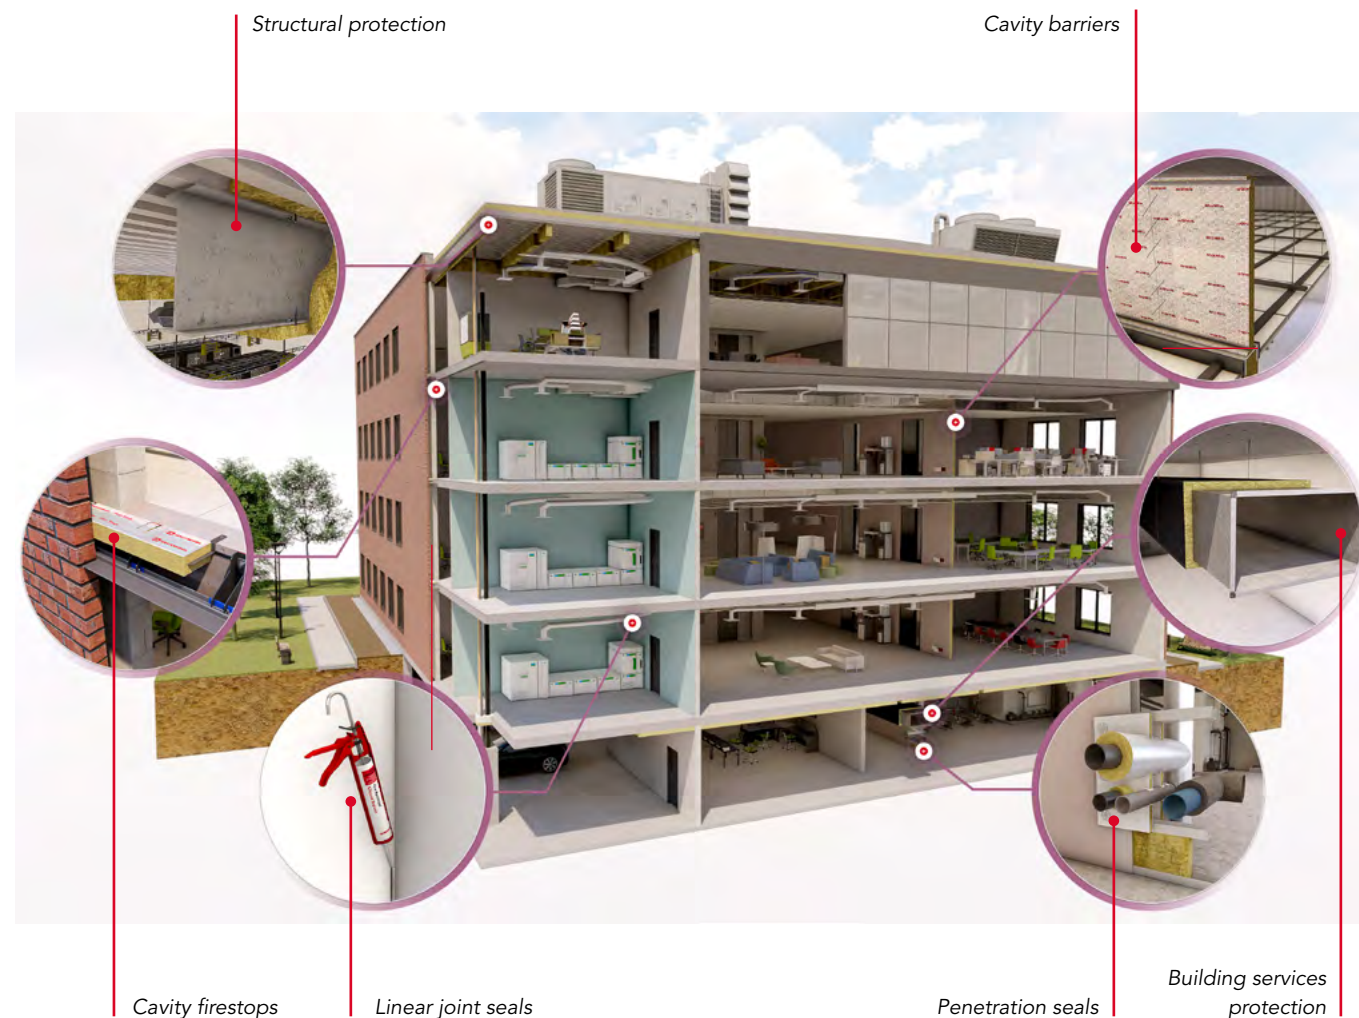

The ROCKWOOL®
FIREPRO® Book is
a comprehensive
catalogue of tested
and certified passive
fire protection
solutions.






Section 1: Penetration seals

Modern buildings include a vast array of building services which when installed, often pass through fire resistant compartment elements. It is also important to consider that buildings are subject to change, and that many building services can be added throughout its lifetime.

It is vitally important that breaches applied to compartment walls and floors by services are appropriately sealed to prevent the passage of fire and smoke. When sealing penetrations through compartment walls and floors, it is essential that approved and tested products are used to re-establish the fire resistance of the compartment.

ROCKWOOL® Firestopping solutions include a wide range of 3rd party-approved products that have been developed to seal apertures made within compartment walls and floors. Within our range of penetration seals, we have products that have been designed for use with specific types of building services including:

- Combustible pipes
- Metal pipes
- Cables, cable trays & conduits
- Fire dampers
- Duct work
- Electrical sockets

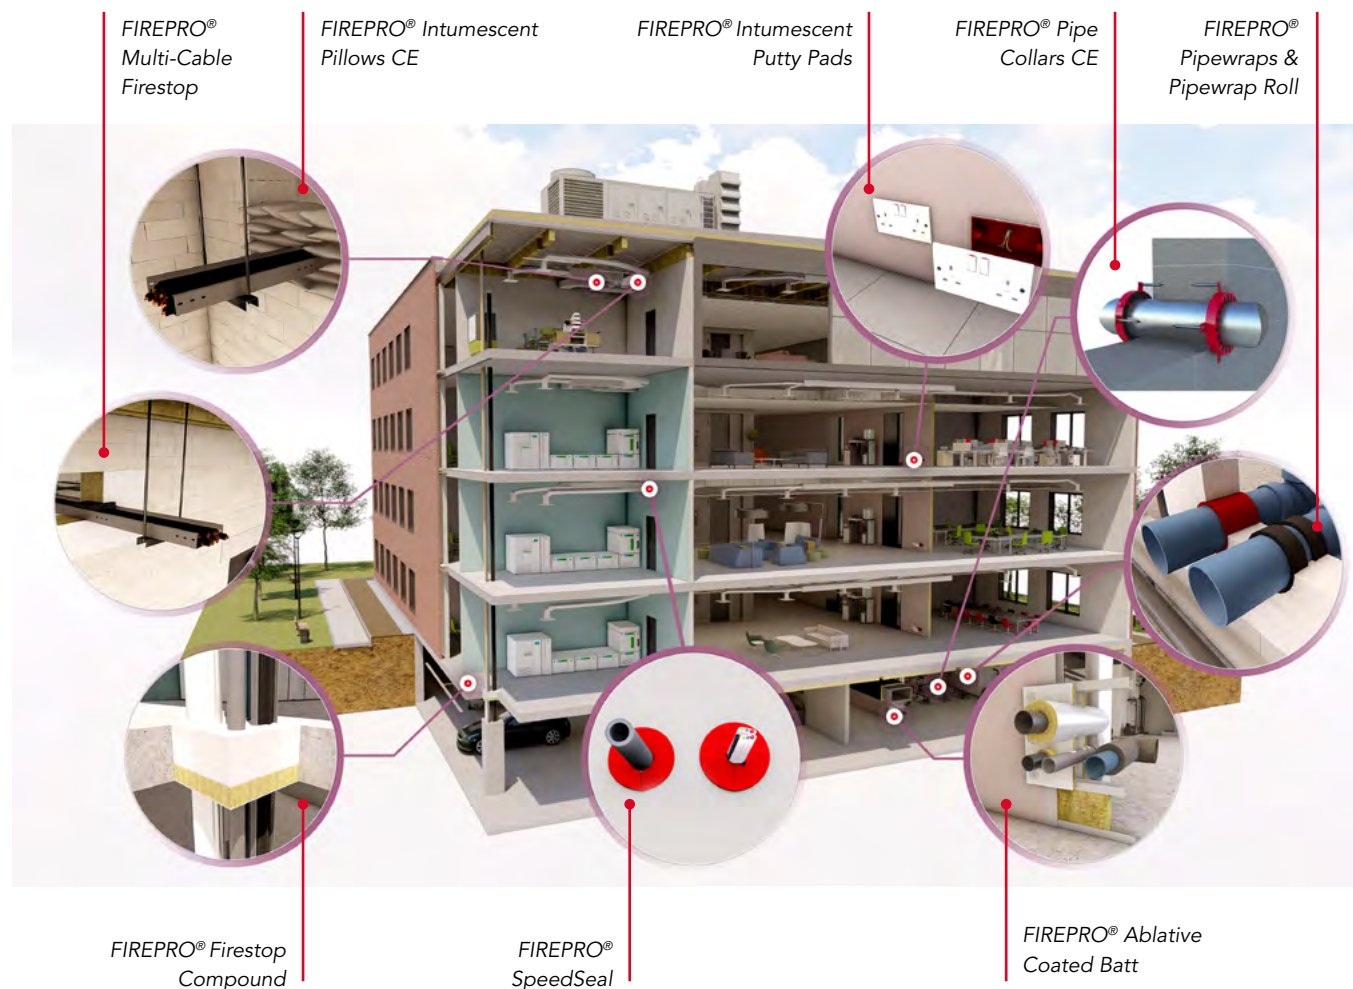

Core products



Ablative Coated Batt
Acoustic Intumescent Sealant
Insulated Fire Sleeves
Pipe Wrap Roll




Firestop Compound
High Strength Compound
Intumescent Pipe Wraps
Firestop Pipe Collar CE



High Expansion Intumescent Sealant



FIREPRO® Speedseal

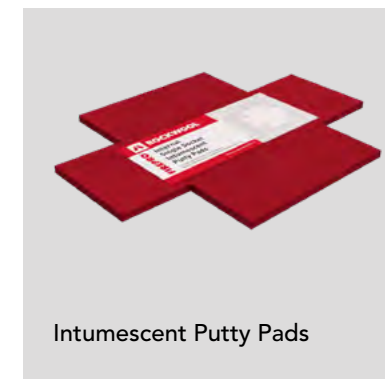

Intumescent Putty Pads



Multi Cable Firestop



Intumescent Pillows

Useful documents and standards

ASFP Technical Guidance Document – TGD 17: Code of practice for the installation and inspection of fire stopping systems in buildings

ASFP Red Book: Fire stopping and penetration seals for the construction industry

ASFP: Ensuring best practice for passive fire protection in buildings

ASFP: On-site guide to installing fire stopping

[ROCKWOOL® Firestopping Standard Details](#)

BS 476-20: Fire test on building materials and structures. Method for determination of the fire resistance of elements of construction

BS EN 1366-3: Fire resistance test for service installations. Penetration Seals

BS EN 1363-1: Fire resistance tests. General Requirements

BS EN 13501-2: Fire classification of construction products and building elements. Classification using test data from resistance to fire tests, excluding ventilation services.

ROCKWOOL guidance - HVAC specification detail guide

ASFP (Association for Specialist Fire Protection) guidance documents can be sourced at www.asfp.org.uk



FIREPRO®

50mm Ablative Coated Batt



Description

The ROCKWOOL Ablative Coated Batt comprises a high density stone wool core, pre-coated on both sides with our high-performance ablative coating.

Ablative Coated Batt has been comprehensively tested as part of the ROCKWOOL FIREPRO® range of fire protection products, specifically for use in service penetrations, head of wall and other void seals.

Advantages

- Excellent fire resistance from a single thickness batt
- Comprehensively tested as part of the FIREPRO® suite of solutions
- Suitable for sealing wall and floor voids containing most commonly used services and substrates
- Can be used as a blank seal and a head of wall seal
- Lightweight and simple to install
- Tested for air tightness, providing an additional smoke and acoustic seal

Applications

- Multiple substrates including: solid walls and floors; flexible walls
- Multi-service penetrations
- Head of wall
- Blank seals
- Face-fixed applications
- Large-framed service voids

For a fully comprehensive list of applications, please refer to the appropriate ROCKWOOL standard details available at www.rockwool.co.uk or contact the ROCKWOOL Technical Solutions Team.

Performance

Fire performance

Tests have proved the capability of a single 50mm Batt to provide up to 2 hours fire resistance Integrity and Insulation ratings are dependent upon the service penetrations and void size. Where 4 hours integrity and insulation are required we recommend the use of our 60mm Ablative Coated Batt.

Acoustic performance

Tested for head of wall:

- Rw= up to 48db (2 x Coated batts)
- Rw= up to 37db (1 x Coated batts)

The correct use of Coated batt within concealed cavities and voids will reduce the level of transmitted sound:

- Rw= up to 52 db (2 x Coated batts) - incorporating 48mm O/D PVC /15mm copper pipe penetrations.
- Rw= up to 34 db (1x Coated batts) - incorporating 48mm O/D PVC /15mm copper pipe penetrations.

For specific acoustic requirements please contact ROCKWOOL Technical Solutions.

Standard and approvals

BS EN 1366-3: 2009 and the dedicated fire resistance standard for linear joint seals, BS EN 1366-4:2006. Ablative Coated Batt has been classified in accordance with BS EN 13501-2.

Third party accreditation through IFC and Certifire.

CE marked to ETAG 26-02

For further information on the full scope of fire performance please refer to the appropriate standard details available www.rockwool.co.uk or contact ROCKWOOL Technical Solutions.

Note: All Ablative Coated Batt fire resistance tests were conducted using ROCKWOOL FIREPRO® ancillary products as appropriate.

Product information

Property	Description
Length	1200mm
Width	600mm
Thickness	50mm
Fire resistance	Up to 2 hours
Density	160kg/m ³
Air leakage	0.8m ³ /h/m ²



Installation

1. Make sure that the area within the aperture is clean of any debris and remove any dust from the edges.
2. Cut ROCKWOOL Ablative Coated Batt to the size and shape required to fit the aperture ensuring that batt will make a tight fit with all edges of the aperture.
3. Cut rectangular holes from the coated batt to accommodate cable trays or ladders containing cables.
4. Cut the Coated Batt across its width at the mid-point of each rectangular hole to enable the Batt to be fitted into the aperture.
5. Apply ROCKWOOL Acoustic Intumescent Sealant to all edges of the Batt ensuring that an even cover is achieved over the entire thickness of the Batt. This should include the outer edges of the Batt and the edges of the cuts made across the Batt to allow fitting into the aperture.
6. Insert the Batt into the aperture.
7. Apply a bead of ROCKWOOL Acoustic Intumescent Sealant approximately 15mm wide around the perimeter of the Batt ensuring that all gaps between the Batt and surrounding edges are fully filled.
8. Apply a bead of ROCKWOOL Acoustic Intumescent Sealant approximately 15mm wide where cables pass through the Batt. Ensure that the sealant fully enclosed each cable within the tray or ladder and that all gaps are fully filled.
9. Repeat step 7 and 8 on the other side of the Batt.

Other installation information

FIREPRO® Ablative Coated Batts are not intended for use as load-bearing seals. Where a load-bearing seal is required, ROCKWOOL Firestop Compound should be considered.



Specification clauses

50mm Ablative Coated Batt is associated with the following NBS clauses:

P12 Fire stopping systems

- 325 Boards: Mineral Bound Lightweight
- 360 Mineral Wool Rigid Batts
- 365 Mineral Wool Rigid Batts: Ablative Coated

For a comprehensive range of ROCKWOOL solutions for penetrating services passing through the Ablative Coated Batt, please refer to the applicable ROCKWOOL standard details available at www.rockwool.co.uk or contact ROCKWOOL Technical Solutions.





FIREPRO®

60mm Ablative Coated Batt



Description

The ROCKWOOL Ablative Coated Batt comprises a high-density stone wool core, pre-coated on both sides with our high-performance ablated coating.

Ablative Coated Batt has been comprehensively tested as part of the ROCKWOOL FIREPRO® range of fire protection products, specifically for use in service penetrations, head of wall and other void seals.

Advantages

- Excellent fire resistance from a single thickness batt
- Suitable for sealing 20m long x 1.2m high voids at head of wall
- Suitable for large unframed voids up to 7.02m²
- Tested with dampers
- Comprehensively tested as part of the FIREPRO® suite of solutions
- Lightweight and simple to install
- Tested for air tightness, providing an additional smoke and acoustic seal

Applications

- Multiple substrates including: solid walls and floors; flexible walls
- Multi-service penetrations
- Head of wall
- Blank seals
- Face-fixed applications

For a fully comprehensive list of applications, please refer to the appropriate ROCKWOOL standard details available at www.rockwool.co.uk or contact the ROCKWOOL Technical Solutions Team.

Performance

Fire performance

Tests have proved the capability of a single 60mm Batt to provide up to 4 hours fire resistance Integrity and Insulation ratings are dependent upon the service penetrations and void size.

Acoustic performance

Tested for head of wall:

- Rw= up to 52db (2 x Coated batts)
- Rw= up to 38db (1 x Coated batts)

The correct use of Coated batt within concealed cavities and voids will reduce the level of transmitted sound:

- Rw= up to 52 db (2 x Coated batts) - incorporating 48mm O/D PVC /15mm copper pipe penetrations.
- Rw= up to 34 db (1x Coated batts) - incorporating 48mm O/D PVC /15mm copper pipe penetrations.

For specific acoustic requirements please contact ROCKWOOL Technical Solutions.

Standard and approvals

BS EN 1366-3: 2009 and the dedicated fire resistance standard for linear joint seals, BS EN 1366-4:2006. Ablative Coated Batt has been classified in accordance with BS EN 13501-2. 60mm Ablative Coated Batt is also comprehensively tested to BS 476 Part 20 & 22.

Third party accreditation through IFC and Certifire.

CE marked to ETAG 26-02.

For further information on the full scope of fire performance please refer to the appropriate standard details available www.rockwool.co.uk or contact ROCKWOOL Technical Solutions.

Note: All Ablative Coated Batt fire resistance tests were conducted using ROCKWOOL FIREPRO® ancillary products as appropriate.

Product information

Property	Description
Length	1200mm
Width	600mm
Thickness	60mm
Fire resistance	Up to 4 hours
Density	180kg/m ³
Air leakage	0.41m ³ /h/m ²



Installation

1. Make sure that the area within the aperture is clean of any debris and remove any dust from the edges.
2. Cut ROCKWOOL Ablative Coated Batt to the size and shape required to fit the aperture ensuring that batt will make a tight fit with all edges of the aperture.
3. Cut rectangular holes from the coated batt to accommodate cable trays or ladders containing cables.
4. Cut the Coated Batt across its width at the mid-point of each rectangular hole to enable the Batt to be fitted into the aperture.
5. Apply ROCKWOOL Acoustic Intumescent Sealant to all edges of the Batt ensuring that an even cover is achieved over the entire thickness of the Batt. This should include the outer edges of the Batt and the edges of the cuts made across the Batt to allow fitting into the aperture.
6. Insert the Batt into the aperture.
7. Apply a bead of ROCKWOOL Acoustic Intumescent Sealant approximately 15mm wide around the perimeter of the Batt ensuring that all gaps between the Batt and surrounding edges are fully filled.
8. Apply a bead of ROCKWOOL Acoustic Intumescent Sealant approximately 15mm wide where cables pass through the Batt. Ensure that the sealant fully enclosed each cable within the tray or ladder and that all gaps are fully filled.
9. Repeat step 7 and 8 on the other side of the Batt.

Note: For any areas of Batt where the coating has been damaged, repaint with the Ablative Coating. Ensure that there is no uncoated slab or bare mineral wool visible.

Other installation information

FIREPRO® Ablative Coated Batts are not intended for use as load-bearing seals. Where a load-bearing seal is required, ROCKWOOL Firestop Compound should be considered. For seals over 1200mm x 1200mm Batt to Batt joints are to be fully coated with FIREPRO® Glue.



Specification clauses

60mm Ablative Coated Batt is associated with the following NBS clauses:

P12 Fire stopping systems

- 325 Boards: Mineral Bound Lightweight
- 360 Mineral Wool Rigid Batts
- 365 Mineral Wool Rigid Batts: Ablative Coated

For a comprehensive range of ROCKWOOL solutions for penetrating services passing through the Ablative Coated Batt, please refer to the applicable ROCKWOOL standard details available at www.rockwool.co.uk or contact ROCKWOOL Technical Solutions.





ROCKWOOL® Ablative Coating



Description

The ROCKWOOL ablative Coating is a water based, ready to use viscous paste which may be brush or spray-applied to stone wool slabs. The coating is available in white and in other colours subject to minimum order quantities. The coating may be over painted if desired*. ROCKWOOL Ablative is supplied in 5L tubs.

Advantages

- Suitable for spray or brush application
- Dries to give a sound, flexible white surface finish
- Provides a stable surface for adhesive and fixing sealants

Applications

The ablative Coating is available separately to enable site repairs to Ablative Coated Batts, that may have been damaged during installation.

ROCKWOOL Ablative Coated Batt is intended to act as an air seal barrier to reinstate the fire resistance and acoustic performances of concrete floors, masonry walls and dry wall systems when voids have been created for the passage of services. This includes pipes made of plain or stainless steel, cast iron, copper, polypropylene (PP), high density polythene (HDPE), PVC and ABS along with all sheathed cables up to 80mm and supported cable bundles up to 100mm.

Performance

Fire performance

ROCKWOOL Ablative Coating is designed to re-seal the surface of Ablative Coated Batt where damage to the ablative coating may have occurred during installation.

ROCKWOOL Ablative Coated Batt has been tested to the dedicated fire resistance standard for penetration seals EN 1366-3. The independently prepared assessment, detailing the full scope of fire performance, is available from the ROCKWOOL Technical Solutions Team. Ablative Coated Batt fire resistance tests were conducted using ROCKWOOL acoustic Intumescent Sealant and/or ROCKWOOL FIREPRO® Glue.

ROCKWOOL Ablative Coating and stone wool slabs may only be used to fire protect service penetrations if supported by independent fire test evidence due to the variants in the density and thicknesses of stone wool slabs available

Product information

Property	Description
Cure system	Water Loss
Colour	White
Specific gravity	1.3 – 1.4
pH	8.5 – 9.2
Flashpoint	None
Solids content (%w/w)	>58%
Application temp range	+10°C to +30°C
Vice temp range	-15°C to +75°C
Shelf life	Up to 12 months when stored in unopened containers under cool, dry conditions. AVOID FROST and extremes of temperature
Durability	Up to 15 years when used as recommended
Flashpoint	180kg/m ³
Solids content (%w/w)	0.41m ³ /h/m ²

Installation

ROCKWOOL Ablative Coating can be spray or brush-applied.

Specification clauses

ROCKWOOL Ablative Coating is associated with the following NBS clauses:

P12 Fire stopping systems
<ul style="list-style-type: none">▪ 325 Boards: Mineral Bound Lightweight▪ 360 Mineral Wool Rigid Batts▪ 365 Mineral Wool Rigid Batts: Ablative Coated

*Please contact ROCKWOOL Technical Solutions for guidance on suitable paints



ROCKWOOL® Firestop Compound



Description

Firestop Compound is a specially formulated gypsum-based compound, which is mixed with water to be trowelled or poured around service penetrations.

Advantages

- Inhibits smoke
- Good acoustic barrier
- Suitable for sealing around most types of service penetrations
- Load bearing capability
- Simple installation
- No smoke emission
- Unaffected by humidity

Applications

- Re-instating the fire resistance of wall and floor constructions
- Load bearing floors
- Wall penetrations
- Load bearing seals around unsupported fire dampers

Performance

Acoustic performance

Thickness of Compound (mm)	Weighted Sound Reduction Index (Rw)
75	39dB
100	46dB
150	51dB

For specific information on acoustic performance please contact ROCKWOOL Technical Solutions on 01656 868490 or technical.solutions@rockwool.co.uk.

Load bearing capability

Thickness of Compound (mm)	Max. load bearing area free of services
75	500 x 500mm
100	750 x 750mm

Openings with a clear area larger than 750 x 750mm need to be reinforced as outlined within the installation section. For further information on the reinforcement of openings greater than 750 x 750mm, please contact ROCKWOOL Technical Solutions on 01656 868490 or technical.solutions@rockwool.co.uk

Technical information

Standards and approvals

FIREPRO® Firestop Compound has been tested to BS 476 Part 20:1987

FIREPRO® Firestop Compound is third party accredited through IFC and Certifire.

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details.

Fire performance

Firestop Compound has been independently tested for use in walls and floors.

When reinforced, Firestop Compound offers up to 360mins protection for both Integrity and Insulation in masonry/ concrete walls or concrete floors.

When un-reinforced, Firestop Compound offers up to 240mins protection for both Integrity and Insulation in masonry/ concrete walls or concrete floors.

Plastic pipework must be protected with either ROCKWOOL Firestop Pipe Collars or Intumescent Pipe Wraps. For further advice on specific applications and fire performance, please contact ROCKWOOL Technical Solutions on 01656 868590 or technical.solutions@rockwool.co.uk.

Firestop Compound - Spans with services

Non-reinforced seal

Firestop Compound thickness (mm)	Fire rating (hours)	Max. opening width x any linear length (mm)	Load bearing capacity (Kn)
75	2	500	2.5
100	4	750	2.5



Simply reinforced seals

Firestop Compound thickness (mm)	Fire rating (hours)	Max. opening width x any linear length (mm)	Load bearing capacity (Kn)
100	4	Up to 1500	2.5

Product information

Property	Description
Pack Size	22kg Bag
Fire Resistance	Up to 6 hours
Load Bearing Capacity	Up to 2.5KN
Acoustic Performance	Up to 51dB

Installation

Floor installations

In floors, a permanent shuttering made from 50mm ROCKWOOL slab (minimum density 140kg/m³) is cut and friction fitted between services and the edges of the floor slab. Firestop Compound is then trowelled over the shutter to a depth of 25mm thick. This is allowed to cure. Further Firestop Compound is then mixed to a pouring grade and tops the seal up to the required depth (See Figure 1).

Firestop Compound sets in 30-45 minutes and is capable of accommodating light foot traffic in approximately 72 hours.

Installation instructions – Floors

1. Mix a bag of compound to 10 litres of water (3:1) by volume. Vary to suit site conditions.
2. Set the shuttering into the opening ensuring a tight fit so that once the required depth of compound is installed it finishes flush with the floor slab/screed unless otherwise specified.
3. Mix and pour compound until the required thickness is achieved.

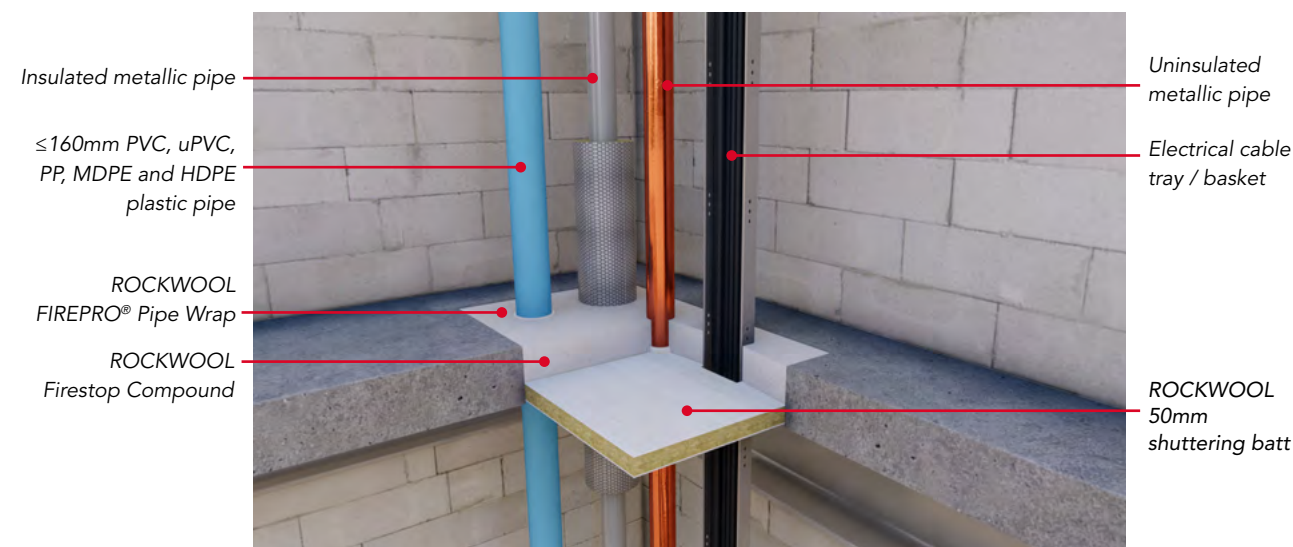


Figure 1

Wall installations

In wall applications (See Figure 2), Firestop Compound is mixed into a stiff consistency for trowelling into openings.

Installation instructions – Walls

1. Mix a bag of compound to 10 litres of water (3:1) by volume. Vary to suit site conditions.
2. Apply the compound using the specified shuttering method (See Figure 3).
3. Trowel the compound starting at the base of the opening ensuring the correct thickness of material is installed. Work progressively towards the top of the opening until the barrier is complete. If the shuttering panel is set at the centre, repeat the process on the other side.



Figure 2

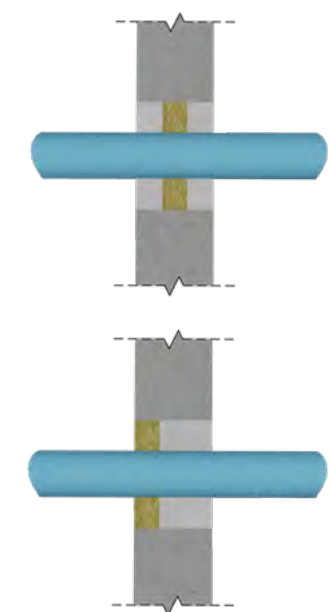


Figure 3

Coverage

Thickness of compound (mm)	Number of bags/m ²
75	3.15
100	4.20
150	6.30

The above calculations are approximate and based on 22kg bags.
The coverage rates shown do not take into account the area of service penetrations within the aperture.

Specification clauses

ROCKWOOL Firestop Compound is associated with the following NBS clauses:


P12 Fire stopping systems

- 340 Intumescent Mortar



FIREPRO®

HS Firestop Compound

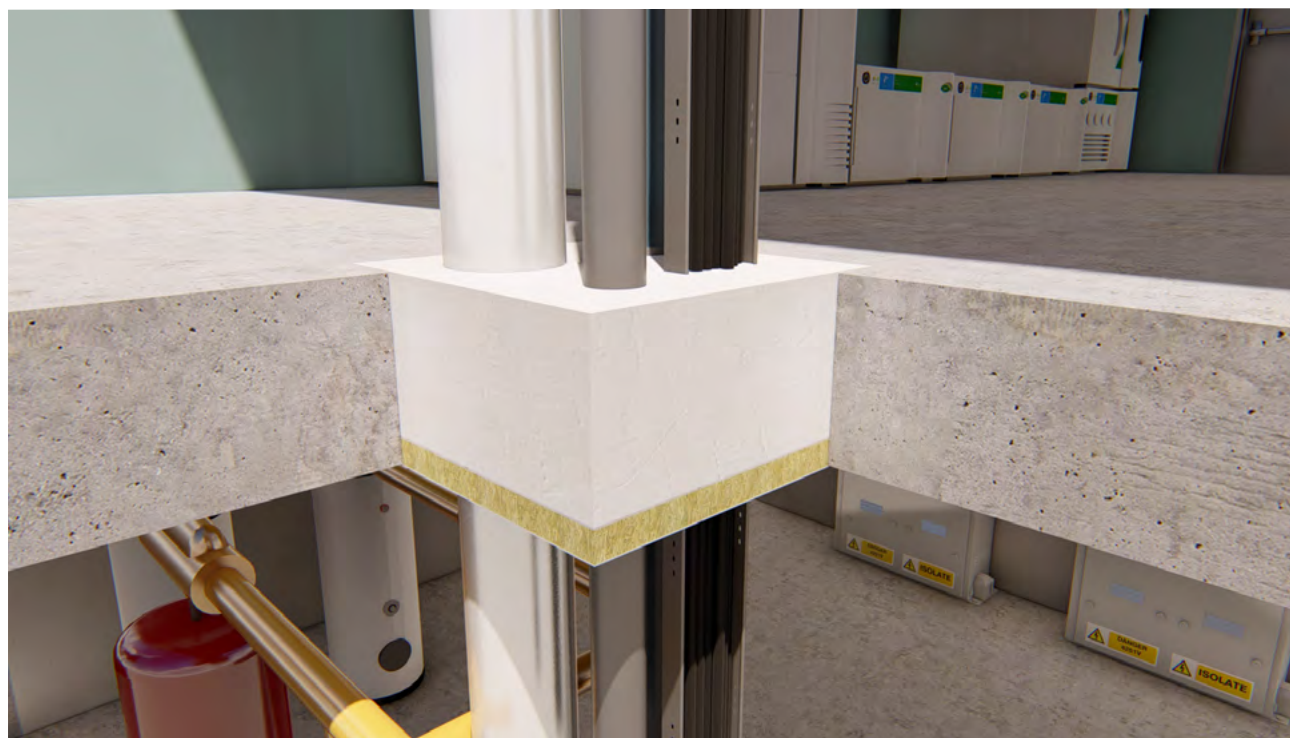

Description

HS Firestop Compound is a specially formulated gypsum-based mortar, which is mixed with water to create a workable range from stiff to pourable mix. HS Firestop Compound is also suitable for pre-casting into convenient size blocks for use in wall openings.

Advantages

- Unsupported spans of up to 1800mm
- High load bearing capacity
- Suitable for use with multiple service penetrations
- Can be formed into blocks
- Good acoustic barrier
- Effective smoke seal
- Rapid setting

Applications

- Re-instating the fire resistance of wall and floor constructions
- Load-bearing floors
- Wall penetrations
- Load-bearing seals around unsupported fire dampers

Performance

Fire performance

HS Firestop Compound has been independently tested for use in walls and floors.

Plastic pipework must be protected with either ROCKWOOL Firestop Pipe Collars or Intumescent Pipe Wraps. For further advice on specific applications and fire performance, please contact ROCKWOOL Technical Solutions on 01656 868590 or technical.solutions@rockwool.co.uk

Floor seals - Maximum aperture 1800 x 1800					
Service	Diameter (mm)	Wall thickness (mm)	Min floor thickness (mm)	Classification	
				E	EI
Copper pipe ‡	40-107	1.5-14.2	100	60	15
Steel pipe ‡	40-115	3.5-14.2	100		120
Steel pipe ‡	116-160	5-14.2	100	120	90
Electrical cables P	≤80	N/A	100	120	60
Non-sheathed wires P	≤24	N/A	100		120
Telecom cables P	100mm bundle	N/A	150		120
Floor seals – Maximum aperture unlagged solutions for cables and conduits					
Cable trays	≤450mm		100		120
Cable ladders	≤300mm		100		120
Electrical cables	≤21mm		100		120
Electrical cables	22-80mm		100	120	90
Non-combustible conduits	≤16mm		100		90

‡ - Service fitted with 50mm thick H&V 500mm above floor (L/I)

P - Service fitted with 25mm thick Ductwrap 500mm above floor (L/I)

Rigid walls min 150mm thick - Maximum aperture 2600 x 2600					
Service	Diameter	Wall thickness	Min wall thickness	Classification	
	(mm)	(mm)	(mm)	E	EI
Blank seal 2.6 X 2.6M	No services		150		240
Non-combustible pipe ‡	40 - 219⚡	1.0-14.2	150		240
Perforated cable trays	≤500mm	n/a	150		240
Non-perforated cable trays	≤500mm	n/a	150	240	180
Cable ladders	≤350mm	n/a	150	240	120
Cable ladders	≤200mm	n/a	150	240	240
Electrical cables (s)	≤21mm	n/a	150	240	120
Electrical cables (m)	22-50mm	n/a	150	240	120
Electrical cables (l)	51-80mm	n/a	150	240	120
Non combustible conduits	≤16mm	n/a	150	240	240
Combustible conduits	≤16mm	n/a	150	240	180

‡ - Service fitted with 1m long 25mm thick H&V section (C/S) - 0mm separation distance to each other and aperture opening

⚡ - When installed in opening with cable services, the diameter range reduces to 40 - 108 with 10mm spacing



Acoustic performance

HS Firestop Compound has been tested in accordance with EN 10140 achieving Rw 57dB at a depth of 100mm (with 50mm ROCKWOOL shuttering batt).

For specific information on acoustic performance please contact ROCKWOOL Technical Solutions on 01656 868490 or technical.solutions@rockwool.co.uk

Load bearing capability

HS Firestop Compound in floor spans of up to 1800mm without the need for further reinforcement. For further information on the load bearing capacity of HS Firestop Compound, please contact ROCKWOOL Technical Solutions.

Property	Description
Description	Grey coloured free flowing powder
Pack size	20kg bag
Density	1750-1900kg/m ³
Loadbearing	2.5KN/m ² UDL
Fire resistance	Up to 4 hours
Acoustic performance	Rw 57dB (100mm Depth)
Max unsupported span	1800mm
Thermal conductivity	0.45W/mK
Setting expansion (%)	0.1
Typical yield	±6bags/m ² at 100mm depth
Expected shelf life	6 months (When stored in accordance with the packaging instructions)

Technical information

Standards and approvals

FIREPRO® HS Firestop Compound has been tested for resistance in accordance with BS 476 Part 20 and EN 1366-3.

HS Firestop Compound has been classified as EI 120 in accordance with EN 13501-2

FIREPRO® Firestop Compound is third party accredited through Certifire.

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details.

Installation

Mixing

HS Firestop Compound can be mixed preferably by mechanical paddle or manually, if required. Measure out the correct amount of clean water into a clean container to achieve the desired consistency.

Avoid any cross-contamination with part-cured and new mixes as this can accelerate curing times.

HS Firestop Compound: water ratio
Pourable Mix ratio of 3 - 3Vz:1
Trowel Mix ratio of 4:1

Gradually add the HS Firestop Compound, stirring continually. Continue mixing until the compound is mixed to a smooth, even consistency. Any spillage should be wiped up with a damp cloth before setting occurs*. Mix only enough material sufficient for use within the recommended pot life (20-30 minutes). Pot life and set times will be reduced for lower water content and higher temperatures.

**HS Firestop Compound may stain pipes and services*

Installation should not be carried out when temperatures are above 35°C. Setting times are normally between 30 and 90 minutes.

Note: Do not attempt to extend working time by remixing with additional water once the mortar has started to set, as this will interfere with the setting process. Always mix in clean buckets.

Fit a shuttering board to the bottom of the opening. Shuttering materials must be able to support the wet weight of the compound under pouring conditions. Pour HS Firestop Compound to the required 100mm thickness.

General installation requirements

Ensure that the aperture and services in question are tested with HS Firestop Compound, and the site conditions are within the application specification.

All services and apertures need to be clean and clear of all dust and loose particles. The aperture temperature needs to be at 5°C or above at time of installation. Plastic pipework must be protected with either ROCKWOOL Firestop Pipe Collars or Intumescent Pipe Wraps.

Upon installation make sure that you install the HS Firestop Compound to the recommended ratio for the aperture you are installing, make sure that you fill the full depth in a single pour to create a solid structure. Apply a minimum depth of 100mm in a single pour to achieve loadbearing capabilities.

Once filled, smooth off the HS Firestop Compound to produce a professional finish.

Wall openings (Figure 1)

For small holes and gaps, trowel a stiff mix into the opening to the correct depth. For larger holes, use an appropriate non-combustible shuttering material to support the mix until it sets, or, if a fair faced finish is required to both sides, consider using a sandwich construction. Alternatively, the HS Firestop Compound may be pre-cast into convenient sized blocks, a stiff mix being used as a bedding mortar. All combustible services (Plastic Pipes etc.) should have a ROCKWOOL tested fire rated closure device/material fitted prior to the pouring of the HS Firestop Compound.



Floor openings (Figure 2)

When sealing holes in floor slabs, appropriate shuttering must be installed, cut to fit tightly around any services within the opening, to support the wet mix until it sets. Non-combustible shuttering materials, such as mineral fibre slab, can be left in place, but combustible materials must be removed, after the mix has set. For complex penetrations it may be preferable to initially form a thin seal around all services with a nominal 5mm layer of the HS Firestop Compound mix. Once this has set, the remaining depth of seal should be poured in one operation. All combustible services (Plastic Pipes etc.) should have a tested fire rated closure device/material fitted prior to the pouring of the HS Firestop Compound.

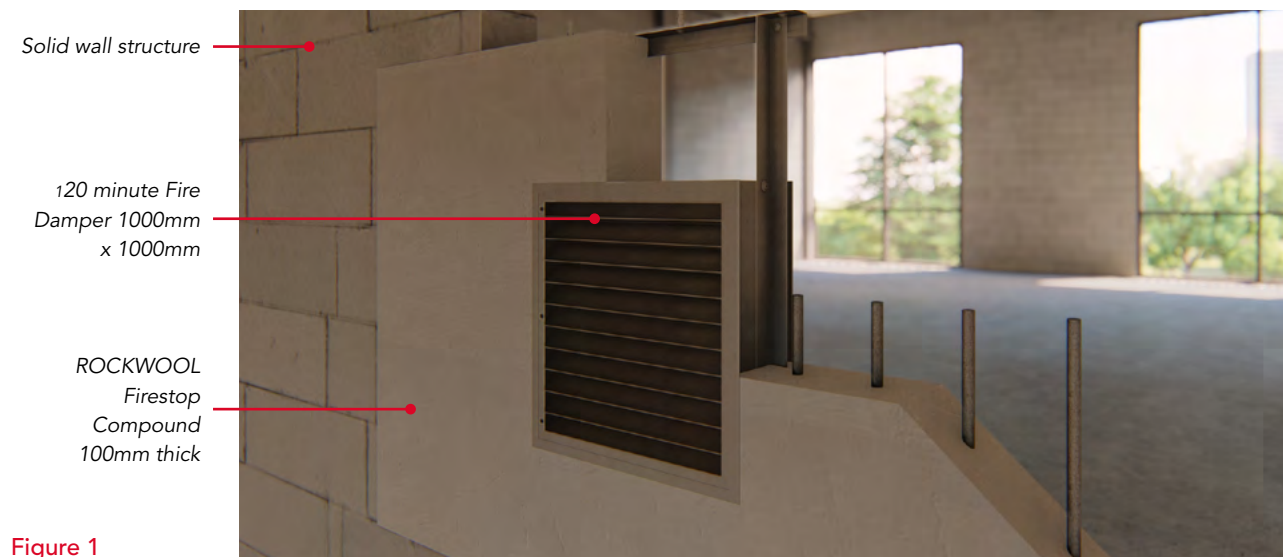


Figure 1

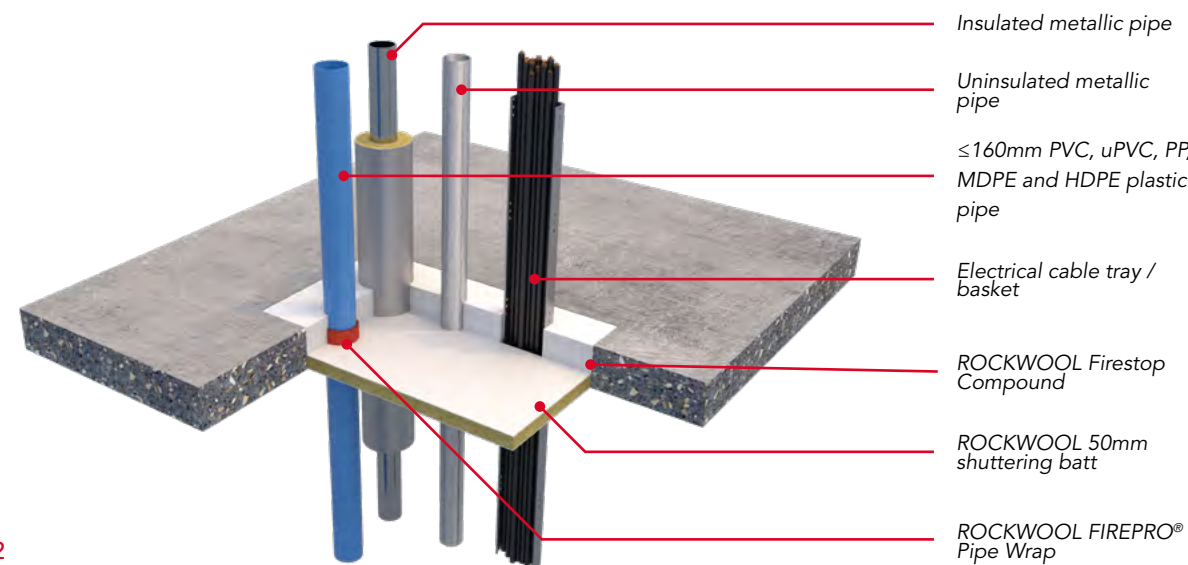


Figure 2

Specification clauses

ROCKWOOL Firestop Compound is associated with the following NBS clauses:


P12 Fire stopping systems

- 340 Intumescent Mortar





FIREPRO® Intumescent Pillows CE

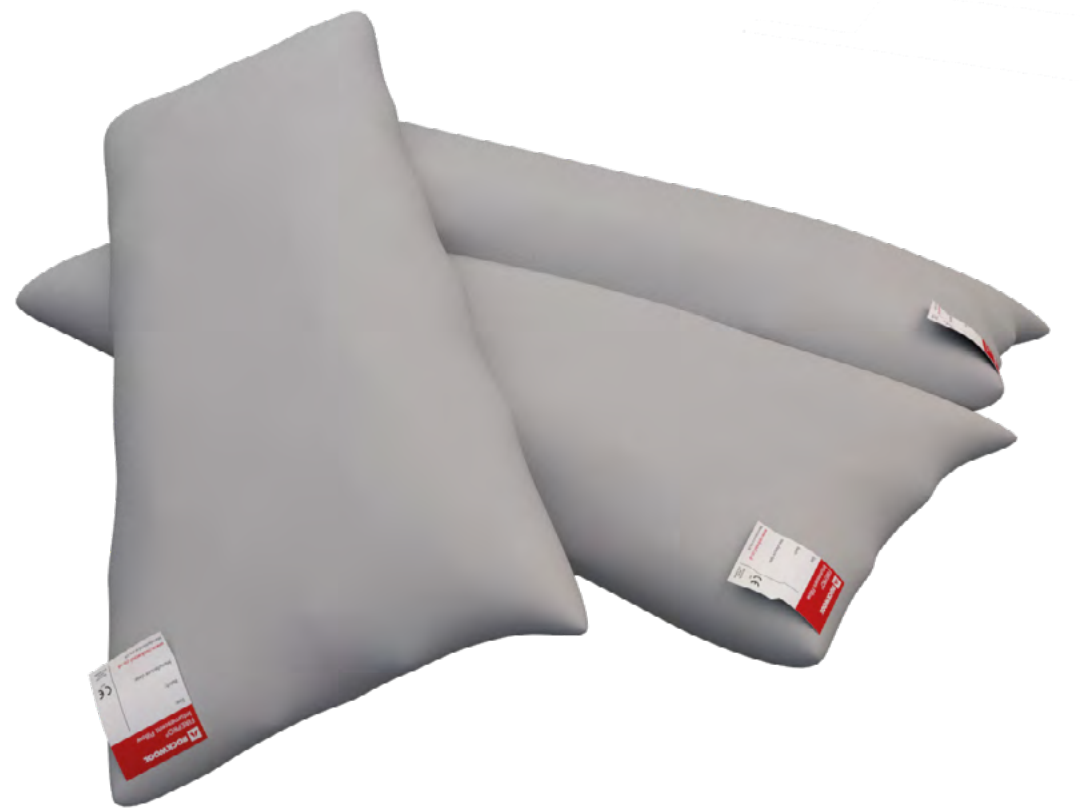

Description

FIREPRO® Intumescent Pillows CE consist of intumescent material encased within a waterproof glass cloth bag. Intumescent Pillows CE are designed to create a temporary or permanent fire seal around all types of services to maintain continuity of fire performance of compartment walls and floors. They are an ideal solution for applications where services are required to be changed or replaced on a regular basis.

Easy to install, they are simply packed tightly in between penetrating services and the wall. In a floor, pillows are additionally supported by means of a mesh support system (see Figure 2 on page 6).

Advantages

- Easy to install
- Easy to remove and reinstate when changing services
- Maintenance free
- Dry system
- Reusable

Applications

Under fire conditions, Intumescent Pillows CE expand several times their original volume to form an effective seal around service penetrations. Intumescent Pillows CE are suitable for use with:

- Metal pipework
- Plastic conduits
- Cable trays/ladders

Note: For applications inside metal cable trunkings please contact ROCKWOOL

Performance

Fire performance

ROCKWOOL Intumescent Pillows CE provide up to 2 hours fire rating where services pass through fire-rated walls.

Table 1: Performance in Masonry Supporting Walls - BS EN 1366-3:2009

Rigid wall construction 150mm thick (min.) Intumescent Pillow CE seals 330mm deep laid centrally within the aperture with 75mm projection from each face of wall. Additional FIREPRO® Intumescent Pillows CE to be sewn to provide additional protection to the cable to minimum distance of 300mm either face of the seal.

Services	Fire resistance (min)	
	Integrity (E)	Insulation (I)
Telecom cables up to 21mm Ø (single or bundles up to 100mm Ø)	120	120
Electrical cables up to 21mm Ø	120	120
Electrical cables up to 50mm Ø	120	90
Electrical cables up to 80mm Ø	120	90
Unsheathed wires up to 24mm Ø	120	120
Steel or Copper conduits and tubes up to 16mm Ø	120	120
Plastic (any) conduits and tubes up to 16mm Ø	120	120
Cable trays or ladders up to 300mm wide	120	60
Cable trays up to 500mm wide	120	90
108mm Ø x 1.5-14.2mm thick copper pipe (C/U)*	120	90

Note: Maximum aperture size 1100mm x 1100mm

Minimum density masonry walls - 650kg/m³ 330mm bag length to be laid horizontally in wall void. Bags should be laid centrally within all wall thicknesses.



Figure 1



Fire stopping: Section 1 - Penetration seals

Table 2: Performance in Masonry Supporting Walls - BS EN 1366-3:2009

Rigid wall construction 150mm thick (min.) Intumescent Pillow CE seals 330mm deep laid centrally within the aperture with 75mm projection from each face of wall.

Services	Fire resistance (min)	
	Integrity (E)	Insulation (I)
165mm Ø x 5.6-14.2mm thick mild steel pipe (C/U)*	120	0
48mm Ø x 3.5-14.2mm thick steel pipe with 300mm local interrupted (LI)** foil faced cermic blanket 7mm thick (C/U)*	120	120
113mm Ø x 4.5-14.2mm thick steel pipe with 300mm local interrupted (LI)** foil faced cermic blanket 10mm thick (C/U)*	120	120

Note: Maximum aperture size 1100mm x 1100mm

All pipes tested according to EN 1366-3 have been tested with a specific pipe end configuration. All pipes have been tested U/C unless otherwise stated in the tables.

The EN test standard EN 1366-3 states, "it is important to ensure that sealing systems have been tested with appropriate pipe end conditions."

The specification of pipe closure devices will be determined based on the scope of test data and whether the pipework is ventilated or not.

Key

* The product can withstand temperature travelling along the service.

** LI - Local interrupted - insulation installed up to face of pillows.

U/U = Uncapped inside and outside the furnace

U/C = Uncapped inside and capped outside the furnace.

C/U = Capped inside and Uncapped outside the furnace.

Table 3: Performance in Masonry Supporting Floors - BS 476:Part 20:1987

Concrete floor construction to be 100mm thickness for fire periods up to 60 minutes and 150mm thickness for periods up to 120 minutes. The minimum density for the concrete floor is 780kg/m³.

Services	Pillow thickness (mm)	Fire resistance (min)	
		Integrity (E)	Insulation (I)
Cable ladders & communication cables	150	30	30
Cable ladders & communication cables	200	60	60
Cable ladders & communication cables	250	90	90
Cable ladders & communication cables	300	120	120
Cable ladders & communication cables	150	60	0
Cable ladders & communication cables	200	120	0
No Services - blank seal	150	60	60
No Services - blank seal	200	120	120

Note: Maximum aperture size 1100mm x 1100mm

Steel mesh (50mm square with 5mm wire) to be mechanically fastened within the reveal of the aperture via returning the edge of the wire mesh.

Pillows to be packed tightly into the opening and around the services.



Technical information

Standards and approvals

FIREPRO® Intumescent Pillows CE have been tested in accordance with BS EN 1366 Part 3: March 2009 achieving fire resistance of up to 2 Hours (EI120) in walls and dependent upon service type - see Tables 1 & 2 (pages 4 & 5).

FIREPRO® Intumescent Pillows CE have been tested in accordance with BS 476:Part 20:1987 in rigid floors achieving fire resistance of up to 2 hours (EI120) - see Table 3 (page 6).

Product information

Property	Description
Length	330mm
Width	50mm, 200mm
Thickness	20mm, 25mm, 45mm
Fire resistance	Up to 2 hours integrity and insulation (EI120)
Application	Internal
Shelf life	N/A if stored in cool, dry, well ventilated area
Acoustic	Airborne Sound Insulation Rw (C,Ctr) = 33 (0,-2)
Air permeability	Tested to EN1026

Installation

Installation in floors

1. Make a basket using galvanised steel mesh (50 x 50mm squares x 5mm wire diameter) to sit into the hole in the floor slab. There should be a minimum 50mm overlap onto the surrounding floor slab or wall. Mechanically fix to top of floor slab or wall.
2. Lay Intumescent Pillows CE standing on end into the wire basket. Pack the pillows tightly into the basket around the penetrating services.
3. If required, lay a sheet of the galvanised steel mesh over the basket and tie together using steel wire.

Installation in walls

1. Push the first Intumescent Pillow CE into the hole to be filled, so that the longest dimension (330mm long) spans across the wall with 75mm projection from either face.
2. Pack the hole tightly with additional Intumescent Pillows CE, staggering the joints, until it is tightly packed.
3. For wall penetrations, the pillows are normally self supporting, but for large openings with few penetrations, you may require a steel retaining mesh for support on both sides of the penetration.
4. Smaller pillows are used as appropriate to fill smaller gaps.

Installation of service penetrations

1. The total amount of cross sections of services should not exceed 60% of the penetration area.
2. The minimum permitted separation between adjacent seals/apertures is 200mm.
3. Pipes must be installed singular, cables require no minimum separation.
4. Services in walls shall be supported via steel angles/hangers/channels a maximum 250mm (BS EN 1366-3:2009) or a maximum 500mm (BS 476:Part 20:1987) from the face of the separating element.
5. Pipes must be perpendicular to the seal surface.

Coverage

Table 4: Estimating quantities.

Pillow size (mm)	Approximate number
330 x 200 x 45	113 per m ² opening
330 x 200 x 25	180 per m ² opening
330 x 50 x 20	As required to fill small voids

Specification clauses

FIREPRO® Intumescent Pillows CE are associated with the following NBS clauses:

P12 Fire stopping systems

- 345 Intumescent pillows





FIREPRO® Multi-Cable Firestop



Description

Multi-Cable Firestop is compressible fire retardant foam which is laminated both sides with a graphite based intumescent polymer. Multi-Cable Firestop is supplied in sections measuring 60mm wide x 25mm thick x 1000mm long.

Advantages

- Simple to install
- Cables can be easily added/removed
- No de-rating of cables required
- Maintenance free
- Dry installation

Applications

FIREPRO® Multi-Cable Firestop has been developed to provide fire protection in all electrical trunking and cable trays at the junction in which these services pass through the compartment wall. FIREPRO® Multi-Cable Firestop can be used where electrical services pass through both walls and floors providing up to 4 hours fire resistance.

Performance

Fire performance

Services and support	Surrounding penetration seal	Width of fire stop for each Coated Batt (mm)	Maximum void height (mm) (no. of fire stop plies)	Fire resistance integrity (mins)		
				Seal in masonry wall	Seal in a plaster-board wall	Seal in a concrete floor
Cables (see note 1) secured to appropriately supported perforated steel cable trays/ladders	Single 60mm ROCKWOOL Ablative Coated Batt	60	25(1) 55(2) 80(3)	180 120 120		180 120 n/a
	Double 60mm ROCKWOOL Ablative Coated Batt	60	25(1) 55(2) 80(3)	240 240 240	60 60 60	240 240 n/a
Cables (see note 1) within PVC trunking (max. 100 x 100mm)	Double 60mm ROCKWOOL Ablative Coated Batt with no air gap	60	100(1)	240	60	-

Fire performance - Service penetration requirements

1. Suitable for copper cored / PVC sheathed and insulated power cables up to 12mm diameter, secured on perforated trays/ladders or within PVC trunking passing through both walls and floors.
2. Cables and trays must be supported within 500mm on both sides of the seal.
3. Maximum of 3 layers of cables, each layer sealed with the Multi-Cable Fire stop.
4. The aperture width cut from the ablative Coated Batt should match the width the cable tray or PVC trunking (maximum 100mm).
5. There must be a minimum of 100mm width of ablative Coated Batt between the penetration and the edge of the main aperture within the supporting construction.
6. Maximum depth filled must not exceed 60mm.



Technical information

Standards and approvals

FIREPRO® Multi-Cable Firestop has been tested to BS 476: Part 20: 1987 and can provide up to 4 hours fire protection in joints.

Acoustic Intumescent Sealant is third party accredited through IFC and Certifire.

Product information

Property	Description
Length	1000mm
Width	60mm
Thickness	25mm
Fire resistance	Up to 4 hours

Installation

- Where a single Multi-cable Firestop is installed in fire-resisting walls (which will require fire resistance from either side), the Ablative Coated Batt and Multi-cable Firestop should be fitted centrally within the thickness of the wall. Twin layer Batts/Seals with an air gap should be aligned with each face of the wall.
- If a wall/floor does include a decorative finish, such as plaster, the Ablative Coated Batts must not be installed flush with the surface of this decorative finish; it must be recessed, to remain aligned with the face of the 'solid' construction.
- Where the Multi-cable Firestop is installed in fire-resisting floors, it shall be positioned approximately 15mm from the upper surface of the slab.
- Limitations and specifications for the construction of associated walls, partitions, and floors shall be as defined in Appendix K.
- Cables must be secured to perforated cable trays, which must be fully supported within at least 500mm of both sides of the construction element; and using a support system that will remain effective under fire conditions. Cable trays may penetrate horizontal or vertical construction elements.
- Cables may also be included within PVC trunking, which must be fully supported within at least 500mm of both sides of the construction element; and using a support system that will remain effective under fire conditions. PVC trunking may only penetrate walls. The lid of the trunking should be cut within 100-150mm of the Ablative Coated Batt barrier to facilitate the installation of, or access to, cables and the Multi-cable Firestop within the trunking.
- Only one single layer of cables may be included on each cable tray, or within the trunking, prior to application of the multi-cable firestop material. Additional cables may be included between extra sections of Multi-cable Firestop, if necessary; but only one single layer of cables may be included between each subsequent section of Multi-cable Firestop material, where included.
- Over-compression of the seal can cause lateral expansion or misalignment of the activated strips; and the seals should be installed carefully, with consideration to the layers/thickness of cables.
- Maximum diameter of any cable is 12mm, and only power cables, of the type with multi-core copper conductor and PVC insulation/sheath, are approved.
- The aperture in the Ablative Coated Batt must match the width of the perforated cable tray.
- The section(s) of Multi-cable Firestop must extend over the full width of the aperture within the Ablative Coated Batt; i.e. to fill the aperture and the tray.

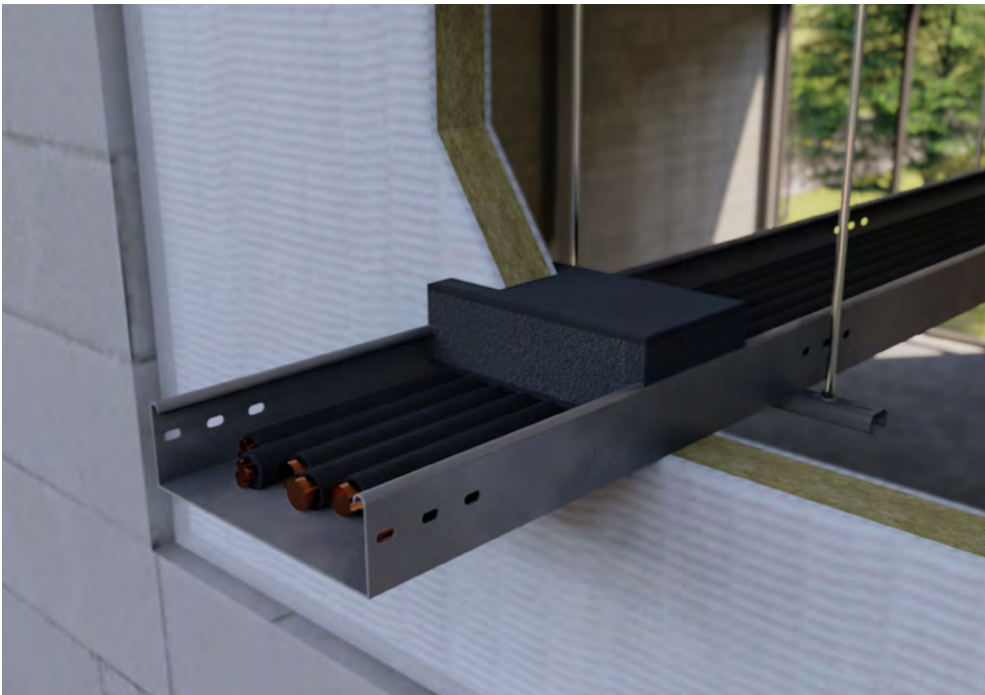


Figure 1

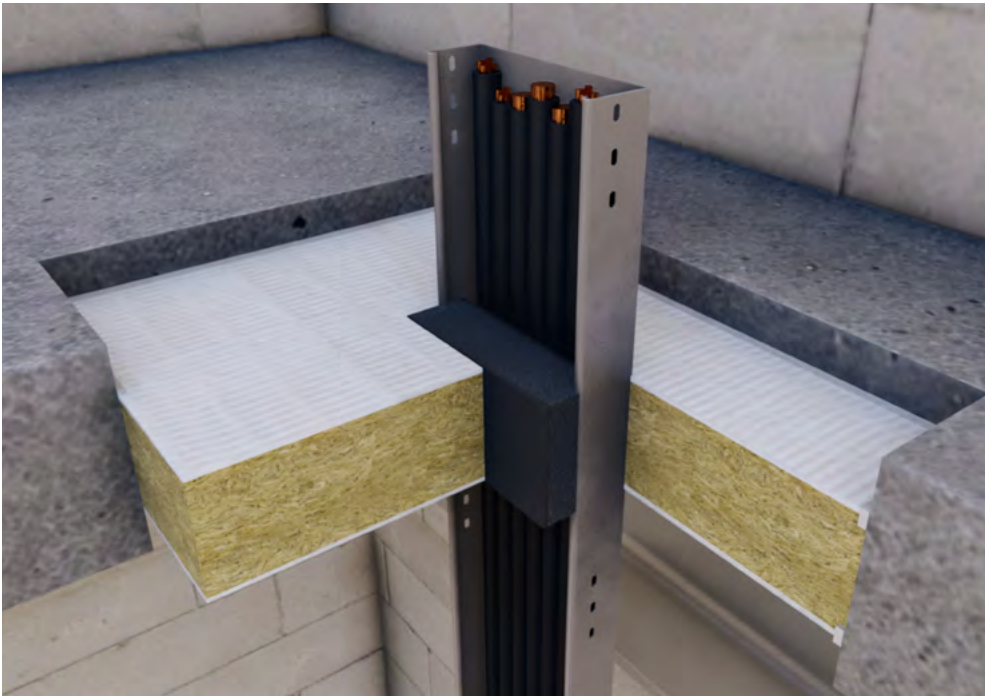


Figure 2

Specification clauses

FIREPRO® Multi-Cable Firestop is associated with the following NBS clauses:

P12 Fire stopping systems

- 330 Fire stop laminate



FIREPRO® Intumescent Putty Pads



Description


Intumescent Putty Pads are manufactured from a red non-setting, flexible silicone based intumescent polymer. They will not harden, crack or dry out with age.

The intumescent properties activate as temperatures reach 200°C, restricting the passage of fire and smoke.

External socket Intumescent Putty Pads provide a fast, efficient and clean method of achieving the required fire and acoustic ratings as specified in the 2006 edition of the Building Regulations approved document part E and B, sections 7 and 7.12 b.

Advantages

- Available for single & double sockets
- Up to 2 hours fire resistance
- Reduces noise transfer
- Pre-cut for simple installation
- Maintenance free

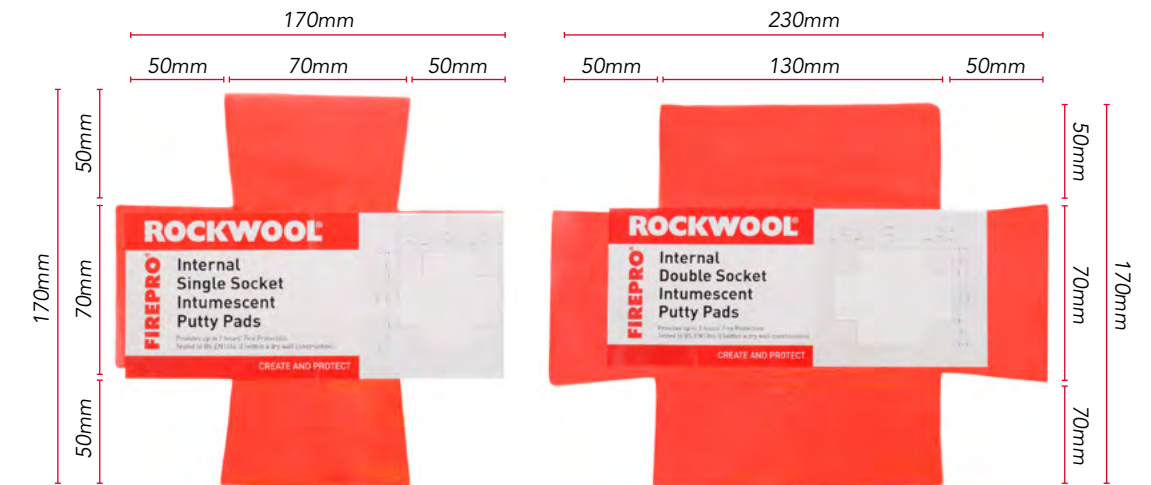

Applications

Intumescent Putty Pads are designed for (but not limited to) effecting a fire and acoustic seal around plastic or metal electrical socket boxes. Using the putty pads removes the need to install time-consuming baffle boxes.

Under fire conditions the intumescent pad expands to fill the void left by the burnt out electrical socket box, preventing the spread of fire through the plasterboard wall. The intumescent putty can also be used for upgrading the acoustic performance of partitions where electrical sockets boxes have penetrated the wall, reducing room-to-room noise transfer.

Performance

Fire performance

Tested to BS 476 Part 20:1987/EN1366-3, Acoustic Intumescent Putty Pads offer up to 2 hour fire resistance.

Acoustic performance

Measurement of airborne sound insulation was made in accordance with BS EN ISO 140-3:1995. Single number quantities were calculated in accordance with BS EN ISO 717-1:1997.

Intumescent Putty Pads (Internal socket) offer a weighted sound reduction index of up to 67db. Tests were conducted by BRE Acoustics who hold UKAS accreditation for the measurement of sound insulation in the field and the laboratory. The measurements were conducted using the procedures accredited by UKAS.

Technical information

Product information

Property	Description
Suitable socket size	Single & double gang
Suitable socket type	Internally & externally mounted
Activation temperature	200°C
Application temperature	0°C to 40°C
Acoustic performance	Up to 67 dB
Shelf life	Up to 24 months
Fire resistance	Up to 2 hours



Installation

1. Remove the socket plate.
2. To ensure a high-quality seal, ensure the socket box is clean, dry and free from any dirt and dust.
3. Remove the protective paper from one side of the pad and align the pad so that it fits centrally over the switchbox. (can be installed to either the inside or the outside of the socket, depending on the fitting method / type of socket).
4. Firmly press and mould the pre-formed putty pad into the back of the box and around the cables ensuring the pad perimeter is sufficiently bonded.
5. Remove the remaining protective paper and trim off any excess material to leave a neat finish.
6. Replace and secure the socket plate.



Figure 1



Figure 2



Figure 3

Specification clauses

FIREPRO® Multi-Cable Firestop is associated with the following NBS clauses:

P12 Fire stopping systems

- 350 Intumescent Putty





FIREPRO® Pipe Collars CE



Description

Tested to the harmonised European Standard EN 1366-3:2009, FIREPRO® Pipe Collar CE provides up to 4 hours fire stopping in rigid floor constructions and up to 2 hours fire stopping in flexible/rigid wall constructions. The penetration seal is certified to internationally recognised standards such as Certifire and CE marking.

FIREPRO® Pipe Collar CE is slim in design (depth 30mm or 40mm) allowing it to be installed around a service where space is restricted. FIREPRO® Pipe Collar CE can be installed on flexible wall, rigid wall and rigid floor constructions. When used around plastic combustible pipes, FIREPRO® Pipe Collar CE will form a penetration seal to reinstate the fire resistance performance of the wall or floor construction.

FIREPRO® Pipe Collar CE consists of a corrosion resistant powder coated steel sleeve, containing a flexible graphite based intumescent liner which is manufactured to suit standard diameter plastic pipework. Under fire conditions, the intumescent material within the collar expands, crushing the pipework and closing the void left by the pipework, preventing the passage of fire.

Advantages

- High performance intumescent
- Quick and easy to install
- Up to EI240* fire resistance
- Suitable for flexible wall and rigid wall/floor constructions
- Available to suit plastic pipe sizes ranging from 32mm to 160mm OD
- Allows for thermal and mechanical movement of pipe
- Tested in conjunction with FIREPRO® Ablative Coated Batt seals

*EI = Integrity/Insulation

Applications

Tested to reinstate the fire performance of rigid and flexible walls (minimum 100mm) and rigid floors (minimum 150mm) where combustible plastic pipes penetrate.

Fire resistance testing to EN 1366-3 and proven to perform for up to EI 240 in rigid floors and EI 120 in flexible/rigid walls.

Used to seal standard plastic pipe penetrations 32mm – 250mm diameter.

Standard plastic pipes tested are PVC-U, PP, PE.

FIREPRO® Pipe Collar CE is supplied in assembled form, without fixings. The collar is wrapped around the pipe at the soffit of a rigid floor or both faces of rigid/flexible walls.

Performance

Table 1: Pipe Collar CE faced fixed on underside of Rigid Floor (min. 150mm thickness)

Penetration specification	Diameter (mm)	Wall thickness (mm)	Fire performance	
			Integrity (E)	Insulation (I)
PP Pipes	32 - 160	2.9 - 14.6	240	240
PE Pipes	32 - 160	2.9 - 10	240	240
PVC-U	32 - 160	1.8 - 9.5	240	240

Table 1A: Pipe Collar CE faced fixed on both sides of Rigid Floor (min. 150mm thickness)

Penetration specification	Diameter (mm)	Wall thickness (mm)	Fire performance	
			Integrity (E)	Insulation (I)
PP Pipe	110	2.7	120	120
PP Pipe	160	4	120	120

Table 1B: Face Fixed on Both Sides of Rigid Floor (min 150mm thick)

Penetration specification	Diameter (mm)	Wall thickness (mm)	Fire performance
			Classification
PP Pipes	110	2.7	EI 120 U/ U*
PP Pipes	160	4	EI 120 C/U*

*U = Uncapped (pipe end open)
C = Capped (pipe end closed)

All pipes tested according to EN 1366-3 have been tested with a specific pipe end configuration. All pipes have been tested U/C unless otherwise stated in the tables.

The EN test standard EN 1366-3 states, "it is important to ensure that sealing systems have been tested with appropriate pipe end conditions."

The specification of pipe closure devices will be determined based on the scope of test data and whether the pipework is ventilated or not.





Table 2: Pipe Collar CE faced fixed on both sides of Flexible or Rigid Wall (min 100mm thick)

Penetration specification	Diameter (mm)	Wall thickness (mm)	Fire performance	
			Integrity (E)	Insulation (I)
PVC	32 - 160	1.8 - 9.5	120	120
PP	32 - 160	2.9 - 14.6	120	120
PE	32 - 160	2.7 - 10	120	120

Table 2A: Pipe Collar CE faced fixed on both sides of Rigid Wall

Penetration specification	Diameter (mm)	Wall thickness (mm)	Fire performance	
			Integrity (E)	Insulation (I)
PP Pipe	110	2.7	120	120
PP Pipe	160	4	120	120
PP Pipe	250	6.2	120	120

Table 2B: FIREPRO® Pipe Collar CE installed on both sides of rigid wall


Penetration specification	Diameter (mm)	Wall thickness (mm)	Fire performance	
			Classification	
PP Pipes	110	2.7	EI 120 U/ U*	
PP Pipes	160	4	EI 120 U/ U*	
PP Pipes	250	6.2	EI 120 U/ C*	

*U = Uncapped (pipe end open)
C = Capped (pipe end closed)

All pipes tested according to EN 1366-3 have been tested with a specific pipe end configuration. All pipes have been tested U/C unless otherwise stated in the tables.

The EN test standard EN 1366-3 states, "it is important to ensure that sealing systems have been tested with appropriate pipe end conditions."

The specification of pipe closure devices will be determined based on the scope of test data and whether the pipework is ventilated or not.

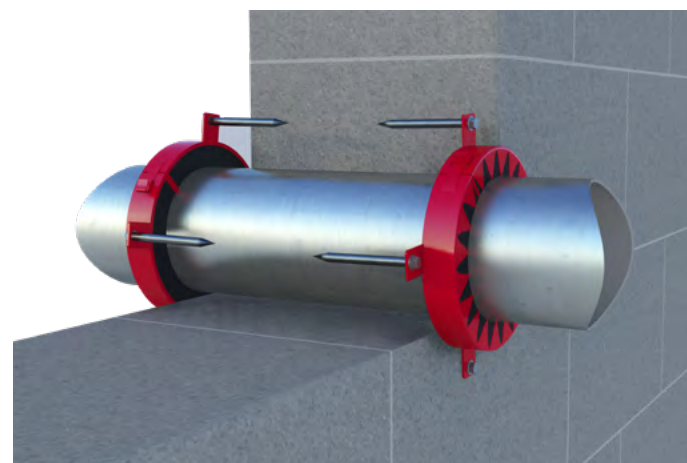


Pipe Collar CE wall application

Table 3: FIREPRO® Pipe Collar CE secured to both faces of Ablative Coated Batt Seal (2 x 50 or 2 x 60mm). Max. opening 1200mm High x 730mm Wide in min. 100mm thick wall

Penetration specification	Diameter (mm)	Wall thickness (mm)	Fire performance	
			Integrity (E)	Insulation (I)
PVC	32 - 160	1.8 - 9.5	120	120
PP	32 - 160	2.9 - 14.6	120	120
PE	32 - 160	2.9 - 10	120	120

FIREPRO® Pipe Collar CE secured to each face of Ablative Coated Batt Seal utilising 80mm long steel pig tail screws

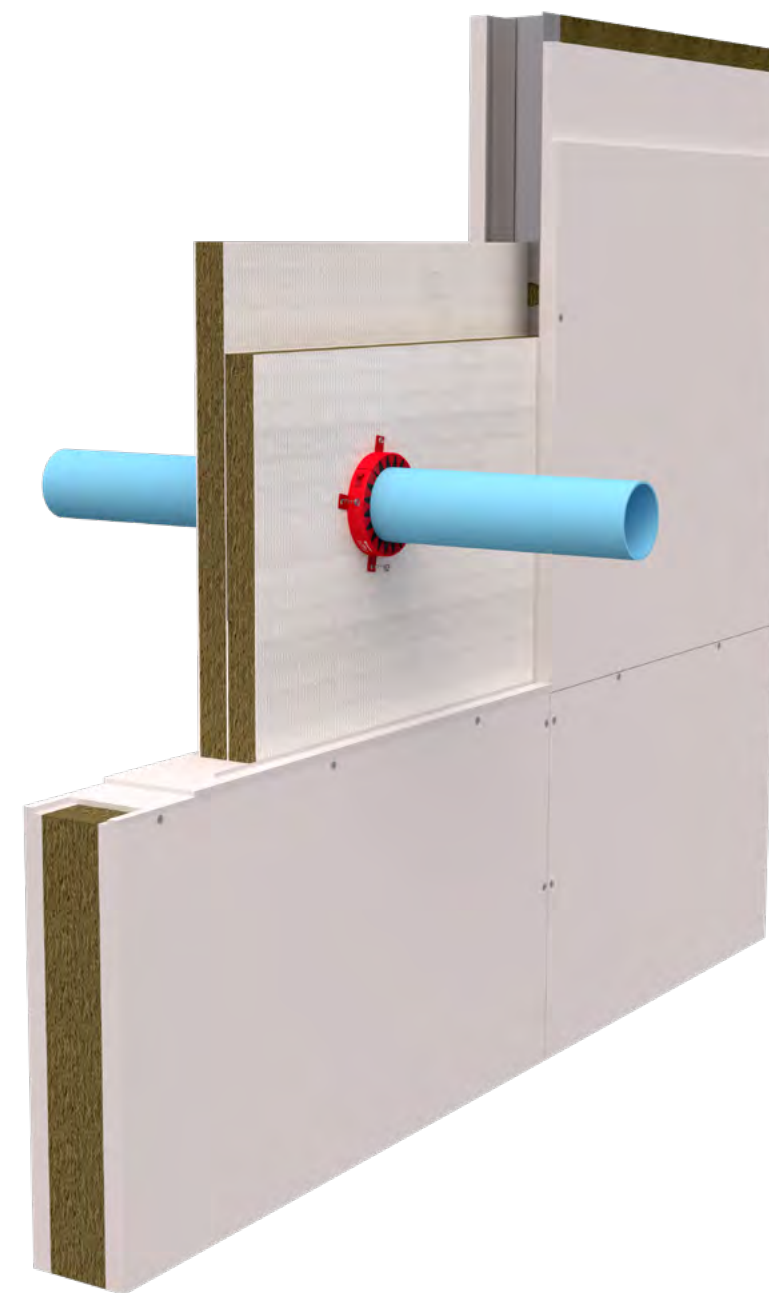



Technical information

Standards and approvals

- FIREPRO® Pipe Collar CE has been tested to BS EN 1366-3:2009
- FIREPRO® Pipe Collar CE has been third party accredited through Certifire

The independently prepared assessment, detailing the full scope of fire performance, is available from the ROCKWOOL Technical Solutions Team.

ROCKWOOL FIREPRO® Pipe Collar CE provides up to 4 hours fire resistance integrity and insulation for PVC-U, PP and PE pipes up to a maximum 14.6mm wall thickness, for standard diameters 32mm – 250mm.

The performance of FIREPRO® Pipe Collar CE will be determined by the performance of the substrate, so should 2 hours be the requirement of the collar then the substrate should be rated to no less than the collar.

For advice on types and sizes of pipes or particular applications, please contact the Technical Solutions Team on 01656 868490.

Product information

Property	Description	Test standard
Application temperature	-5°C to 40°C	
Application	Internal or external (Conditioned to Type X: -20°C - +70°C)	EOTA TR 024
Expansion rate	20:1	EOTA TR 024
Expansion pressure	1.30	EOTA TR 024
Plastic types	PP, PVC-U, PE	
Colour	Red	
Fire Resistance – Rigid Floors	Up to 4 hours	EN 1366-3:2009
Fire resistance – flexible & rigid walls	Up to 2 hours	EN 1366-3:2009
Fixing detail	3 No 60mm x 6mm expanding anchors – rigid floors 3 No size 70 wood screws - rigid walls 3 No 65mm spider fixings - flexible walls 3 No 35mm tap in fixings - rigid walls & floors 3 No. 80mm Steel Pigtail Screws - Ablative Coated Batt seals in walls.	
Expected shelf life	N/A	Store in dry conditions unopened

Installation

Installation of FIREPRO® Pipe Collar CE in walls

1. Walls shall be a minimum thickness of 100mm or greater.
2. Flexible drywalls/partitions shall comprise a minimum of 2 layers of 'Type F' Gypsum board on both faces, with minimum 50mm studs.
3. Solid block, masonry and concrete walls shall have a minimum density of 780kg/m³ and a minimum thickness of 100mm. Aerated concrete block shall have a minimum density of 600kg/m³.
4. Fire Stopping seals at maximum 1200mm high x 730mm wide consisting of a double layer of Ablative Coated Batt seal 2 x 50mm or 2 x 60mm.
5. All walls shall have at least the same fire resistance as that required of the sealing system.
6. Services penetrating the division shall be suitably supported via steel angles, hangers or channels, no further than 400mm from the surface of the sealing system on both faces.
7. Multiple apertures must be separated by a minimum of 200mm in drywalls and concrete/masonry constructions.
8. Check services to be treated are within scope of test data.
9. All services and apertures need to be thoroughly clean and clear of dust and loose particles.
10. Temperature to be 5°C or above at time of installation.
11. Gaps of up to 10mm wide around the service within the substrate can be filled with a minimum 5mm deep FIREPRO® Acoustic Intumescent Sealant.
12. In rigid walls, for gaps greater than 10mm wide, ROCKWOOL Firestop compound can be used.
13. Fixing straps on the FIREPRO® Pipe Collar CE are opened up and the collar is simply fitted around the plastic pipe with the fixing tabs closest to the face of the wall.
14. Lock the FIREPRO® Pipe Collar CE around the pipe by closing the fixing strap. The collar is pushed flush to the surface of the wall.
15. The collar is then securely fastened to the substrate by means of fire rated fixings to suit the substrate and installed through the fixing tabs. Steel pig tail screws minimum 80mm are utilised to secure the collar through to the Ablative Coated Batt.
16. Repeat for the other side of the wall if required.



Installation of FIREPRO® Pipe Collar CE in floors

1. Floors shall be a minimum thickness of 150mm or greater.
2. Concrete, aerated concrete or masonry floors shall have a minimum density of 650kg/m³.
3. All floors shall have at least the same fire resistance as that required of the sealing system.
4. Services penetrating the division shall be suitably supported via steel angles, hangers or channels, no further than 400mm from the upper surface of the floor.
5. Check services to be treated are within scope of test data.
6. All services and apertures need to be thoroughly clean and clear of dust and loose particles.
7. Temperature to be 5°C or above at time of installation.
8. Gaps of up to 10mm wide around the service within the substrate can be filled with a minimum 5mm deep FIREPRO® Acoustic Intumescent Sealant.
9. For gaps greater than 10mm wide, ROCKWOOL Firestop compound can be used.
10. Fixing straps on the FIREPRO® Pipe Collar CE are opened up and the collar is simply fitted around the plastic pipe with the fixing tabs closest to the soffit of the floor.
11. Lock the FIREPRO® Pipe Collar CE around the pipe by closing the fixing strap. The collar is pushed flush to the soffit of the floor.
12. The collar is then securely fastened to the substrate by means of fire rated fixings to suit the substrate and installed through the fixing tabs.

Specification clauses

FIREPRO® Pipe Collar CE is associated with the following NBS Clauses:

P12 Fire stopping systems

- 380 Pipe collar: Surface mounted intumescent





FIREPRO®

Intumescent Pipe Wraps CE



Description

Intumescent Pipe Wraps CE are designed to seal service penetrations in apertures containing combustible plastic pipes. Pipe Wraps CE comprise layers of a graphite based intumescent sheet encapsulated in a polythene sheath. All Pipe Wraps CE are supplied in correct lengths to suit the pipe diameter.

Intumescent Pipe Wraps CE are tested to plastic services penetrating flexible and rigid wall constructions, rigid floors and in Ablative Coated Batt seals.

Pipe Wraps CE are tested with end capping configurations that cover U/C pipes.

Advantages

- Simple to install with no mechanical fixings required
- Available to suit pipe diameters up to 250mm O.D.
- Up to EI120 fire resistance
- Tested in conjunction with Ablative Coated Batt seals
- Maintenance free
- Dry system
- Water resistant

Applications

- Fire stopping plastic pipe penetrations in rigid/flexible walls and rigid floors
- Can be applied to PVC, UPVC, Polypropylene, PE & HDPE pipe materials

Performance

Fire performance

ROCKWOOL Intumescent Pipe Wraps CE can provide up to 2 hours fire protection to plastic pipework where it passes through fire rated walls and floors.

Table 1: BS EN 1366-3:2009 - 150mm Rigid Floor

Pipe Wraps installed within both sides of rigid floor min. 150mm thickness (see Figure 1 below)

Service type	Wall thickness (mm)	Pipe diameter (mm)	Integrity	Insulation
PVC	1.8 - 9.6	32 - 200	60	60
	1.8 - 7.7	32 - 200	120	90
	1.8	32 - 50	120	120
PP	2.9 - 18.2	32 - 200	120	90
	2.9	32 - 50	120	120
HDPE	2.9 - 11	32 - 200	120	120

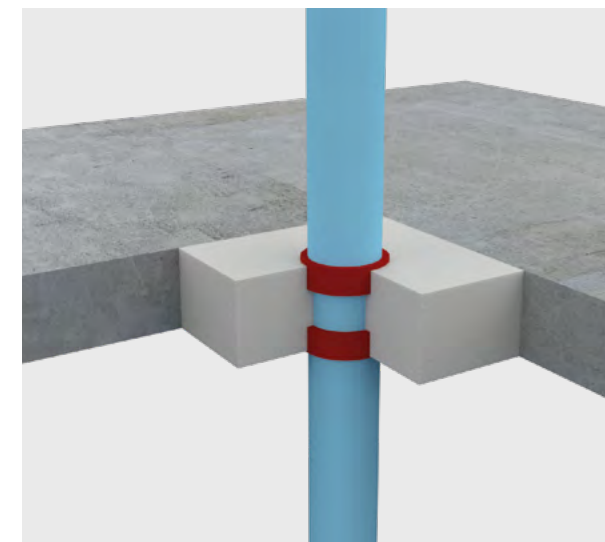


Figure 1
Pipe Wrap CE positioned within floor slab

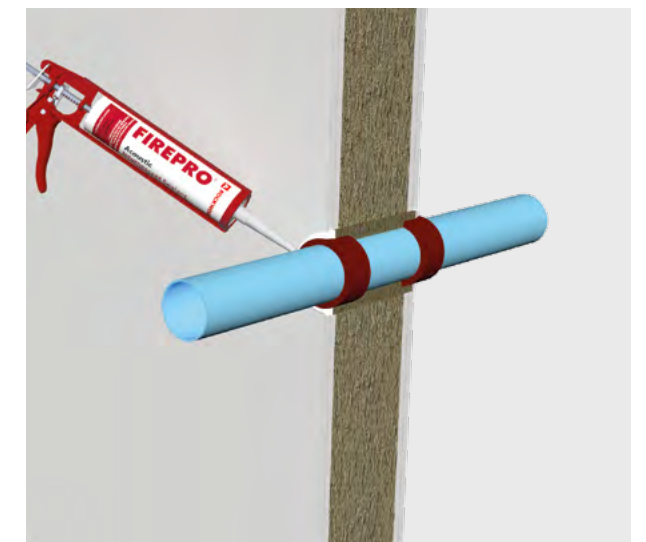


Figure 2
Pipe Wrap CE in position in wall

Table 2: BS EN 1366-3:2009 - 100mm Rigid or Flexible Wall

Fitted flush both sides of rigid or flexible wall min. 100mm thick (see Figure 2 above)

Service type	Wall thickness (mm)	Pipe diameter (mm)	Integrity	Insulation
PVC	1.8 - 9.6	32 - 200	120	120
PP	2.9 - 18.2	32 - 200	120	120
HDPE	2.9 - 18.4	32 - 200	120	120



Table 3: EN 1366-3 - Up to 90 minute flexible/rigid wall construction - void size max 600mm x 600mm

Pipe Wraps CE installed within Ablative Coated Batt seal (see Figure 3 below)

50mm & 60mm
ACB - single layer
patress both faces

Service type	Wall thickness (mm)	Pipe diameter (mm)	Integrity	Insulation
PVC	2.9 - 18.4	50 - 200	60	60
PP	1.8 - 9.6	50 - 200	60	60
PE	2.9 - 18.2	50 - 200	60	60

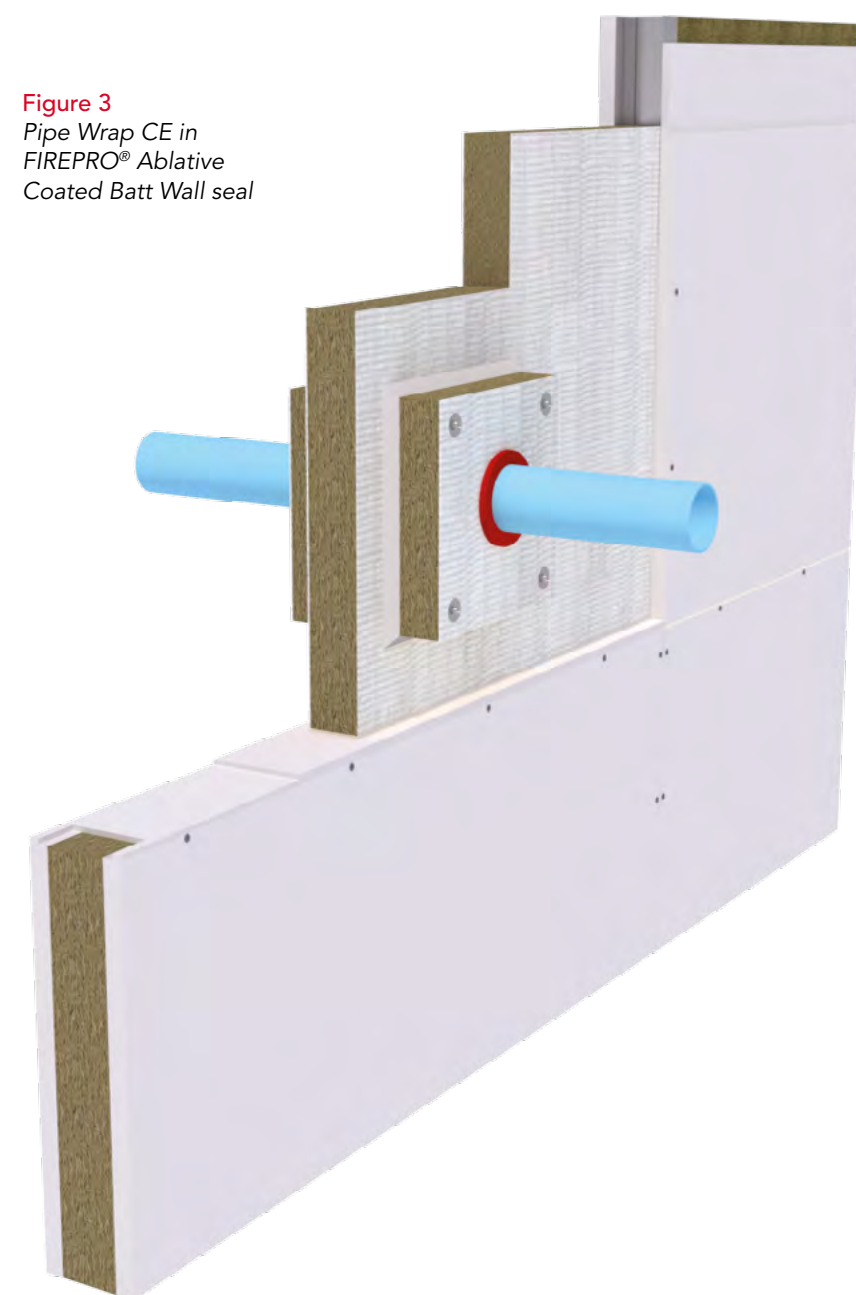


Figure 3
Pipe Wrap CE in
FIREPRO® Ablative
Coated Batt Wall seal

All pipes tested according to EN 1366-3 have been tested with a specific pipe end configuration. All pipes have been tested U/C and are suitable for C/C pipe end configurations..

The EN test standard EN 1366-3 states, "it is important to ensure that sealing systems have been tested with appropriate pipe end conditions."

The specification of pipe closure devices will be determined based on the scope of test data and whether the pipework is ventilated or not.

Installation

The product is intended to be wrapped around the outside diameter of the pipework and is secured by means of a self-adhesive strip.

Apertures or core holes in the separating element shall be maximum oversize with respect to the pipe diameter as follows:

- 32mm - 50mm OD = 4mm
- 160mm OD = 10mm
- 200mm OD = 12mm
- 250mm OD = 14mm

The Intumescent Pipe Wrap CE is then positioned each side within the compartment wall or floor so that the edge of the product is left exposed at the face of the wall or soffit. The remaining annular space/gap shall be infilled using FIREPRO® Acoustic Intumescent Sealant or for larger void sizes, the Intumescent Pipe Wrap CE can be sealed into the structure with ROCKWOOL Firestop Compound (see Figures 4 & 5 below).

Under fire conditions, the intumescent material expands against the structure and fills the void left by the burnt out plastic.

Where pipes are insulated, please refer to the Insulated Fire Sleeve data sheet.

Intumescent Pipe Wraps CE are used to prevent fire penetration in plastic pipes that pass through fire rated walls and floors for a specified period of up to 2 hours. They are manufactured as a sealed unit to the correct length and width to suit the pipe diameter and fire rating.

Walls should be a minimum of 100mm thickness and floors a minimum 150mm thickness. All walls should have the same or improved period of fire resistance as that required of the sealing system.

Services should be supported no further than 400mm from the surface of the separating element for walls and 400mm above the surface of the floor.

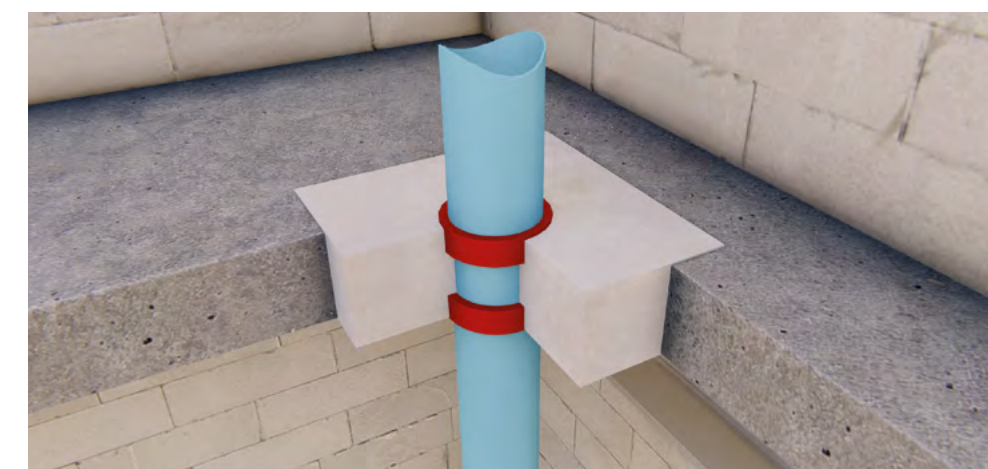


Figure 4
Intumescent Pipe
Wrap CE sealed into
compartment floor with
ROCKWOOL Firestop
Compound

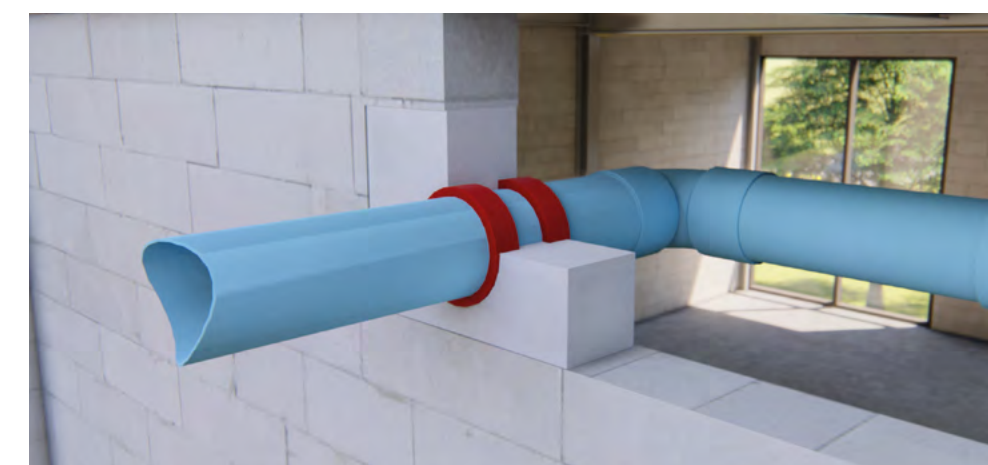


Figure 5
Intumescent Pipe
Wrap CE sealed into a
compartment wall with
ROCKWOOL Firestop
Compound



Installation instructions

1. Check that the pipe surface is clean and clear of debris, dust or loose particles.
2. Aperture temperature should be 5°C or greater at time of installation.
3. Ensure that the appropriate Pipe Wrap CE is installed to suit the outside pipe diameter and required fire rating.
4. An annular space will be required around the service to allow sufficient installation depth.
5. Wrap around pipe and fix with integral self-adhesive strip. Ensure that when installing the Pipe Wrap CE to the pipework, that it is installed 5mm proud of the substrate's surface.
6. For larger voids, the Pipe Wrap CE can be sealed into the structure with ROCKWOOL Firestop Compound.
7. Slide into position ensuring that both edges are exposed either side of walls and floors.
8. Annular gaps or spaces present after installation of the Pipe Wrap CE can be infilled using FIREPRO® Acoustic Intumescent Sealant.

Technical information

Standards and approvals

FIREPRO® Intumescent Pipe Wraps CE have been tested to BS EN 1366-3:2009.

FIREPRO® Intumescent Pipe Wraps CE are third party accredited through Certifire.

Product information


Property	Description
Pipe diameter	Up to 250mm O.D.
Width	40mm
Thickness	2mm at 32mm, up to 12mm at 250mm
Fire resistance	Up to 2 hours
Density	1.2g/cm ³
Expansion rate	20:1
Application temperature	-5 to 40°C
Shelf life	N/A if stored indoors in a cool, dry, well ventilated area

Specification clauses

ROCKWOOL Intumescent Pipe Wraps CE are associated with the following NBS clauses:

P12 Fire stopping systems

- 375 Pipe Collar – Insulated Wrap

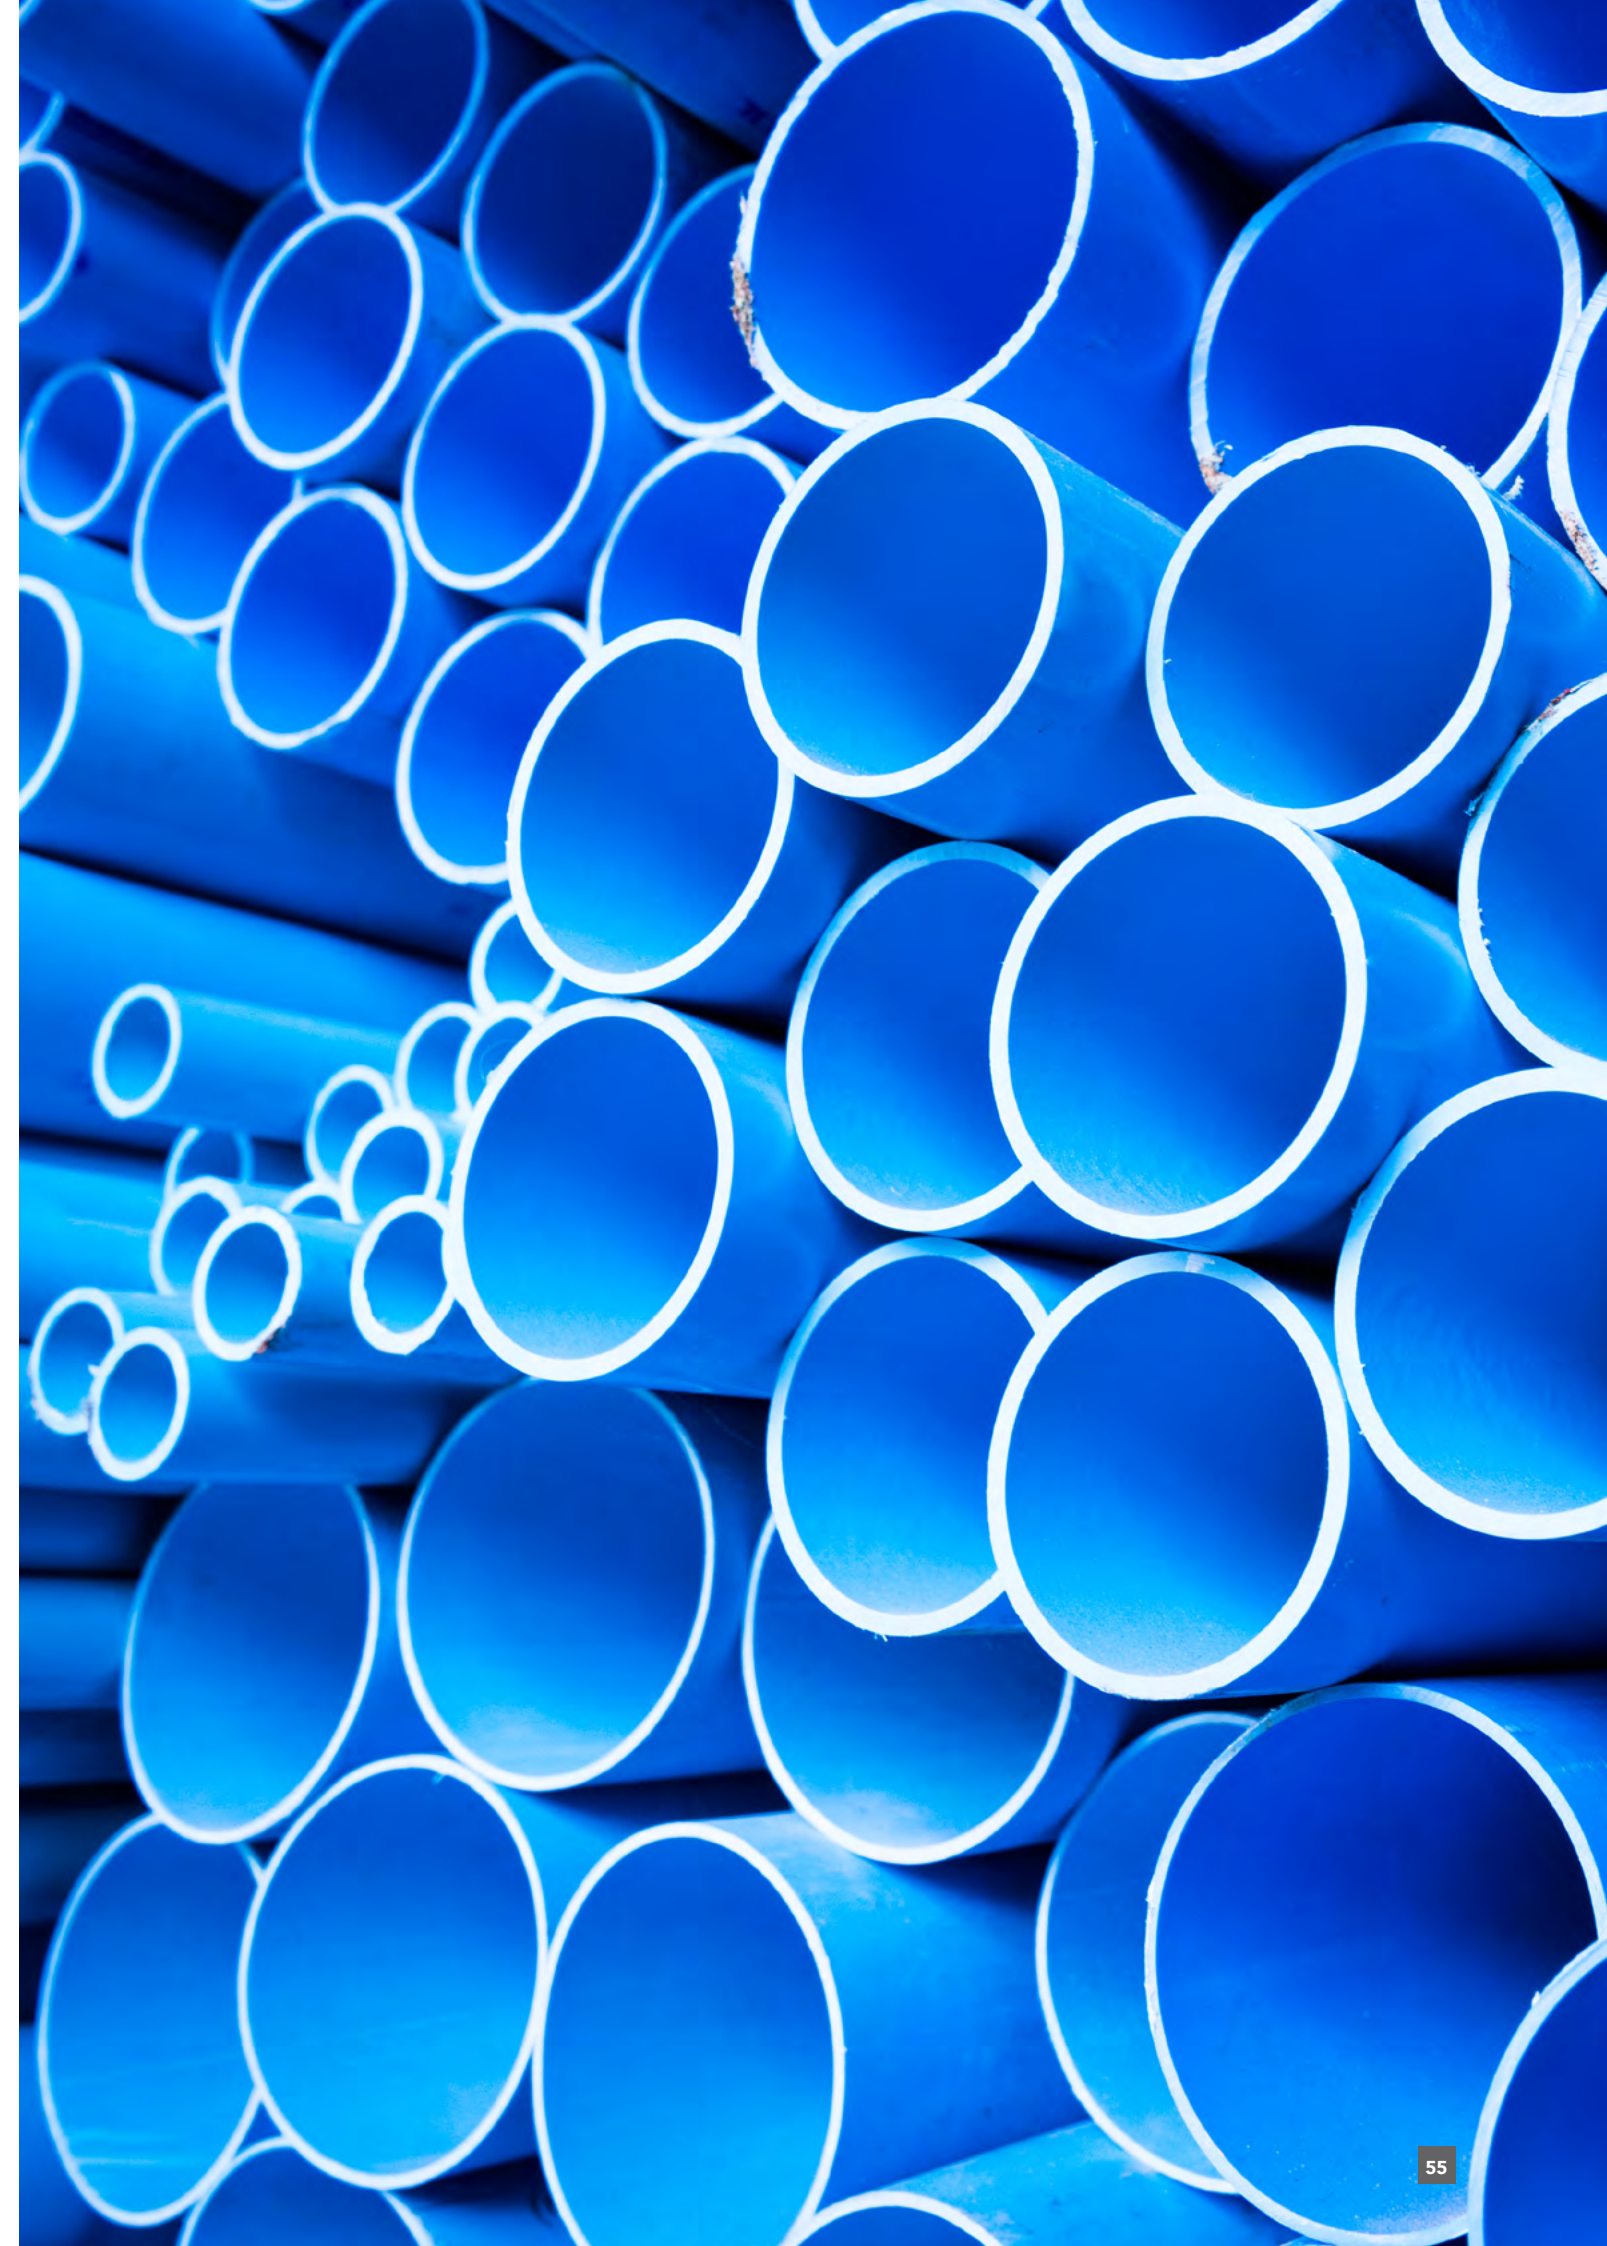



FIREPRO® Insulated Fire Sleeves



Description

Insulated Fire Sleeves are a unique combination of ROCKWOOL stone wool and graphite intumescent.

Supplied with a factory applied reinforced aluminium foil facing.

When thermally insulated plastic pipes pass through fire resisting walls and floors, the insulation is normally removed at the point of penetration to enable standard pipe collars and wraps to close the resulting void when the plastic softens and melts due to the effects of a fire. However, the removal of this insulation may result in the formation of condensation on cold pipework or heat loss from hot pipes.

Insulated Fire Sleeves avoid this problem by providing both fire stopping and thermal insulation in a single product.

Insulated Fire Sleeves are intended for use on copper, steel and most types of plastic pipes, trunking and conduits to provide up to 2 hours fire resistance.

Insulated Fire Sleeves can be used on numerous division types and under fire attack, expand both inwards to choke the plastic service penetration and also outwards to seal gaps between the sleeve and the surrounding construction.

Advantages

- Quick, simple and accurate installation
- Maintains pipe insulation at penetration points
- Supplied with integral vapour barrier
- No mastic or ancillaries required
- Excellent thermal and acoustic insulation

Applications

Insulated Fire Sleeves should be installed to the same thickness as the pipe insulation (min 25mm thick). For uninsulated pipes, a thickness of 25mm is required to maintain the fire resistance of the wall or floor.

Performance

Standards and approvals

Insulated Fire Sleeves have been independently tested and assessed to BS 476: Part 20 and/or EN 1366-3: 2009 for periods of up to 2 hours in concrete walls and floors, plasterboard partitions and ROCKWOOL Ablative Coated Batts.

Fire

Service Temperature and Limiting Service Temperature - Insulated Fire Sleeves are used to fire stop pipework operating at temperatures between 0°C and 180°C. At low temperatures, care should be taken to maintain the vapour barrier.

Table 1: Fire resistance (FR) performance - ducting, trunking and conduits

Service type	Material	Max size W/D (mm)	Wall thickness range (mm)	Supporting construction		FR integrity (minutes)	FR insulation (minutes)		Report
				Wall	Floor		Wall	Floor	
Rectangular vent ducts	PVC	Other sizes available - see ROCKWOOL Oval Insulated Firesleeve Data Sheet	1.6 to 3	M/PB	Concrete	120	90	120	1
Square trunking	PVC		3	M/PB	Concrete	120	90	120	1
Cable conduit	PVC	Up to 55 diameter	3	M/PB	Concrete	120	90	120	1

Table 2: Fire resistance (FR) performance - metal and plastic pipes in masonry, plasterboard or concrete supporting construction

Service type	Material	Min diameter	Wall thickness (mm)	Max diameter	Wall thickness (mm)	Supporting construction		FR integrity (minutes)	FR insulation (minutes)		Report
						Wall	Floor		Wall	Floor	
Metal pipes (uninsulated)	Copper	22	2.5	165	14.2	M/PB	Concrete	120	0	0	1
	Mild steel										
	Stainless steel										
Pipes (plastic)	PVC/UPVC	55	3.0	160	4.2	M/PB/CB	Concrete	120	120	120	1
	PVC/UPVC	160	3.0	110	4.2	M/PB	Concrete	120	90	90	
	Polybutylene	12	2.0	28	3.5	M/PB/CB	Concrete	120	120	120	

A minimum thickness of 25mm is required for uninsulated pipes.
25 to 100mm available to match insulation on other pipes.

Manufactured to fit pipe diameters of 15 to 169mm

1 = Chilt/A12265
2 = Chilt/A08152 Rev D
M = Masonry
PB = Plasterboard
CB = Ablative Coated Batt



Table 3: Fire resistance (FR) performance of plastic pipes in FIREPRO® Ablative Coated Batt

Service type	Material	Pipe outer diameter (mm)	Wall thickness (mm)	FR integrity (minutes)		FR insulation (minutes)	
				50mm Coated Batt	2 x 50mm Coated Batt	50mm Coated Batt	2 x 50mm Coated Batt
Pipes (plastic)	Polybutylene	15-28	2.5	60	120	60	120
	HDPE	40	3	60	120	60	120
	PVCu	43	1.8	60	120	60	120
	PVC	55	2	60	120	60	120
	HDPE	56	2.3	60	120	60	120
	ABS	57	4	60	120	60	120
	PVC, PVCu	82	3.2-4.0	60	120	60	120
	HDPE	90	3.5	60	120	60	120
	PVC, PVCu	110	4.3	60	120	60	120
	HDPE	110	5	60	120	60	120
	ABS	110	5	60	120	60	120
	PVC, PVCu	160	3.2-4.5	60	120	60	120
	HDPE	160	6.2	60	120	60	120
	ABS	160	6.7	60	120	60	120

For information regarding alternative pipe sizes or types, or for help regarding achieving higher integrity and insulation ratings. Please contact ROCKWOOL Technical Solutions Team for further assistance.

Acoustics

The use of Insulated Fire Sleeves can considerably reduce the noise emission from noisy pipework. ROCKWOOL Insulated Fire Sleeves have been tested to provide up to Rw 49 dB.

For higher standards of acoustic insulation, it is recommended that an increased length of the pipework either side of the compartment wall or floor is insulated with ROCKWOOL Techwrap 2 or Techtube.

Product information

Dimensions

Insulated Fire Sleeves are supplied 300mm long. They are manufactured to fit a range of standard pipe sizes, from 17mm to 169mm O.D. and in a standard thickness of 25mm. Other pipe sizes and thicknesses may be available to special order.

Installation

Installation instructions


Insulated Fire Sleeves are supplied 300mm long and are simply cut to the desired length and as a minimum, be cut flush with both faces of the wall/floor. When used in conjunction with PVC services or ROCKWOOL Ablative Coated Batts, they are required to extend beyond the face of the wall/floor. For details of how far they need to extend please refer to specification clause 2.

Maintenance

To maintain thermal efficiency, the Insulated Fire Sleeves should tightly abut any existing pipe insulation and where this is foil faced, all joints must be sealed with self-adhesive class O foil tape.

Other install info e.g. ancillaries

No specialist tools or ancillary materials are required for the fitting of Insulated Fire Sleeves. Insulated Fire Sleeves can accommodate irregularities in the division opening and the pipe O.D. of up to 15mm. Multiple pipe penetrations can be accommodated in conjunction with Ablative Coated Batts. A minimum thickness of 25mm is required for uninsulated pipes. Thicknesses of 25 to 100mm available to match insulation already installed on pipework. Manufactured to fit pipe diameters of 15 to 169mm.

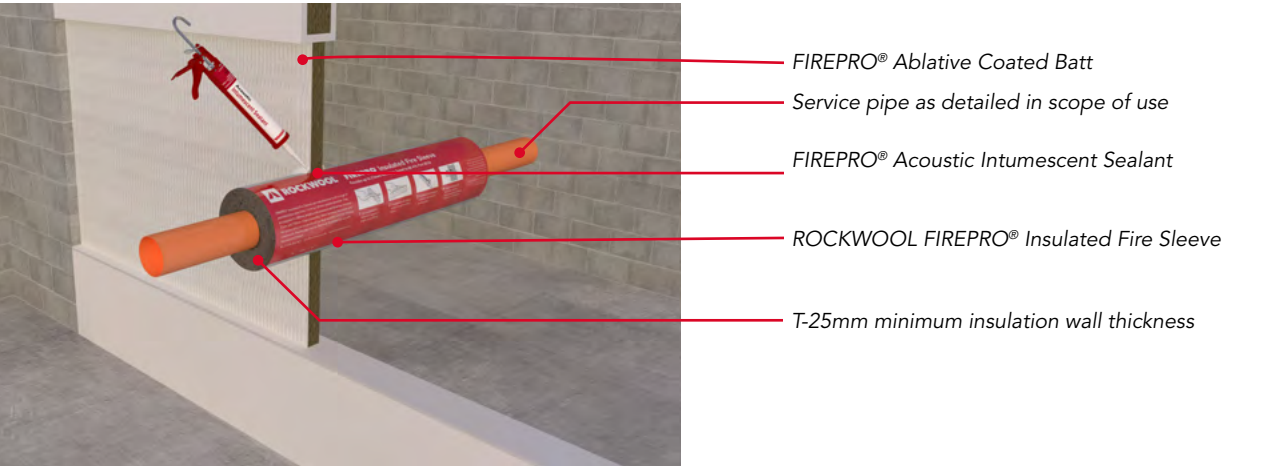

Specification clauses

- Supporting construction designation:- Floors: Cast concrete between 1100 and 2400kg/m³ density.
M=Masonry between 600 and 1500kg/m³ density.
PB= Plasterboard clad steel or timber stud partitions with fire resistance at least the same as the Fire Sleeve performance.
CB= ROCKWOOL 50 or 60mm thick Ablative Coated Batt.
- Insulated Fire Sleeves should project by at least 25mm beyond the visible face of each Coated Batt. There must be at least 50mm width of Coated Batt between any fire sleeve and the edge of the aperture and also between individual Fire Sleeves.
- If gaps exceed 15mm around the aperture and the sleeve, the gap should be filled with ROCKWOOL Acoustic Intumescent or FIREPRO® Firestop Compound. If gaps exceed 8mm between the service and the sleeve, these can be infilled, locally where the service penetrates the aperture, with the Acoustic Intumescent Sealant.
- The installed length of any Insulated Fire Sleeve shall be at least 60mm.

NBS clauses


FIREPRO® Insulated Fire Sleeves are associated with the following NBS clauses:

P12 Fire stopping systems

- 375 Pipe Collar – Insulated Wrap



Intumescent Pipewrap Roll

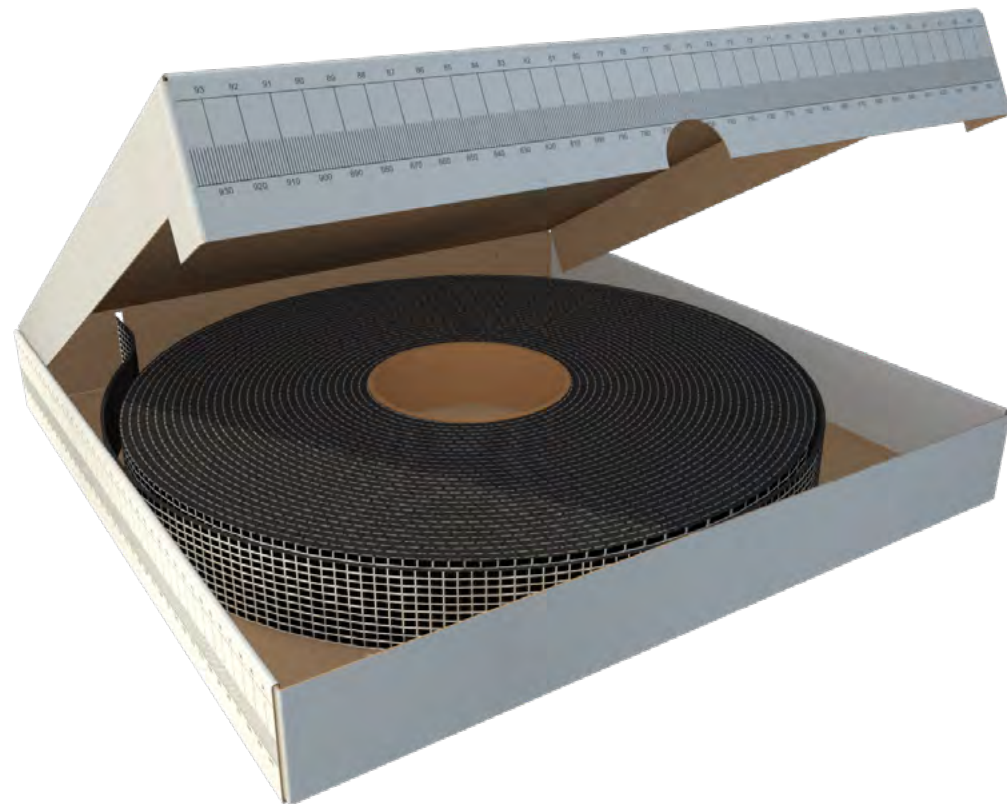

Description

Intumescent Pipewrap Roll comprises an intumescent material made from elastomeric thermoplastic polymers combined with active components that provide a high volume expansion and pressure seal in the event of a fire.

Intumescent Pipewrap Roll is supplied on 25m roll. The product is 40mm wide and 2mm thick, with integral adhesive tape for securing around the pipe. Depending on the service to be protected and the fire resistance required, multiple layers of wrap may be required, the exact number and positioning of the product is detailed in the performance section of this data sheet.

Advantages

- Simple to install
- No mechanical fixings required
- Water resistant
- Maintenance free
- Supplied as a 25m long roll in box dispenser
- Available to suit pipes up to 200mm o.d.
- Comprehensively tested
- Available from stock

Applications

Install Intumescent Pipewrap Roll to provide up to 4 hours fire protection to tested plastic pipework and insulated pipes where they pass through fire rated walls and floors. Installation to be fully in accordance with manufacturer's instructions.

Installation

The product is intended to be wrapped around the outside diameter of combustible pipework or the outside diameter of insulation on pipework and is secured by means of the integral self-adhesive strip.

1. Check that pipe surface and substrate are clean and clear of any debris.
2. Install the correct number of wraps for the service type and ensure the correct number of layers of wrap as detailed in the performance section of this data sheet.
3. Install the wrap into the wall or floor recessed by 5mm from the face of the wall or floor.
4. Fill the annular space with ROCKWOOL® FIREPRO® Acoustic Intumescent Sealant to seal off the 5mm gap to the edge of the substrate.
5. Maintain a record of the installation.

Under fire conditions, the intumescent material expands against the structure and fills the void left by the burnt out plastic and/or insulation.

Maintenance

During normal use, no maintenance is required.

Technical information

Table 1: Pipes through suitable flexible walls

Service type	Classification				Substrate	Wrap dimensions			Supports	Capping	Classification
	Diameter (ø) (mm)	Pipe wall thickness (mm)	Insulation type and thickness (mm)	Insulation fitting		Annular space (mm)	Depth (mm)	No. of layers			
pVC	≤200	≤9.6	N/A	N/A	100min flexible wall	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI120
PP	≤200	≤18.2	N/A	N/A	100min flexible wall	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	E120,EI90
PE	≤200	≤18.4	N/A	N/A	100min flexible wall	thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI90
PE	50	≤4.6	N/A	N/A	100min flexible wall	thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI120
PE	200	18.4	N/A	N/A	100min flexible wall	thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI120

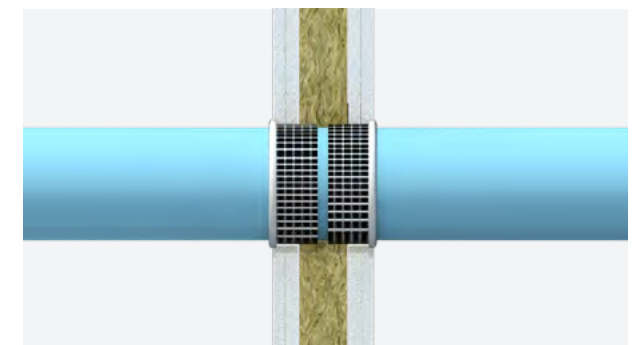




Table 2: Pipes in concrete floors

Classification					Substrate	Wrap dimensions			Supports	Capping	Classification
Service type	Diameter (ø) (mm)	Pipe wall thickness (mm)	Insulation type and thickness (mm)	Insulation fitting		Annular space (mm)	Depth (mm)	No. of layers			
pVC	≤200	≤9.6	N/A	N/A	150mm rigid floor	Thickness of wrap	40 ↑	See table 5 in data sheet	400mm & 500mm	U/C	EI60
PP	50	2.9	N/A	N/A	150mm rigid floor	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI120
PP	200	18.2	N/A	N/A	150mm rigid floor	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	E120, EI90
PE	≤200	≤11.4	N/A	N/A	150mm rigid floor	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI120
PVC	≤200	≤9.6	N/A	N/A	150mm rigid floor	Thickness of wrap	40 ↑	See table 5 in data sheet	400mm & 500mm	U/C	EI60
PVC	200	9.6	N/A	N/A	150mm rigid floor	Thickness of wrap	40 ↑	See table 5 in data sheet	400mm & 500mm	U/C	E240, EI180
PVC	50	3.7	N/A	N/A	150mm rigid floor	Thickness of wrap	40 ↑	See table 5 in data sheet	400mm & 500mm	U/C	E240, EI180
PVC	50	2.4	N/A	N/A	150mm rigid floor	Thickness of wrap	40 ↑	See table 5 in data sheet	400mm & 500mm	U/C	EI240
PP	≤200	≤18.2	N/A	N/A	150mm rigid floor	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI120
PP	≤50	≤6.9	N/A	N/A	150mm rigid floor	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI240
PP	200	4.9	N/A	N/A	150mm rigid floor	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI240
PE	≤200	≤18.2	N/A	N/A	150mm rigid floor	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI240

Table 3: Pipes in suitable flexible wall using pattress installation of 50mm FIREPRO® ACB

Classification					Substrate	Wrap dimensions			Supports	Capping	Classification
Service type	Diameter (ø) (mm)	Pipe wall thickness (mm)	Insulation type and thickness (mm)	Insulation fitting		Annular space (mm)	Depth (mm)	No. of layers			
Copper / steel	≤159	≤14.2	Elastomeric 13-25	CS	100min flexible wall	Thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	E120, EI60
Copper / steel	≤108	≤14.2	Phenolic 25-40	CS	100min flexible wall	Thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI90
Copper / steel	42	1	Phenolic 25-40	CS	100min flexible wall	Thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI120
Copper / steel	≤108	≤14.2	Phenolic 40	CS	100min flexible wall	Thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI120
Copper / steel	42	1	Elastomeric 13-25	CS	90min flexible wall	thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI120
Copper / steel	≤159	≤14.2	Elastomeric 25	CS	100min flexible wall	Thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI90
PVC	≤200	≤9.6	N/A	N/A	100min flexible wall	thickness of wrap	40 Φ	See table 5 in Data Sheet	400mm & 500mm	U/C	EI60
PP	≤200	≤18.2	N/A	N/A	100min flexible wall	thickness of wrap	40 Φ	See table 5 in Data Sheet	400mm & 500mm	U/C	EI60
PE	≤200	≤18.4	N/A	N/A	100min flexible wall	thickness of wrap	40 Φ	See table 5 in Data Sheet	400mm & 500mm	U/C	EI60
Copper / steel	42	1	Mineral wool 20-50	CS	100min flexible wall	thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI120
Copper / steel	≤159	≤14.2	Mineral wool 20-50	CS	100min flexible wall	thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI90
Copper / steel	≤108	≤14.2	Mineral wool 20-50	CS	100min flexible wall	thickness of wrap	40 Φ	2 layers of 2mm	400mm & 500mm	U/C	EI90

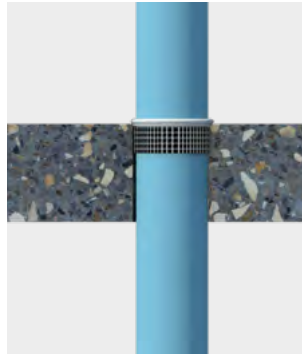
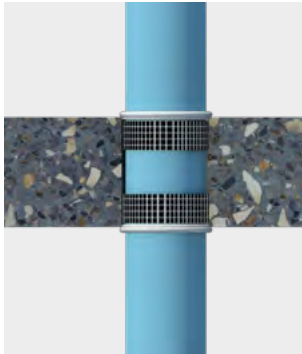




Table 4: Pipes in suitable flexible walls in double layer 50mm FIREPRO® ACB

Classification					Substrate	Wrap dimensions			Supports	Capping	Classification
Service type	Diameter (ø) (mm)	Pipe wall thickness (mm)	Insulation type and thickness (mm)	Insulation fitting	Wall /floor type	Annular space (mm)	Depth (mm)	No. of layers			
Copper / steel	≤159	≤14.2	Elastomeric 13-25	CS	100min flexible wall	thickness of wrap	40 Φ	2 Layers of 2mm	400mm & 500mm	U/C	EI60
Copper / steel	≤108	≤14.2	Phenolic 25-40	CS	100min flexible wall	thickness of wrap	40 Φ	2 Layers of 2mm	400mm & 500mm	U/C	E120, EI60
Copper / steel	42	1	Elastomeric 13-25	CS	100min flexible wall	thickness of wrap	40 Φ	2 Layers of 2mm	400mm & 500mm	U/C	E120,EI90
Copper / steel	42	1	Phenolic 25-40	CS	100min flexible wall	thickness of wrap	40 Φ	2 Layers of 2mm	400mm & 500mm	U/C	E120,EI90
PVC	≤110	≤6.6	Phenolic 20-25	CS	100min flexible wall	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI90
PVC	≤110	≤6.6	Elastomeric 13-25	CS	100min flexible wall	Thickness of wrap	40 Φ	See table 5 in data sheet	400mm & 500mm	U/C	EI90
Copper / steel	≤159	≤14.2	Mineral wool 20-50	CS	100min flexible wall	Thickness of wrap	40 Φ	2 Layers of 2mm	400mm & 500mm	U/C	EI60

Key

ACB = Ablative Coated Batt

CS = Continuous Sustained

Φ = applied to both faces of seal

↑ = applied to upper face only


U/C = Upcapped / Capped

Table 5: Wrap configuration by size

Pipe O.D. (mm)	No. of layers of wrap	Total wrap thickness (mm)
40	1	2
55	2	4
63	2	4
75	2	4
82	2	4
90	3	6
110	3	6
125	4	8
160	4	8
200	5	10

Table 6 : Physical properties

Property	Description
Width	40mm
Length	25m
Thickness	2mm
Density	1.3kg/m³
Volume expansion at 300°C	25 times
Shelf life	60 months

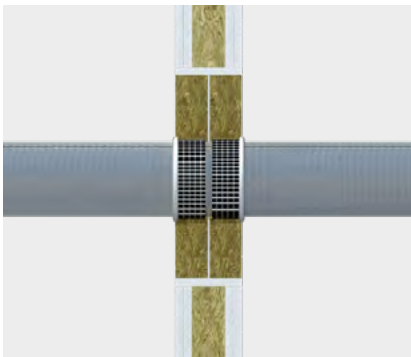



FIREPRO® High Expansion Intumescent Sealant



Description

ROCKWOOL FIREPRO® High Expansion Intumescent Sealant is water based acrylic sealant containing graphite. In the event of a fire, the active components provide a high volume expansion and pressure seal, closing off the void left by combustible materials.

ROCKWOOL FIREPRO® High Expansion Intumescent Sealant is supplied in 310ml cartridges.

Advantages

- Simple solution for sealing combustible pipes and metal pipes with combustible insulation
- Suitable for both walls and floors
- Compatible with cPVC pipes
- Tested in multiple substrates

Applications

FIREPRO® High expansion Intumescent Sealant is comprehensively tested for a wide range of applications which include:

- Combustible pipes
- Metal pipes insulated with combustible insulation
- Other permanent services

Performance

Standards and approvals

FIREPRO® High Expansion Intumescent Sealant has been tested to BS EN 1366-3: 2009 and BS EN 1366-4: 2006 +A1:2010 and classified to EN 13501-2, providing up to 4 hours fire protection in joints up to 30mm.

FIREPRO® High Expansion Intumescent Sealant has been CE marked against ETAG026-2.

"FBC™ System Compatible indicates that this product has been tested, and is monitored on an ongoing basis, to assure its chemical compatibility with FlowGuard Gold®, BlazeMaster® and Corzan® pipe and fittings. FBC™, FlowGuard Gold®, BlazeMaster® and Corzan® are licensed trademarks of The Lubrizol Corporation or its affiliates."

FIREPRO® High Expansion Intumescent Sealant is third party accredited through IFC and Certifire.

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details. LUL Ref. 2454.

Table 1: 2 hour dry wall (min. 120mm thick)

Service penetration	Diameter (Ø)	Wall thickness	Annular space (mm)	Depth (mm)	Classification
Cables	21	N/A	20	25Φ	EI 120 U/C
PVC pipes ‡	40	3	10	25Φ	EI 120 U/C
PVC pipes ¶‡	125	7.4	16	25Φ	EI 120 U/C
HDPE	63	7.2	20	25Φ	EI 120 U/C
HDPE	90	9.2	12.5	25Φ	EI 120 U/C
ABS	90	6	12.5	25Φ	EI 120 U/C
Copper / steel pipe with Armaflex 32mm CS	60	0.8-14.2	20	25Φ	E 120/EI 90 U/C
Copper / steel pipes with Armaflex 16mm CS	15	0.8-7	15	25Φ	EI 120 U/C

Table 2: Wall with single 50mm FIREPRO® Ablative Coated Batt

Service penetration	Diameter (Ø)	Wall thickness	Annular space (mm)	Depth (mm)	Classification
PVC pipes ‡	125	7.4	20	50	EI 30 U/C
Multi layer composite pipes	110	10	20	50	E45 EI30 U/C
500mm perforated cable tray*	N/A	N/A	20	50	EI 30
Medium cables*	47	N/A	20	50	EI 45

Table 3: Masonry wall (min. 150mm) or flexible wall (min. 100m) with double 50mm FIREPRO® Ablative Coated Batt

Service penetration	Diameter (Ø)	Wall thickness	Annular space (mm)	Depth (mm)	Classification
PVC pipes ‡	125	7.4	20	25Φ	EI 120 U/C
Multi layer composite pipes	110	10	20	25Φ	EI 120 U/C
500mm perforated cable tray*	N/A	N/A	20	25Φ	EI 120
Medium cables*	47	N/A	20	25Φ	EI 120



Table 4: Rigid floor (min. 150mm thick)

Service penetration	Diameter (Ø)	Wall thickness	Annular space (mm)	Depth (mm)	Classification
Electrical cables Φ	80	N/A	N/A	25 ↑	E120
Non sheathed electrical cables Φ	24	N/A	N/A	25 ↑	E180
Telecom cables bundled Φ	up to 21	N/A	N/A	25 ↑	E180
Copper / steel pipe with Armaflex 32mm cs Φ	159	14.2	20	25	EI 120 U/C
Copper / steel pipe with Armaflex 16mm cs Φ	41	14.2	20	25	E240/ EI 60 U/C
PP pipes Φ‡	110	10.7	20	25Φ	EI 120 U/C
PP pipes Φ‡	50	2.1	20	25Φ	EI 240 U/C
PE pipe Φ‡	40	4.1	20	25Φ	EI 240 U/C
PE pipe Φ‡	125	11.4	20	25Φ	EI 90 U/C
PVC pipe Φ‡	40	2	20	25Φ	EI 240 U/C
PVC pipe Φ‡	114	8.1	20	25Φ	EI 120 U/C

Table 5: Rigid floor (min. 150mm thick) with double 50mm FIREPRO® Ablative Coated Batt

Service penetration	Diameter (Ø)	Wall thickness	Annular space (mm)	Depth (mm)	Classification
PVC pipe ‡	50	7.4	20	25Φ	EI 120 U/C
PVC pipe ‡	125	7.4	20	25Φ	EI 120 U/C
Multi layer composite pipes	110	10	20	25Φ	E120/EI 60 U/C
500mm perforated cable tray*	N/A	N/A	20	25Φ	EI 120
Medium cables*	47	N/A	20	25Φ	EI 120
Multi service as follows (installed centrally in aperture)					
PE pipe Φ‡	125	7.6	N/A	25Φ	E120/EI 90 U/C
60 pipe with cables Φ	21	N/A	N/A	25Φ	E120/EI 90 U/C

Table 6: Linear joints

Service penetration	Diameter (Ø)	Wall thickness	Annular space (mm)	Depth (mm)	Classification
PVC pipe ω	50	7.4	20	25Φ	EI 120 U/C

Key

‡ = See assessment for other pipe sizes and wall thicknesses within field of application.

*C= All cables coated with 2mm DFT (Dry Film Thickness) of FIREPRO®

RW = Rigid Wall

ACB = Ablative Coated Batt

CS = Continuous Sustained

Φ = Applied to both faces of seal

↑ = Applied to upper face only

ψ = Use RW4 as backing material, minimum 30mm deep.

Φ = Use RWA45 as backing material, minimum 100mm deep.

ω = Use PE backing rod

Technical information

Product information

Property	Description
Form	Ready to use thixotropic paste
Cartridge size	310ml
Curing system	Water based
Specific gravity	1.5
Extrusion rate	350g/min
SAG	<3min
Open time	30mins
Tack free time	60mins
Curing time	3 to 5 days
Shore (A) hardness	50
Solids	>80%
Application temperature range	+4°C to +35°C
Service temperature range	-15°C to 70°C
Shelf life	Up to 12 months when stored in unopened cartridges under cool, dry conditions. Avoid Extreme Temperatures

Installation

All surfaces must be clean and sound, free from dirt, grease and other contamination.

Prepare joint by cleaning as previously detailed and insert backer if required. Cut nozzle to the desired angle and gun firmly into the joint to give a good solid fill to the required depth. Strike off the sealant flush with the joint sides within five minutes of application, before surface skinning occurs. A small amount of shrinkage will occur on curing. If a flush finish is required, fill the joint slightly proud of the surface to allow for shrinkage.



Specification clauses

FIREPRO® High Expansion Intumescent Sealant is associated with the following NBS clauses:

E40 Designed joints in in-situ concrete

- 530 Sealant

F30 Accessories / sundry items for brick / block stone walling

- 610 Movement joints with sealant

L10 Windows / rooflights / screens / louvres

- 790 Fire resisting frames

L20 Doors / shutters / hatches

- 820 Sealant joints

P12 Fire stopping systems

- 395 Sealant: One part fire resisting acrylic

Important information

The sealant is not intended for application on bituminous substrates or substrates that can exude certain oils and plasticizers or solvents.

A high expansion intumescent sealant is different to standard intumescent sealants, it is tested and installed within a defined annular space between the service and the substrate. Please refer to the ROCKWOOL Standard Details for a complete list of tested systems.

The sealant is not recommended for submerged joints or areas exposed to high abrasion.

The sealant is not suitable for food contact or medical applications.



FIREPRO® SpeedSeal



Description

There are many instances in buildings where single or small bunched cables and conduits will need to be positioned through compartment walls. It is important that even the smallest penetrating service is effectively fire stopped to reinstate the fire performance of the wall.

FIREPRO® SpeedSeal is a red putty-based penetration sealing solution available in 60mm and 100mm diameter discs. It has been tested in service openings 25mm x 25mm and 50mm x 50mm to seal penetrating services such as small metallic pipes, plastic pipes, cables and cable bunches.

Advantages

- Quick and Easy to install
- Up to E120/EI60* fire resistance
- 2 size options to suit the majority of small openings
- Ideal for refurbishment or new build

*E = Integrity
*EI = Integrity/Insulation

Applications

Tested to reinstate the fire performance of rigid and flexible walls (minimum 100mm) where small cables and conduits penetrate.

Fire resistance testing to EN 1366-3 and proven to perform for up to EI 60.

Used to seal penetrations through service openings 25mm x 25mm and 50mm x 50mm.

Tested in conjunction with small/medium metallic pipes, plastic pipes, small/medium cables and cable bunches.

Can be used as a blank seal.

Performance

Fire performance

FIREPRO® SpeedSeal is specifically designed to be used around small cables, cable bunches, plastic and metallic conduits in flexible and rigid walls a minimum 100mm thickness. SpeedSeal has been proven by test to provide up to 120 minutes fire resistance (E120) around services.

60mm Diameter SpeedSeal						
Application	Service size (mm)	Service description	Aperture size (mm)	Wall type	Integrity	Insulation
Blank Seal	N/A	N/A	25 x 25	Flexible / Rigid	120	60
Cable Penetration	14	Sheathed PVC	25 x 25	Flexible / Rigid	60	45
	15	Sheathed XPR/PO			60	30
	14	Sheathed XLPE/EVA			120	60
	0-21	Electrical Cables			60	30
Medium Cables	≤ 21	Medium Sheathed PVC	25 x 25	Flexible / Rigid	120	45
	≤ 27	Medium Sheathed PVC			120	30
Conduits						
Copper	≤ 16	≥ 1.2mm wall	25 x 25	Flexible / Rigid	120	20
Steel	≤ 16	≥ 1.2mm wall	25 x 25	Flexible / Rigid	120	20
Plastic	≤ 16	PVC ≥1.0mm wall	25 x 25	Flexible / Rigid	60	60

100mm Diameter SpeedSeal						
Application	Service size (mm)	Service description	Aperture size (mm)	Wall type	Integrity	Insulation
Blank Seal	N/A	N/A	50 x 50	Flexible / Rigid	60	60
Cable Penetration	3 x 14	Sheathed PVC	50 x 50	Flexible / Rigid	60	45
	3 x 15	Sheathed XPR/PO			60	60
	3 x 14	Sheathed XLPE/EVA			60	45
	0-21	Electrical Cables			60	45
Medium Cables	≤ 21	Medium Sheathed PVC	50 x 50	Flexible / Rigid	60	45
	≤ 27	Medium Sheathed PVC			45	45
Conduits						
Copper	≤ 16	≥ 1.2mm wall	50 x 50	Flexible / Rigid	60	15
Steel	≤ 16	≥ 1.2mm wall	50 x 50	Flexible / Rigid	60	15
Plastic	≤ 16	PVC ≥1.0mm wall	50 x 50	Flexible / Rigid	60	30

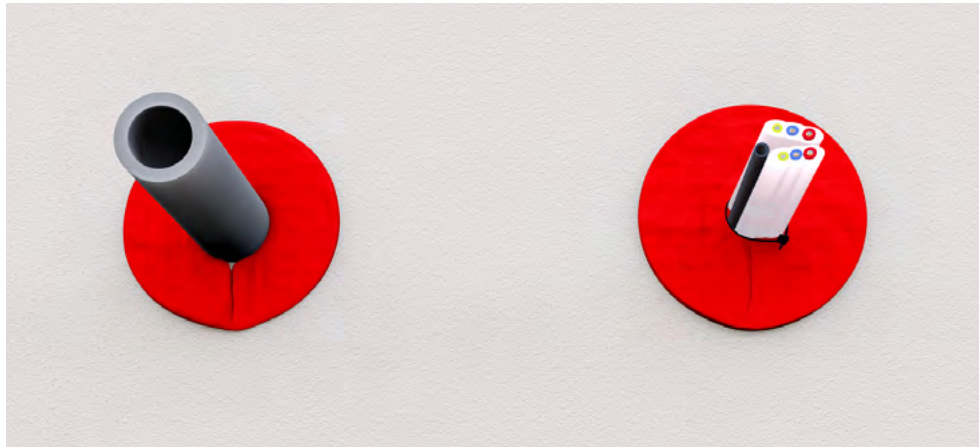


Figure 1:
SpeedSeal for sealing
around conduits and
electrical cables

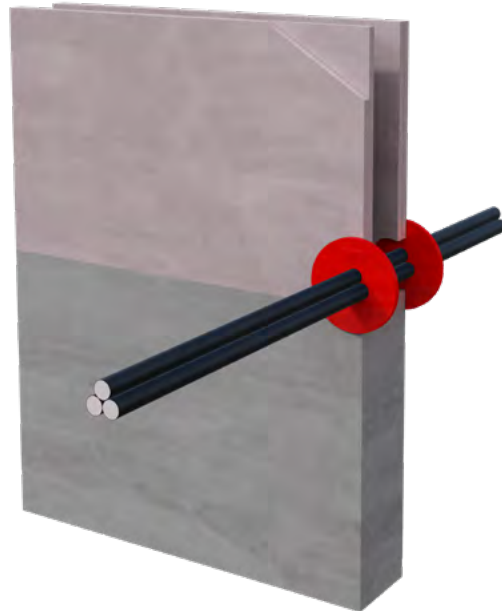


Figure 2:
SpeedSeal for sealing
around small cable
bunches

Technical Information

Standards & approvals

FIREPRO® SpeedSeal has been tested to BS EN 1366-3:2009
FIREPRO® SpeedSeal has been third party accredited through Certifire

Product properties

Property	Description	Test standard
Application temperature	>5°C	-
Thickness	4mm	
Colour	Red	
Density	1.55-1.6 g/cm ³	ISO 28111-1:2011
Fire resistance	Up to 2 hours	EN 1366-3:2009
Expected shelf life	12 months	Store in dry conditions unopened

Installation

1. Walls shall be a minimum of 100mm thickness or greater.
2. Flexible drywalls/partitions shall comprise a minimum of 2 layers of 'Type F' Gypsum board on both faces, with minimum 50mm studs.
3. Solid block, masonry, aerated concrete and concrete shall have a minimum density of 450kg/m³ and a minimum thickness of 100mm.
4. All walls shall have at least the same fire resistance as that required of the sealing system.
5. Services penetrating the division shall be suitably supported via steel angles, hangers or channels, no further than 400mm from the surface of the sealing system on both faces.
6. Ensure that the aperture size is within the scope of test data, maximum 25mm x 25mm for 60mm diameter and 50mm x 50mm for 100mm diameter SpeedSeal disc.
7. Check services to be treated are within scope of test data.
8. All services and apertures need to be thoroughly clean and clear of dust and loose particles.
9. Temperature to be 5°C or above.
10. To install, peel protective layer from back of disc and apply SpeedSeal around service, ensuring a close fit.
11. Install with joint facing in the downwards position where possible.
12. Press into place with slight compression to ensure a tight fit.

Specification clauses

FIREPRO® SpeedSeal is associated with the following NBS clause:

P12 Fire stopping systems

- 350 Intumescent Putty



The ROCKWOOL technical solution team are readily available to provide technical guidance and advice on any aspect of the FIREPRO® range.

For our full suite of Firestopping Standard Details, download the Standard Details Guide at:

www.rockwool.co.uk/technical-resources/product-documentation



Section 2: Cavity barriers & cavity firestops

Concealed spaces or cavities within the construction of a building can provide a clear path for fire and smoke to spread. Cavity Barriers and Cavity Firestops provide two important functions:


Cavity barriers

Used to close the edges of cavities, around openings (e.g. windows) or to sub-divide extensive cavities/voids in accordance with building regulations.

Cavity firestops

Used to continue the fire resistance of a compartment floor or wall within a cavity space or void e.g. junction between a compartment floor and external wall or above a compartment wall within a ceiling or roof void. It is important that the level of fire resistance achieved by the cavity firestop is equal to that of the compartment wall/floor.


Whether its single storey dwellings or multiple occupancy high rise buildings, ROCKWOOL provide a wide range of products and systems that have been tested for use as cavity barriers, cavity firestops or for use in both functions.

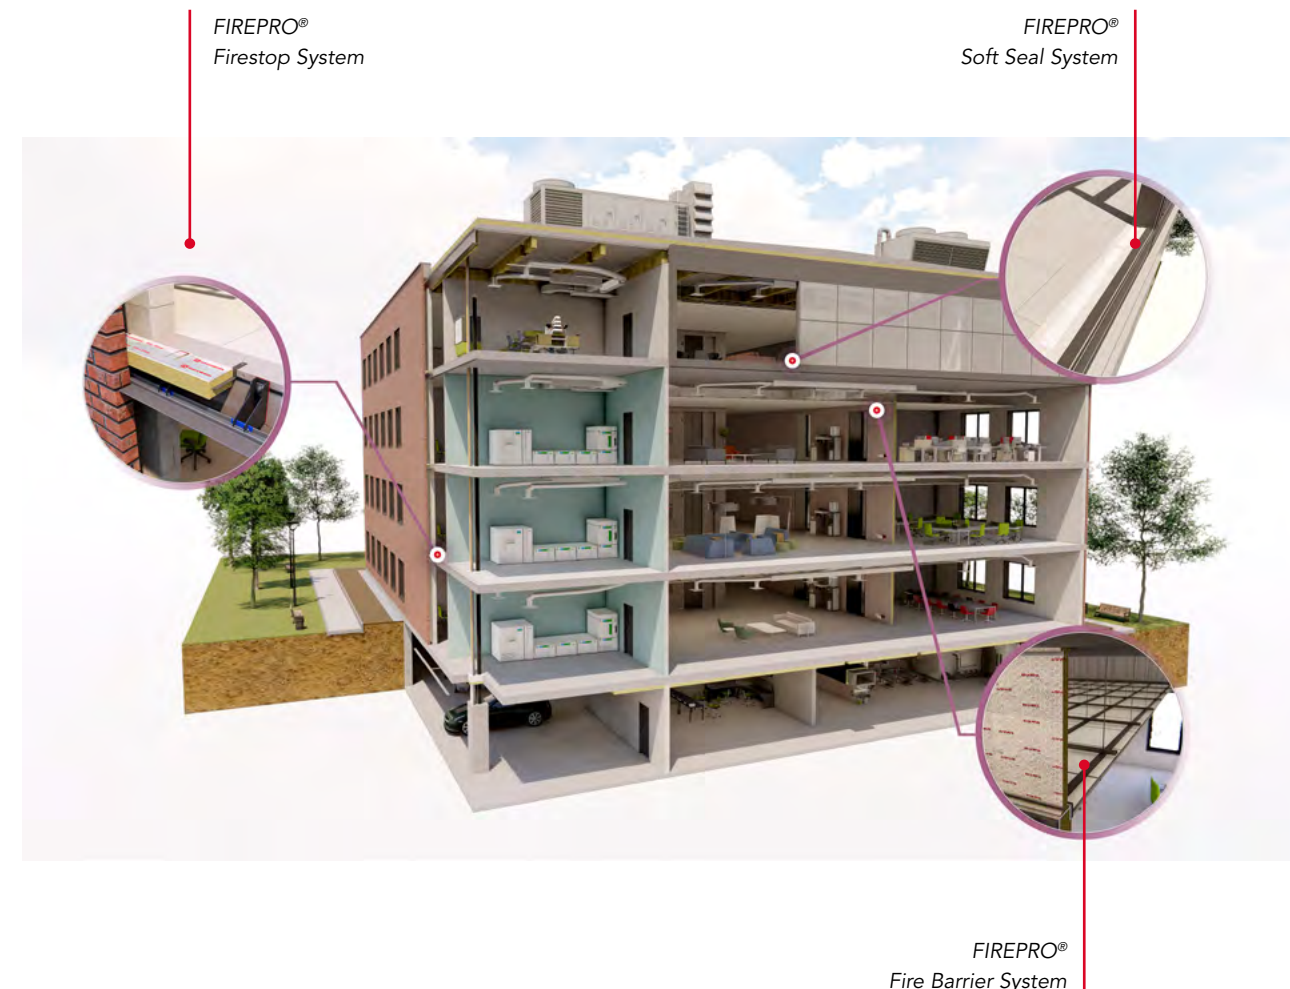

Core products




Fire Barrier System

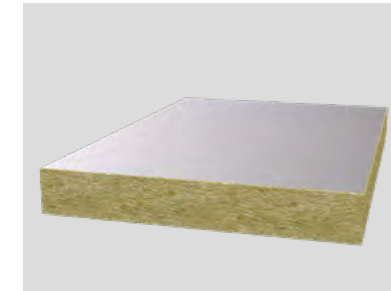

Fire Barrier Slab



TCB & PWCB Cavity Barriers

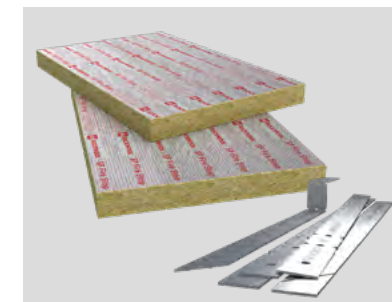

**FIREPRO®
SP Firestop System**

Useful documents and standards

ASFP Technical Guidance Document – TGD 17: Code of practice for the installation and inspection of fire stopping systems in buildings

ASFP Red Book: Fire stopping and penetration seals for the construction industry

ASFP: Ensuing best practice for passive fire protection in buildings

ASFP: On-site guide to installing fire stopping

BS 476-20: Fire test on building materials and structures. Method for determination of the fire resistance of elements of construction

BS EN 1366-4: Fire resistance test for service installations. Linear joint seals

BS EN 1366-4: Fire resistance test for service installations. Linear joint seals

BS EN 1363-1: Fire resistance tests. General Requirements


BS EN 13501-2: Fire classification of construction products and building elements.

Classification using test data from resistance to fire tests, excluding ventilation services.

ASFP (Association for Specialist Fire Protection) guidance documents can be sourced at www.asfp.org.uk



Fire Barrier System

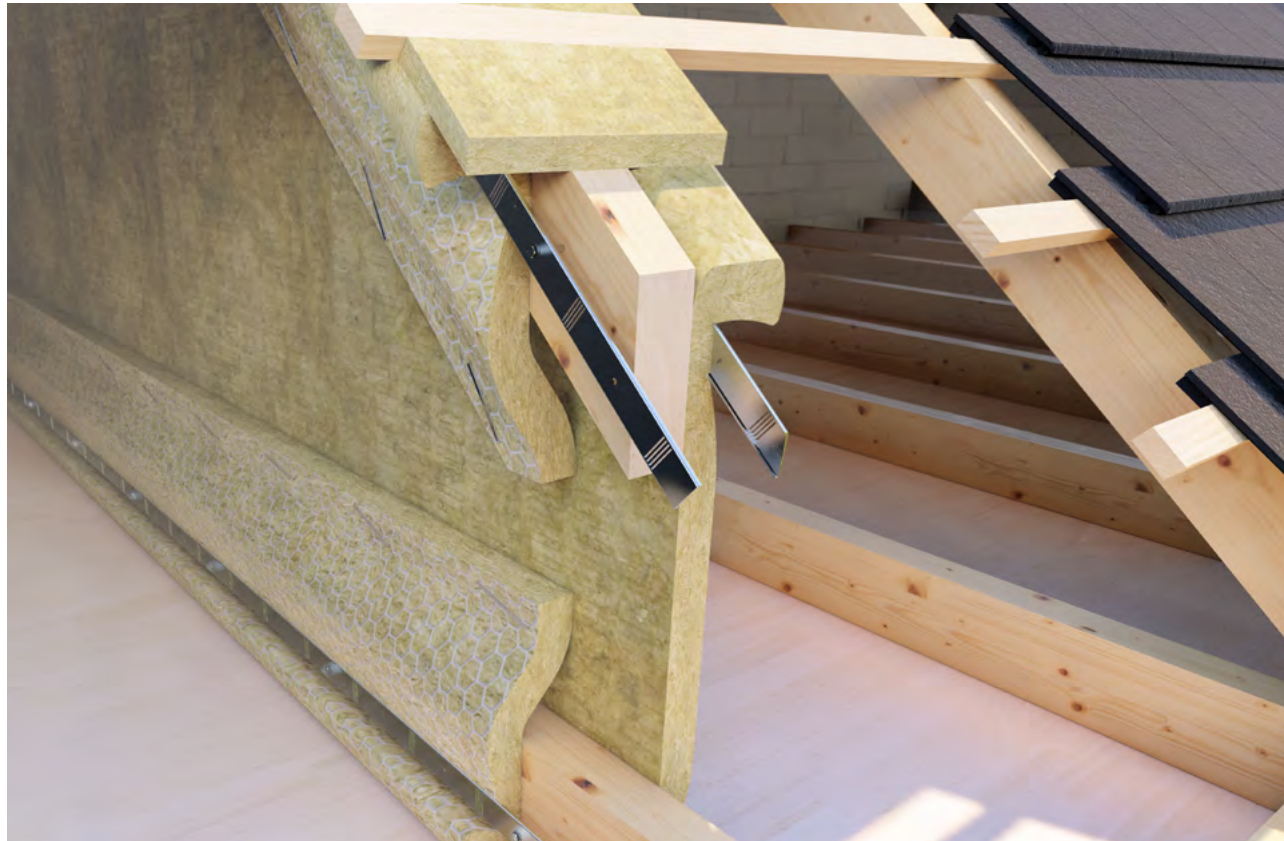

Description

ROCKWOOL Fire Barrier is comprised of stone wool and has a galvanised wire mesh which is stitched to one side. Foil faced options and double sided wire mesh are also available. Fire Barrier systems have been developed to prevent the spread of flames and inhibit heat and smoke through concealed spaces in buildings and improve sound reduction.

Advantages

- Patented 'quick-fit' system for up to 1 hour fire resistance
- Suitable for void heights up to 10.5 meters
- Provides airborne sound reduction
- Additional strength through wire mesh reinforcement
- Service penetration data available
- Fire resistance of up to 2 hours
- Flexible, accommodates movement

Applications

- Pitched roof voids
- Head of wall
- Concealed ceiling spaces
- Multiple substrates

Performance

Fire performance

Rating required	Max drop without support frame	Max drop with additional support frame	Max width	Integrity	Insulation	Install specification	Supporting document
30 min cavity barrier	3m	10.5m -	20m	30 60	15 15	Single 50mm layer FB, vertical joints butt jointed.	116911
30 min fire barrier	6m	N/A	20m	60	30	Single 60mm layer (plain or foil face) with a minimum 100mm overlapped and stitched joints on vertical joints*.	11970
60 min fire barrier	6m	10.5m	20m	60	60	2 layers of 50mm back to back butt jointed with staggered vertical joints between the back to back layers.	116912
90 min fire barrier	3.5m		20m	90	90		51812
120 min fire barrier	3.5m	9m	20m	120	120	2 layers of 60mm (plain or foil face) butt jointed, incorporating a 40mm aircavity between the layers.	44509

*All stitching must be carried out using 0.9mm annealed and galvanised wire. Continuous wire stitching (100mm minimum) or separate lengths of wire secured by twisting ends together. Wire must penetrate through thickness of barrier.

Note: All extensions in drop height must incorporate a minimum 100mm overlap between the sections and stitched with 1.5mm galvanised wire.

Acoustic performance

The correct use of Fire Barrier within structural cavities and voids will reduce the level of transmitted sound.

Where plasterboard ceilings are used, add 2-3dB to above performances.

Room to room attenuation	R _w dB
Typical lay-in grid suspended ceiling	30
Ceiling and 50mm ROCKWOOL Fire Barrier	42
Ceiling and 50mm ROCKWOOL Fire Barrier Foil Faced	44
Ceiling and 2x layers of 50mm ROCKWOOL Fire Barrier Foil Faced	50

Note: Values quoted are approximate



Technical information

Standard and approvals

Fire Barrier Systems have been independently tested and assessed to BS 476: Part 22 by UKAS accredited laboratories.

ROCKWOOL Fire Barrier system achieves a reaction to fire classification of A1 as defined in BS EN 13501:1

They are third party approved for performance and quality by the Loss Prevention Council Certification board (LPCB) and are listed in their Fire and Security 'Red Book' - certificate no. 022c.

The product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this data sheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details – LUL ref: 2230.

Product information

One or two sided foil face options available.

Wired mesh is available to both sides if required.

Thickness	Length	Width
50mm	4000mm	1000mm
60mm	3500mm	1000mm




Installation

½ hour cavity barrier

Figures 4-9 show typical details for Fire barrier applied to a timber truss construction as a half hour cavity barrier within the roof section, to satisfy the requirements of building Regulation B3 - (4) i.e. 30 minutes fire integrity and 15 minutes fire insulation.

If the truss is constructed from a minimum timber size of 35 to 49mm thick, both sides of all truss members/bracing require protection from fire in order to minimise charring and retain strength. Figure 6 shows strips of 50mm Fire Barrier used on the reverse side of the truss (for this purpose). Nail plate fixings may fail prematurely in fire unless protected (see Figure 9).

The ROCKWOOL Fire Barrier Fixing System incorporates an angle support and clamping plate (up to one hour)

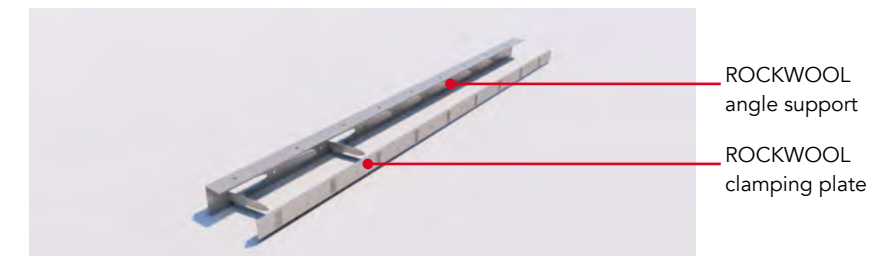

For fixing to timber, the ROCKWOOL clamping plate is used, compressing the barrier to the timber, fixed at 450mm centres using No. 10 woodscrews. To use the patented ROCKWOOL angle support system, bend tongues out to 90° and impale barrier onto them. The slotted clamping plate is then fitted by pushing the tongues through the slots, these are then bent over the face of the clamping plate completing the process.

Figure 4
Fire Barrier traverse to rafters


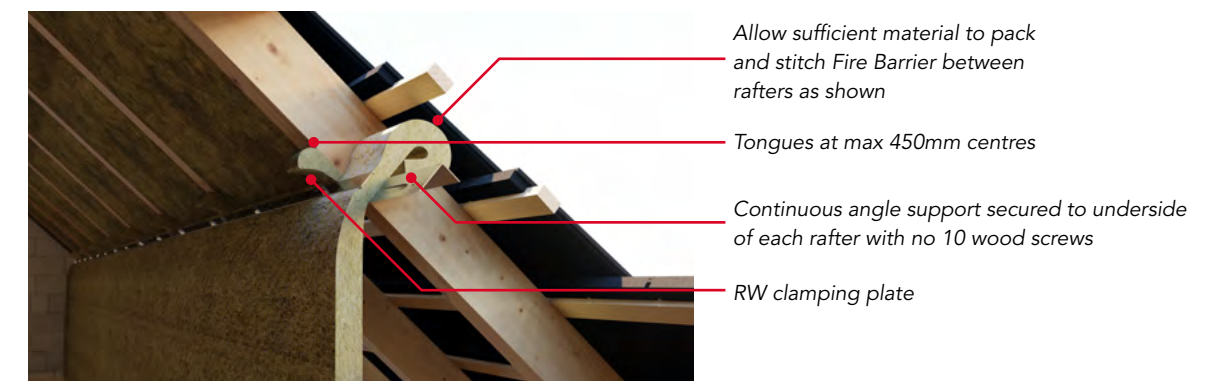


Figure 5
Half hour protection for timber truss construction 50mm thick or more.
Note: Nail plate protection required - see Figure 6



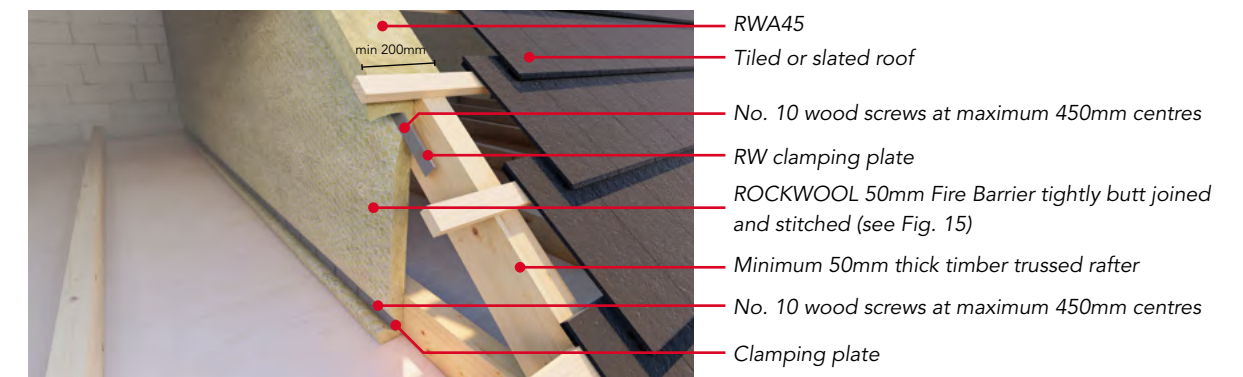

Fire stopping: Section 2 - Cavity barriers & cavity firestops

Figure 6
Half hour protection for timber truss construction 35 to 49mm thick.

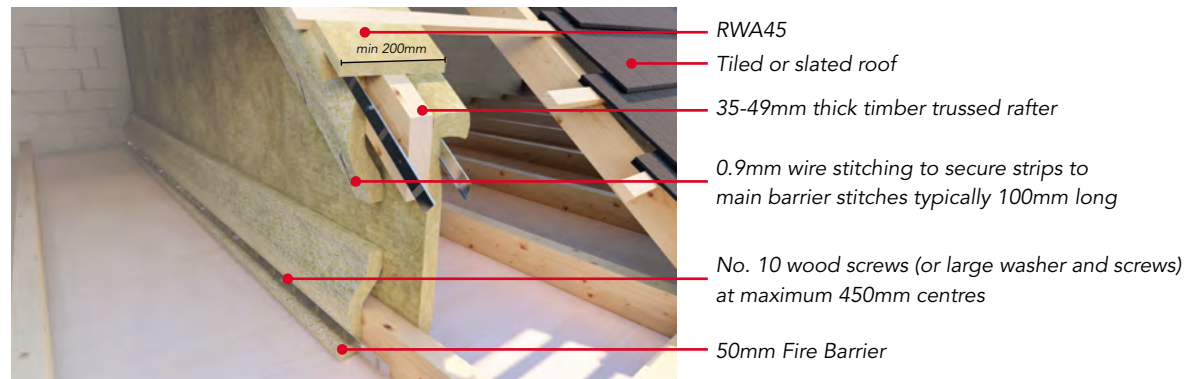


Figure 7
Head of partition

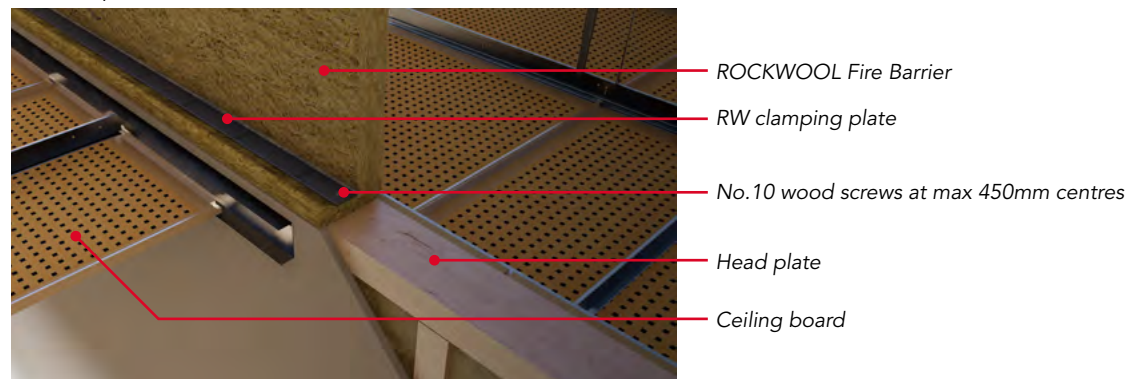


Figure 8
Barrier fitted transversely to timber joisted ceiling

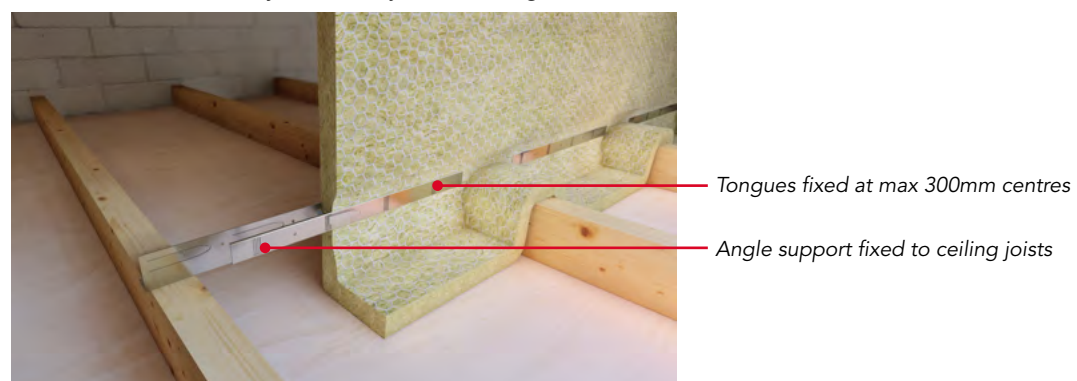


Figure 9
Nail plate protection



25mm thick ROCKWOOL BeamClad® fixed with FIREPRO® Glue and nailed, or 50mm Fire Barrier secured with screws and large square washers. Use 50mm nails for BeamClad® and 70mm screws for Fire Barrier.

For fixing to concrete soffits (Figure 10-12), the pre-punched angle support is fixed using Hilti DBZ or Ejot ECL 35 hammer set anchors at max. 750mm centres. For fixing to steel purlins, use Hilti SMD 02Z (5.5 x 70mm) self-tapping screws at maximum 450mm centre.

Figure 10
50mm Fire Barrier fixed to concrete soffit.

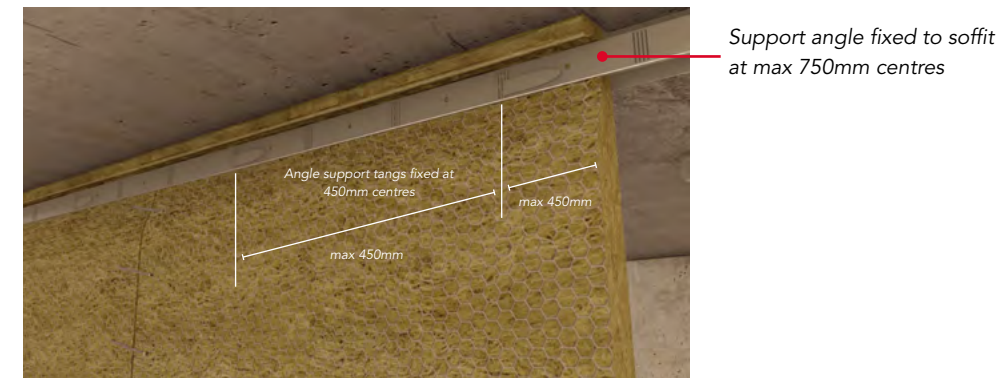


Figure 11
50mm Fire Barrier running across ribbed soffit - Section


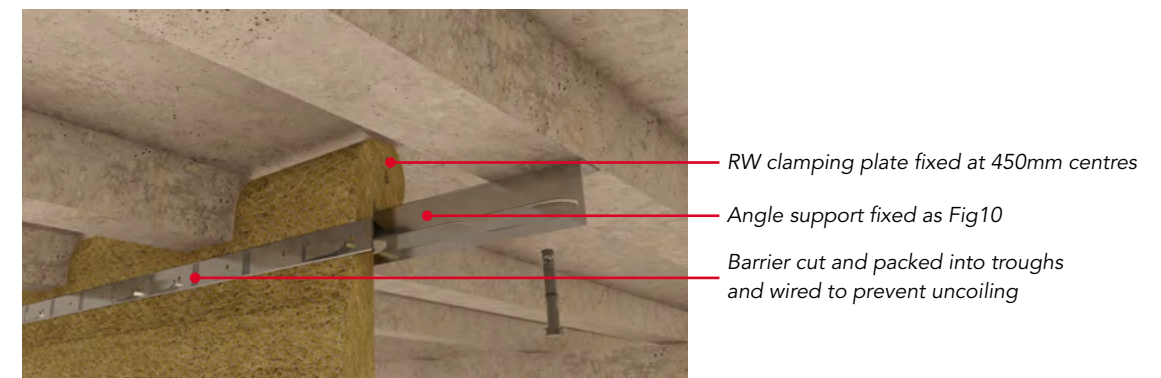


Figure 12
Alternative fixing to flat soffit or perimeter, appropriate to barriers with a shallow drop



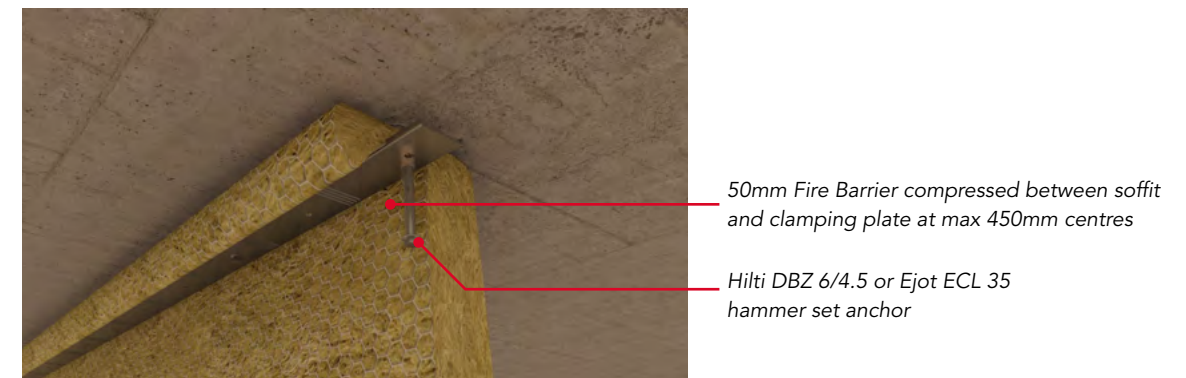

Fire stopping: Section 2 - Cavity barriers & cavity firestops

60-30 fire barrier

If 30 minutes insulation is required, use 1 layer of 60mm plain or foil-faced fire barrier with 100mm vertical over lapped joints (Figure 13 & 14). The barrier is otherwise fixed for timber construction as previously shown on Figures 4-9.

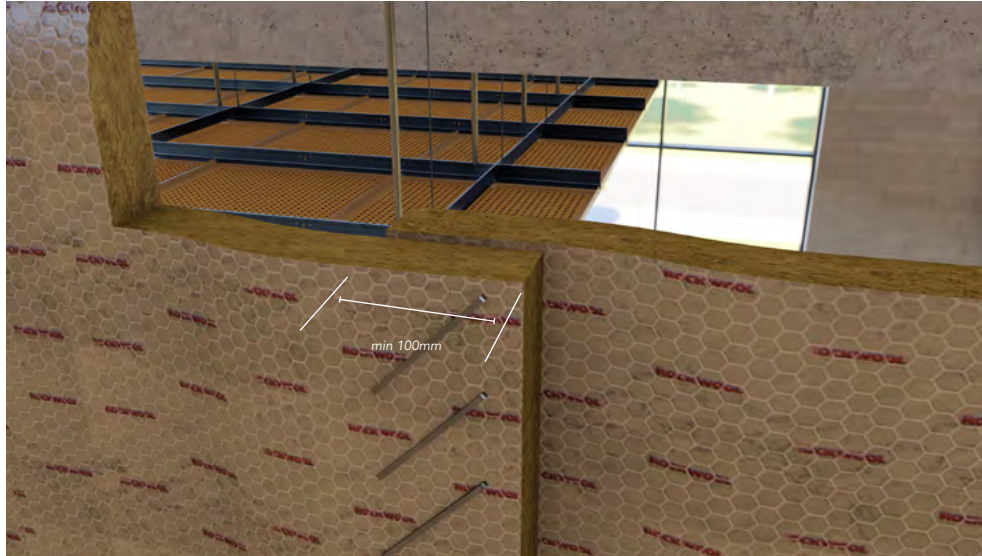


Figure 13



Figure 14

Common details

Extended drops

ROCKWOOL 50mm Fire barrier single and double layers, can be extended from a 3.5m drop to a maximum 6m drop by fixing an additional 2.5m section, stitched with overlapped joints as per Figure 16. For additional guidance and drops in excess of 6m, please refer to Figure 31 and associated guidance.

Wire stitching of butt joints in ROCKWOOL Fire Barriers

Adjacent barriers must be closely butt jointed, or overlapped, and through stitched with 0.9mm galvanised annealed wire (see Figure 15). It is essential that the barrier provides a good seal at its head, perimeter and at all joints. Where the barrier abuts a profile such as a trapezoidal deck, the material must be cut to suit and secured to fire stop the gap (see Figure 17). For extended drops, 1.5mm diameter galvanised and annealed wire is used (see Figure 16).

Figure 15


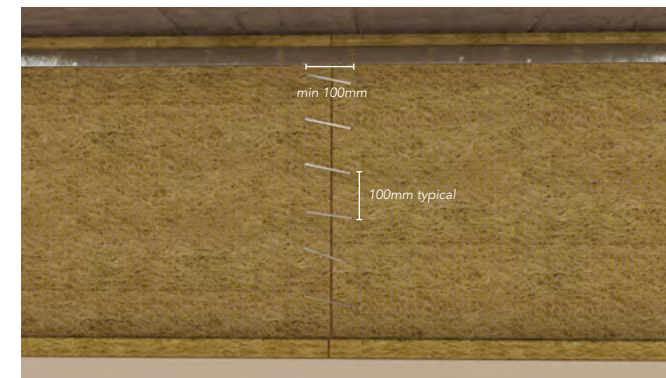


Figure 16



Figure 17

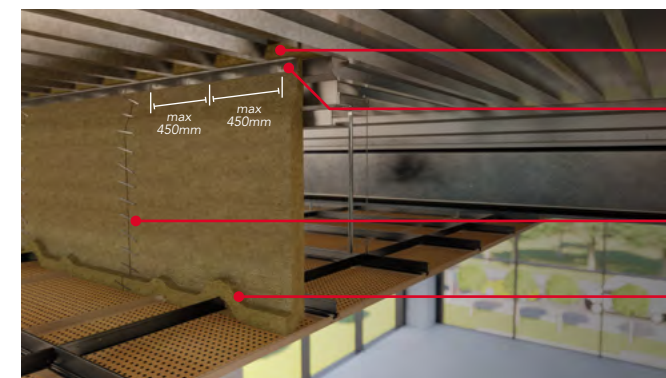

Fire Barrier cut and pushed up into profile as fire stopping

Angle or clamping plate fixing Fire Barrier to purlin with self tapping screws at 450mm centres (Hilti SMD 02Z 5.5 x 70mm)

Adjacent Barriers butt jointed and wired tightly together as Fig15

Fire Barrier draped over suspended ceiling and wired to grid, min 100mm lap. If not wired, overlap is min 150mm



Fire stopping: Section 2 - Cavity barriers & cavity firestops

Penetration details

It is regarded as good practice to adequately support or reinforce services penetrating compartment walls and cavity barriers, to prevent displacement. It is recommended that such supports should be no greater than 500mm from each face of the Fire Barrier.

To maintain the integrity of the Fire/Cavity Barrier when penetrated by services with a high melting point (such as steel or copper pipes, beams or trusses) the barrier is first cut locally to accommodate the service or structural member and then re-stitched as neatly as possible. The penetration is then lightly sleeved each side of the barrier to a minimum length of 300mm, using the same barrier material. Each sleeve should be securely stitched to the main barrier to produce a tight seal and prevent future detachment (see Figures 18 and 19). Where access is only available from one side, the double seal solution may be replaced by a single 'collar' detail - please contact our Technical Solutions Team for further advice.

If the penetrating service is manufactured from low melting point materials such as plastic or aluminium, then sleeving should be extended to at least 1000mm either side of the barrier.

This guidance applies to services such as pipes, sheathed cables and conduits, including those carried on steel trays.

For protected steel ductwork with a tested fire resistance performance (stability, integrity and insulation) at least the same as the Fire Barrier, 300mm sleeves should be applied either side of the main barrier, as for high melting point services above.

For information on achieving fire protection to steel ductwork, please refer to the ROCKWOOL Fire Duct System data sheet.

For non-fire protected ductwork, or that with a fire resistance performance less than the barrier, two sleeves should be applied to each side of the barrier, an inner sleeve of 1000mm and an outer sleeve of 300mm. All sleeves should be stitched to the main barrier.

The duct should also include an independently supported fire damper, located in the line of the main barrier. Reference should also be made to Approved Document B of England & Wales Building Regulations - Volume 1, Requirement B3, Section 7 and Volume 2, Requirements B3, Section 10.

Figure 18


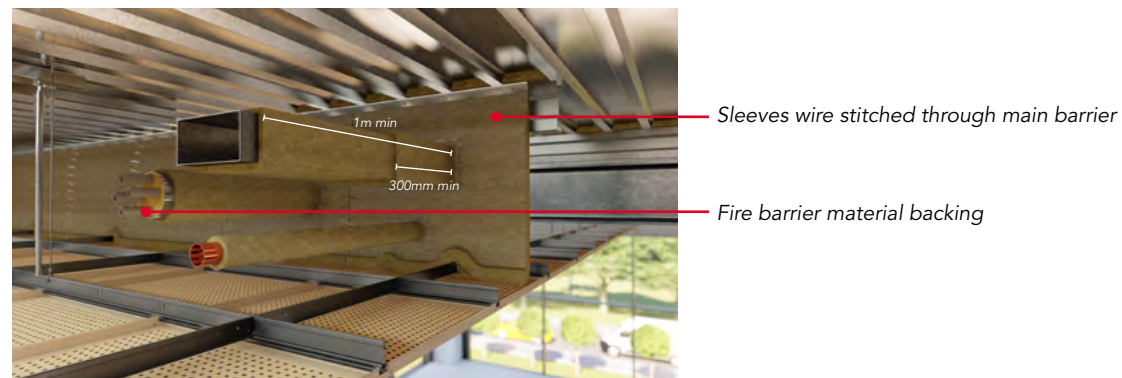


Figure 19

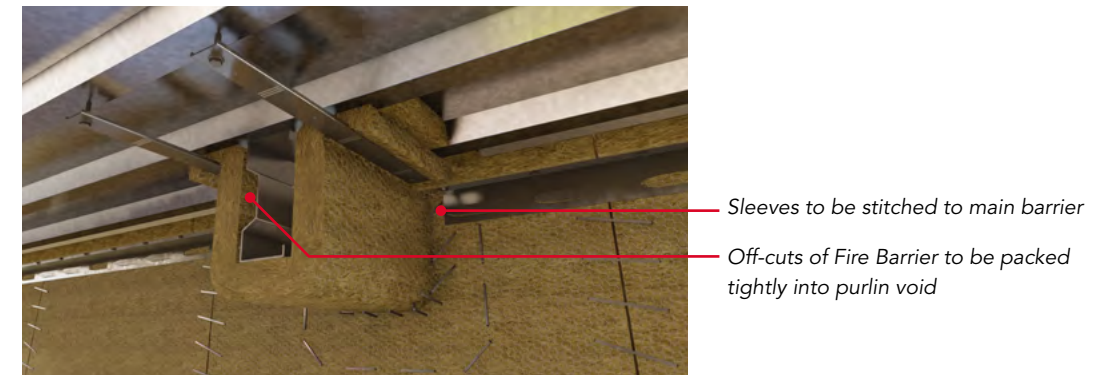

1 hour fire barrier

The unique, patented ROCKWOOL support angle and clamping plate is used to fasten two 50mm Fire Barrier curtains with one support angle without the need for a cavity.

The ROCKWOOL support angle has tongues that are pushed out from opposite sides at 300mm max. centres. The ROCKWOOL Fire Barriers are then impaled on the tongues on both sides and clamped using the ROCKWOOL clamping plates. The tongues are finally bent over the clamping plates, completing the system.

The system uses 50mm Fire Barrier in a double layer with joints staggered.

Note: Wire reinforced sides should be placed outwards.

Figure 20

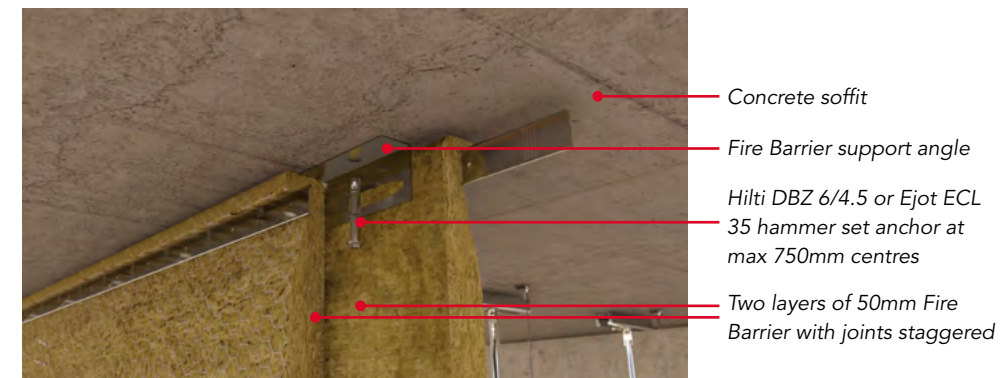


Figure 21

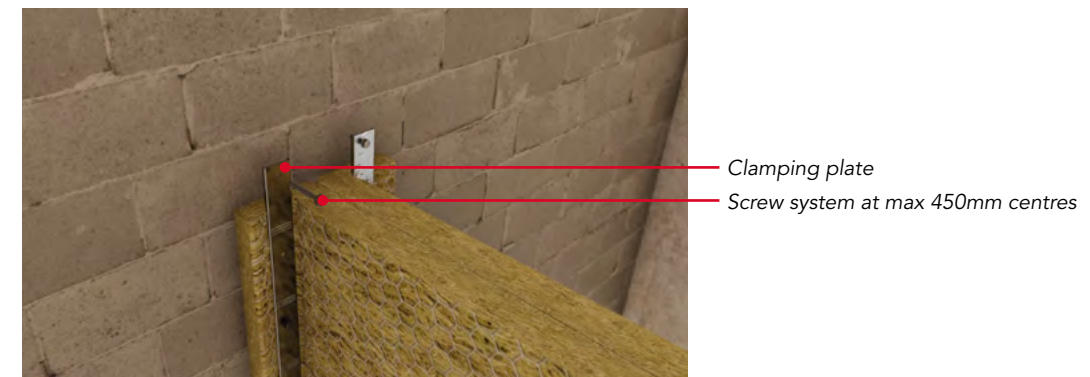




Figure 22


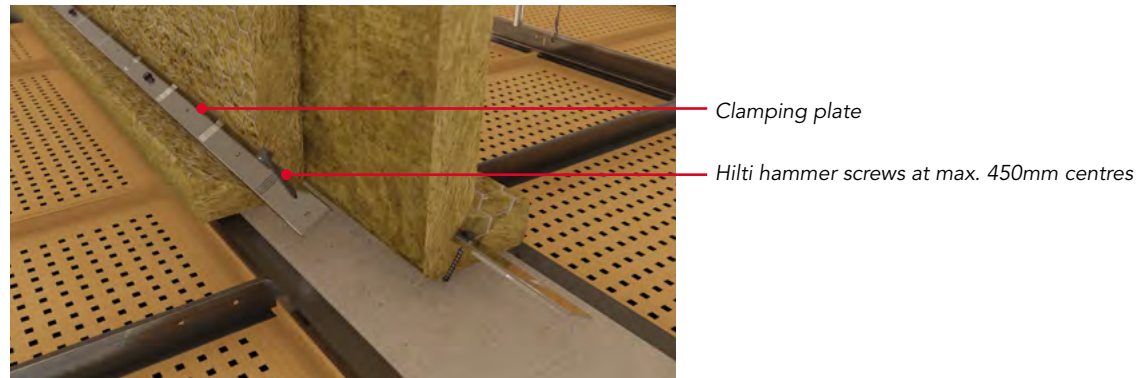



Figure 23

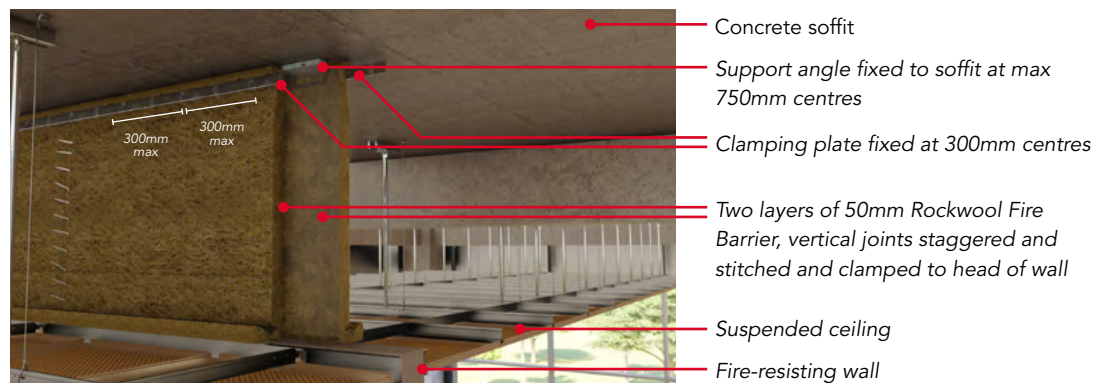

Fixing To timber structure (1 hour)

When a 1 hour Fire Barrier is supported on structural timber (for example a trussed rafter), and the thickness of timber is 35-49mm, one layer of 60mm ROCKWOOL Fire Barrier must be placed on each side of the timber (see Figure 24). Where timber thickness is 50mm or greater, 2 layers of 50mm Fire Barrier are sufficient.

Figure 24

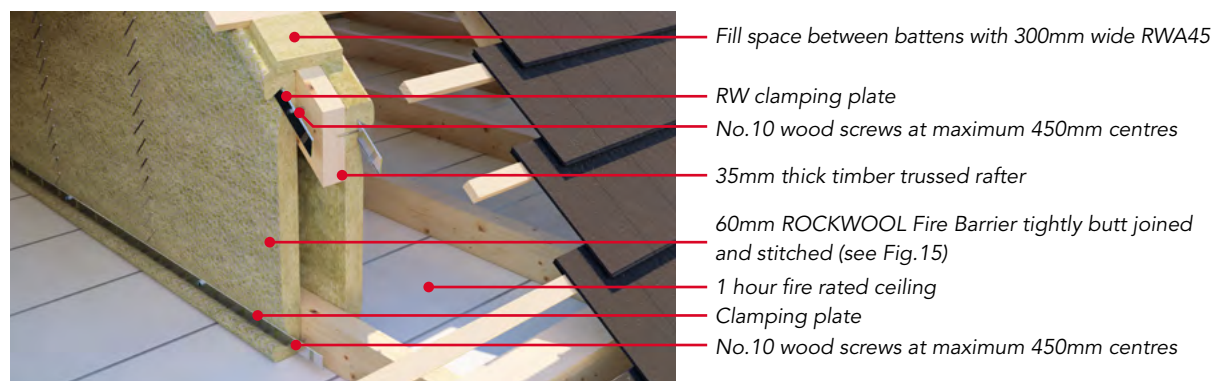

1.5 & 2 hour fire barriers

1.5 hour fire barrier

The ROCKWOOL 1.5 hour Fire Barrier system uses 2 layers of 50mm Fire Barrier with staggered joints fixed as Figures 25-27.

Note: Wire reinforced faces should be placed outwards.

Figure 25

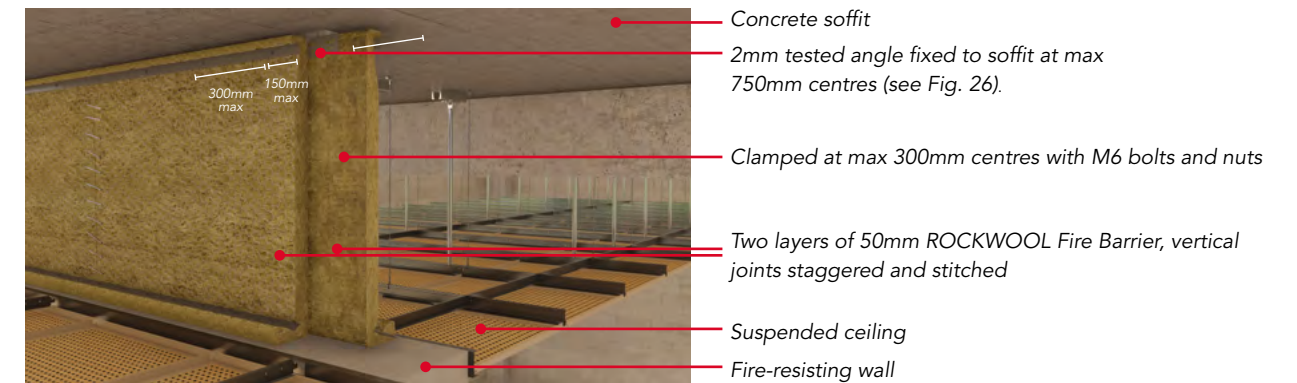


Figure 26


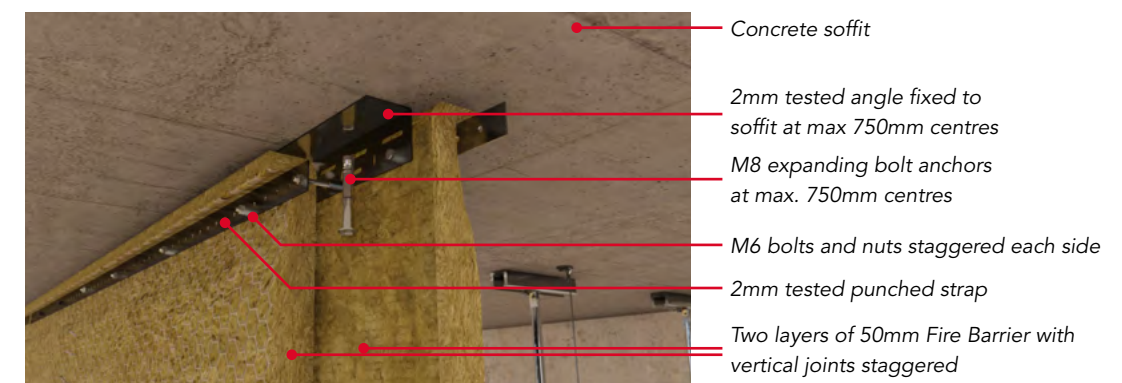


Figure 27



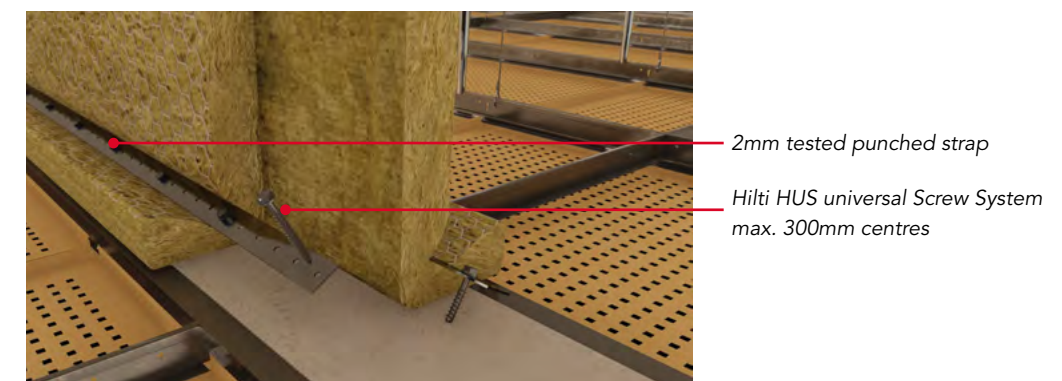

Fire stopping: Section 2 - Cavity barriers & cavity firestops

2 hour fire barrier

The ROCKWOOL 2-hour Fire Barrier (see Figures 28-30) consists of two layers of 60mm (plain or foil-faced), wire stitched Fire Barrier with staggered vertical joints, separated by a nominal 40mm air space. The base or perimeter to which the barrier is fixed must be capable of remaining in place for 2 hours.

Figure 28


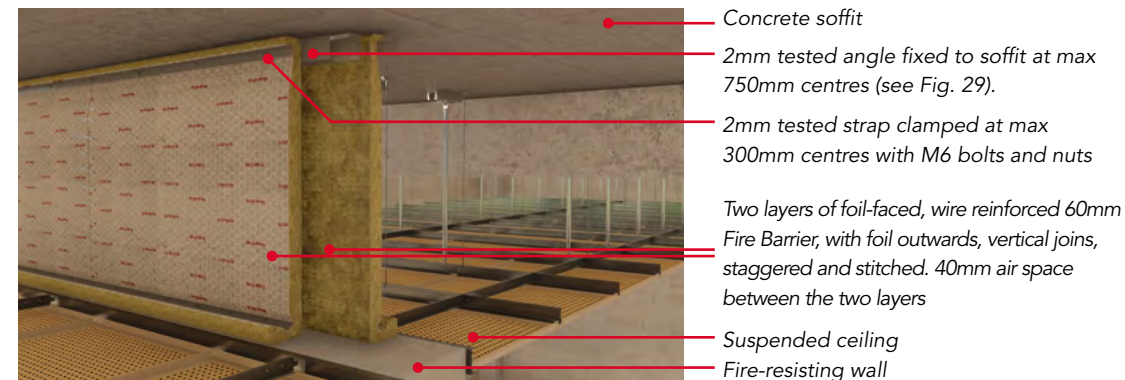


Figure 29



Figure 30

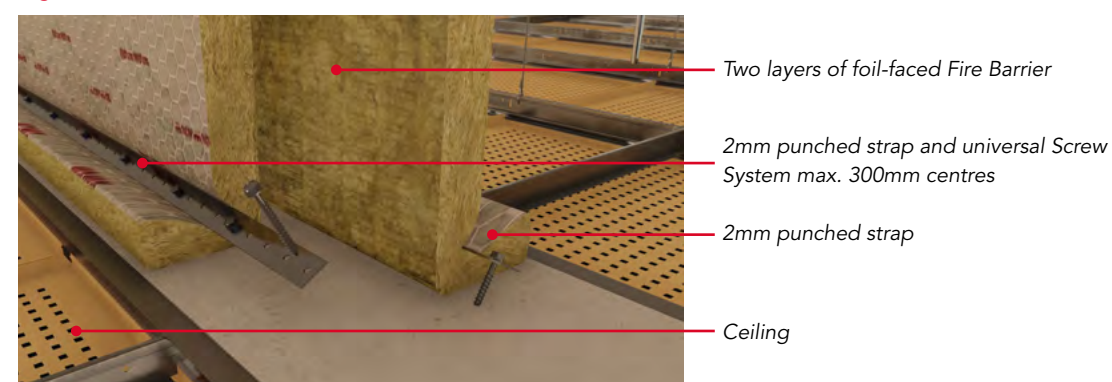

Angle and strap for 1.5% and 2 hour fire barriers

The following specification for slotted angles and straps is suitable for supporting ROCKWOOL Fire Barriers for 1.5 and 2 hours when tested to BS 476: Part 22. Slotted angles (62 x 41 x 2mm) and straps (38 x 2mm) manufactured from mild steel conforming to BS 1449: Part 1.1: 1991 and cold reduced to provide a minimum of 0.2% proof stress of 417 Mpa (27 tons/ in²) and conforming to BS 4345: 1968 (1986) - Specification for slotted angles (inc. flat strap).

Other installation information

General design considerations

A cavity fire barrier must be designed to restrict the passage of both hot smoke and flames for the minimum specified period, as listed in Approved Document B in support of the Building Regulations. In addition, it must be fixed in such a way that:

- It will remain effective in the event of structural movement
- There are no gaps where it abuts other elements of construction
- It complies with the requirements of Approved Document B of the Building Regulations

Extended drops

For periods of up to 60 minutes, ROCKWOOL Fire Barriers can be used for extended void heights between 3.5 and 6m without the need for a supported frame - see Figure 16 for joining barriers with overlap. For periods of up to 90 minutes, this drop height can be increased to 10.5m (9m for 120 minutes), by the use of a simple frame system constructed from slotted angles and straps (see Figure 31).

Further details are available from ROCKWOOL Technical Solutions Team.

Fire barriers and dampers

Where ROCKWOOL Fire Barriers are installed in conjunction with fire dampers, the dampers must be supported independently of the fire barrier. HVCA or ASFP publications may be helpful.

Access through barriers

Where regular access is required through the barriers for maintenance purposes etc, this should be achieved by the inclusion of an independently supported fire rated door set and frame. The Fire Barriers should be clamped to the door frame with the RW clamping plate and appropriate fixings at 450mm centres.

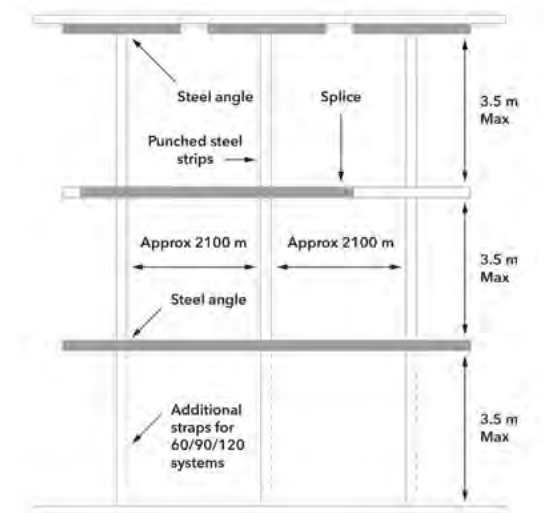


Figure 31



Ancillaries

ROCKWOOL ancillaries

ROCKWOOL Fire Barrier support angle and clamping plate are specially manufactured for ROCKWOOL.

Clamping plate:

3m x 40mm, 10 lengths per pack

Fire barrier support angles:

3m x 34mm x 75mm, 10 lengths per pack

Proprietary fixings

All steel hammer set expansion anchors for soffit fixings are available from Hilti, or Ejot. For perimeter fixings to concrete or masonry, use Hilti HUS Universal Screw system. For fixings to timber, use standard No. 10 steel wood screws 100mm long.

Durability

For durability, we recommend that the finish should be capable of withstanding at least 200 hours salt spray and 400 hours humidity corrosion resistance testing to BS 3990: Part F. Slotted angles and straps conforming to this specification are available from the following suppliers: JB Products Tel: 01384 240234 Link 51 Tel: 01952 682251 Romstor Tel: 01442 242261

If other hardware is used to support the barriers, we recommend that the respective specifier, supplier or installer should be certain that the chosen fixing system has been both tested and approved, for the required period of fire resistance and drop height.

Site advisory service

ROCKWOOL provides a site advisory service by engineers, solely employed to assist with advice when installing ROCKWOOL materials on site. The service is intended for site guidance, but is not intended to be an inspection facility unless agreed under a separately financed contract agreement.

For Approval of installed barriers, the installer or building owner will be referred to a suitably accredited and experienced fire assessor or fire safety engineering organisation.

Packaging of fire barrier

Shrink wrapped in polyethylene

Handling

ROCKWOOL Fire Barriers are easy to handle. It is easy to cut to any shape. The product should be stored indoors or under a weatherproof covering.

Maintenance

Once installed, ROCKWOOL Fire Barriers should need no maintenance. Fire Barriers should be inspected to ensure that they have not been disturbed during maintenance of areas and/or as part of a regular maintenance program.

Specification clauses

ROCKWOOL Fire Barrier System is associated with the following NBS clauses:

K10 Gypsum board dry linings / partitions / ceilings

- 530 – Cavity fire barriers within partitions/wall linings
- 545 – Cavity fire barriers within suspended ceilings

K40: Demountable suspended ceilings

- 287 – Cavity Barriers
- 425 – Installing cavity barriers
- 431 – Installing sound barriers


P10 Sundry insulation / proofing work

- 410 – Flexible cavity barriers
- 430 – Wired mineral wool small cavity barriers
- 440 – Fire protection





Fire Barrier Slab

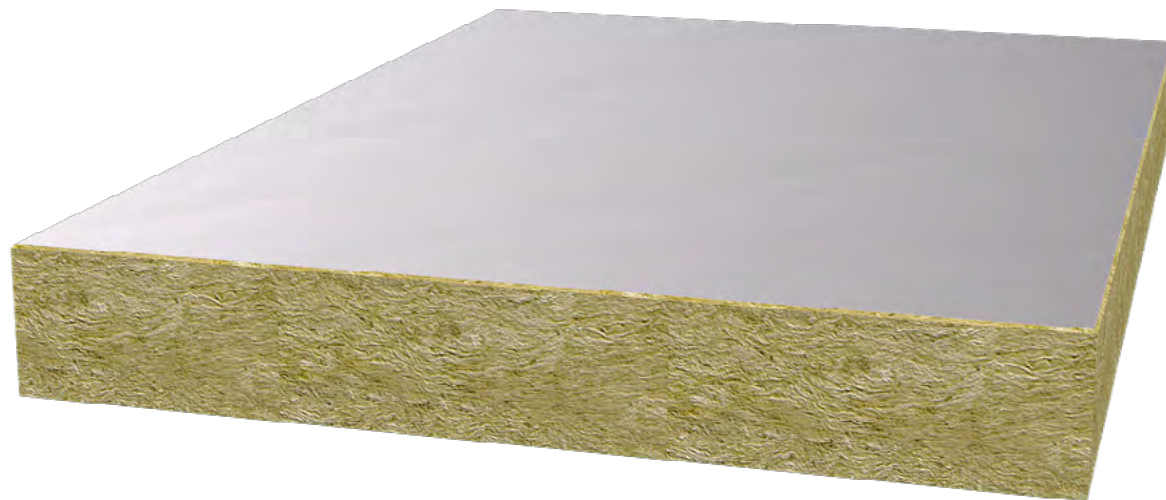

Description

ROCKWOOL Fire Barrier Slab comprises a high density stone wool core which is foil-faced on both sides. Fire Barrier slab has been developed to prevent the spread of flames, inhibit heat and smoke through concealed spaces in buildings and improve sound reduction.

Advantages

- Simple, butt-jointed and friction fit application
- No fixings, fasteners or angles required
- Suitable for closing voids of up to 1m in height and 20m in length
- Provides airborne sound reduction
- Service penetration data available
- Fire resistance of up to 4 hours integrity
- LUL approved in combination with ROCKWOOL LUL Intumescent Sealant

Applications

- Head of wall
- Concealed voids
- Service penetrations

Performance

Fire performance

Achieves 240min integrity; 60 min insulation without service penetrations. Where service penetrations are present Fire Barrier slab can achieve 90min integrity; 60min insulation dependent on service penetration type. For further information of specific service penetration details please contact ROCKWOOL Technical Support.

Acoustic performance

ROCKWOOL Fire Barrier Slab has been tested in accordance with BS EN ISO 10140-2:2010 achieving Rw 23dB. Test Report N° C/23667/T01.

Technical Information

Standards and approvals

Fire Barrier Slab has been independently tested and assessed to BS 476: Part 20 and Part 22 by accredited laboratories.

ROCKWOOL Fire Barrier system achieves a reaction to fire classification of A1 as defined in BS EN 13501:1

They are third party approved for performance and quality by the Loss Prevention Council Certification board (LPCB) and are listed in their Fire and Security 'Red Book' - certificate no. 022c/02.

The product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this data sheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details – LUL ref: 2231.

Product information

Thickness	Length	Width
100mm	1000mm	666mm



Installation

1. Fire Barrier Slab should be cut to the appropriate height and friction fitted within the opening.
2. ROCKWOOL Acoustic Intumescent Sealant or ROCKWOOL LUL Intumescent Sealant should then be applied to both the butt joints and perimeter of the barrier seal.

Service penetrations

ROCKWOOL Fire Barrier Slab can be penetrated by steel pipes of ≤ 33 mm external diameters and steel cable trays of $\leq 305\text{mm} \times 50\text{mm}$.


Penetrating services must be independently supported by a maximum of 150mm from the face of the slabs.

Handling

ROCKWOOL Fire Barrier slab is easy to handle. It is easy to cut to any shape. The product should be stored indoors or under a weatherproof covering.

Maintenance

Once installed ROCKWOOL Fire Barrier Slab should need no maintenance. Fire Barrier Slab should be inspected to ensure that they have not been disturbed during maintenance of areas and/or as part of a regular maintenance program.

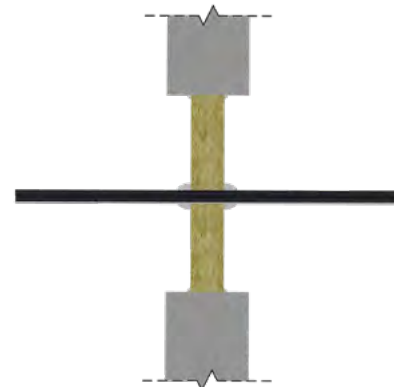

Specification clauses

ROCKWOOL Fire Barrier Slab is associated with the following NBS clauses:

K10 Gypsum board dry linings / partitions / ceilings

- 530 – Cavity fire barriers within partitions/wall linings
- 545 – Cavity fire barriers within suspended ceilings


K40: Demountable suspended ceilings

- 287 – Cavity Barriers
- 425 – Installing cavity barriers
- 431 – Installing sound barriers

P10 Sundry insulation / proofing work

- 410 – Flexible cavity barriers
- 430 – Wired mineral wool small cavity barriers
- 440 – Fire protection

Preventing the spread of fire and smoke within concealed voids is essential for maintaining compartmentation in the event of a fire. To provide additional assurance of performance, ROCKWOOL Fire Barrier Systems have been certified by the LPCB and are listed in the LPCB Red Book (Certificate Number 022c)

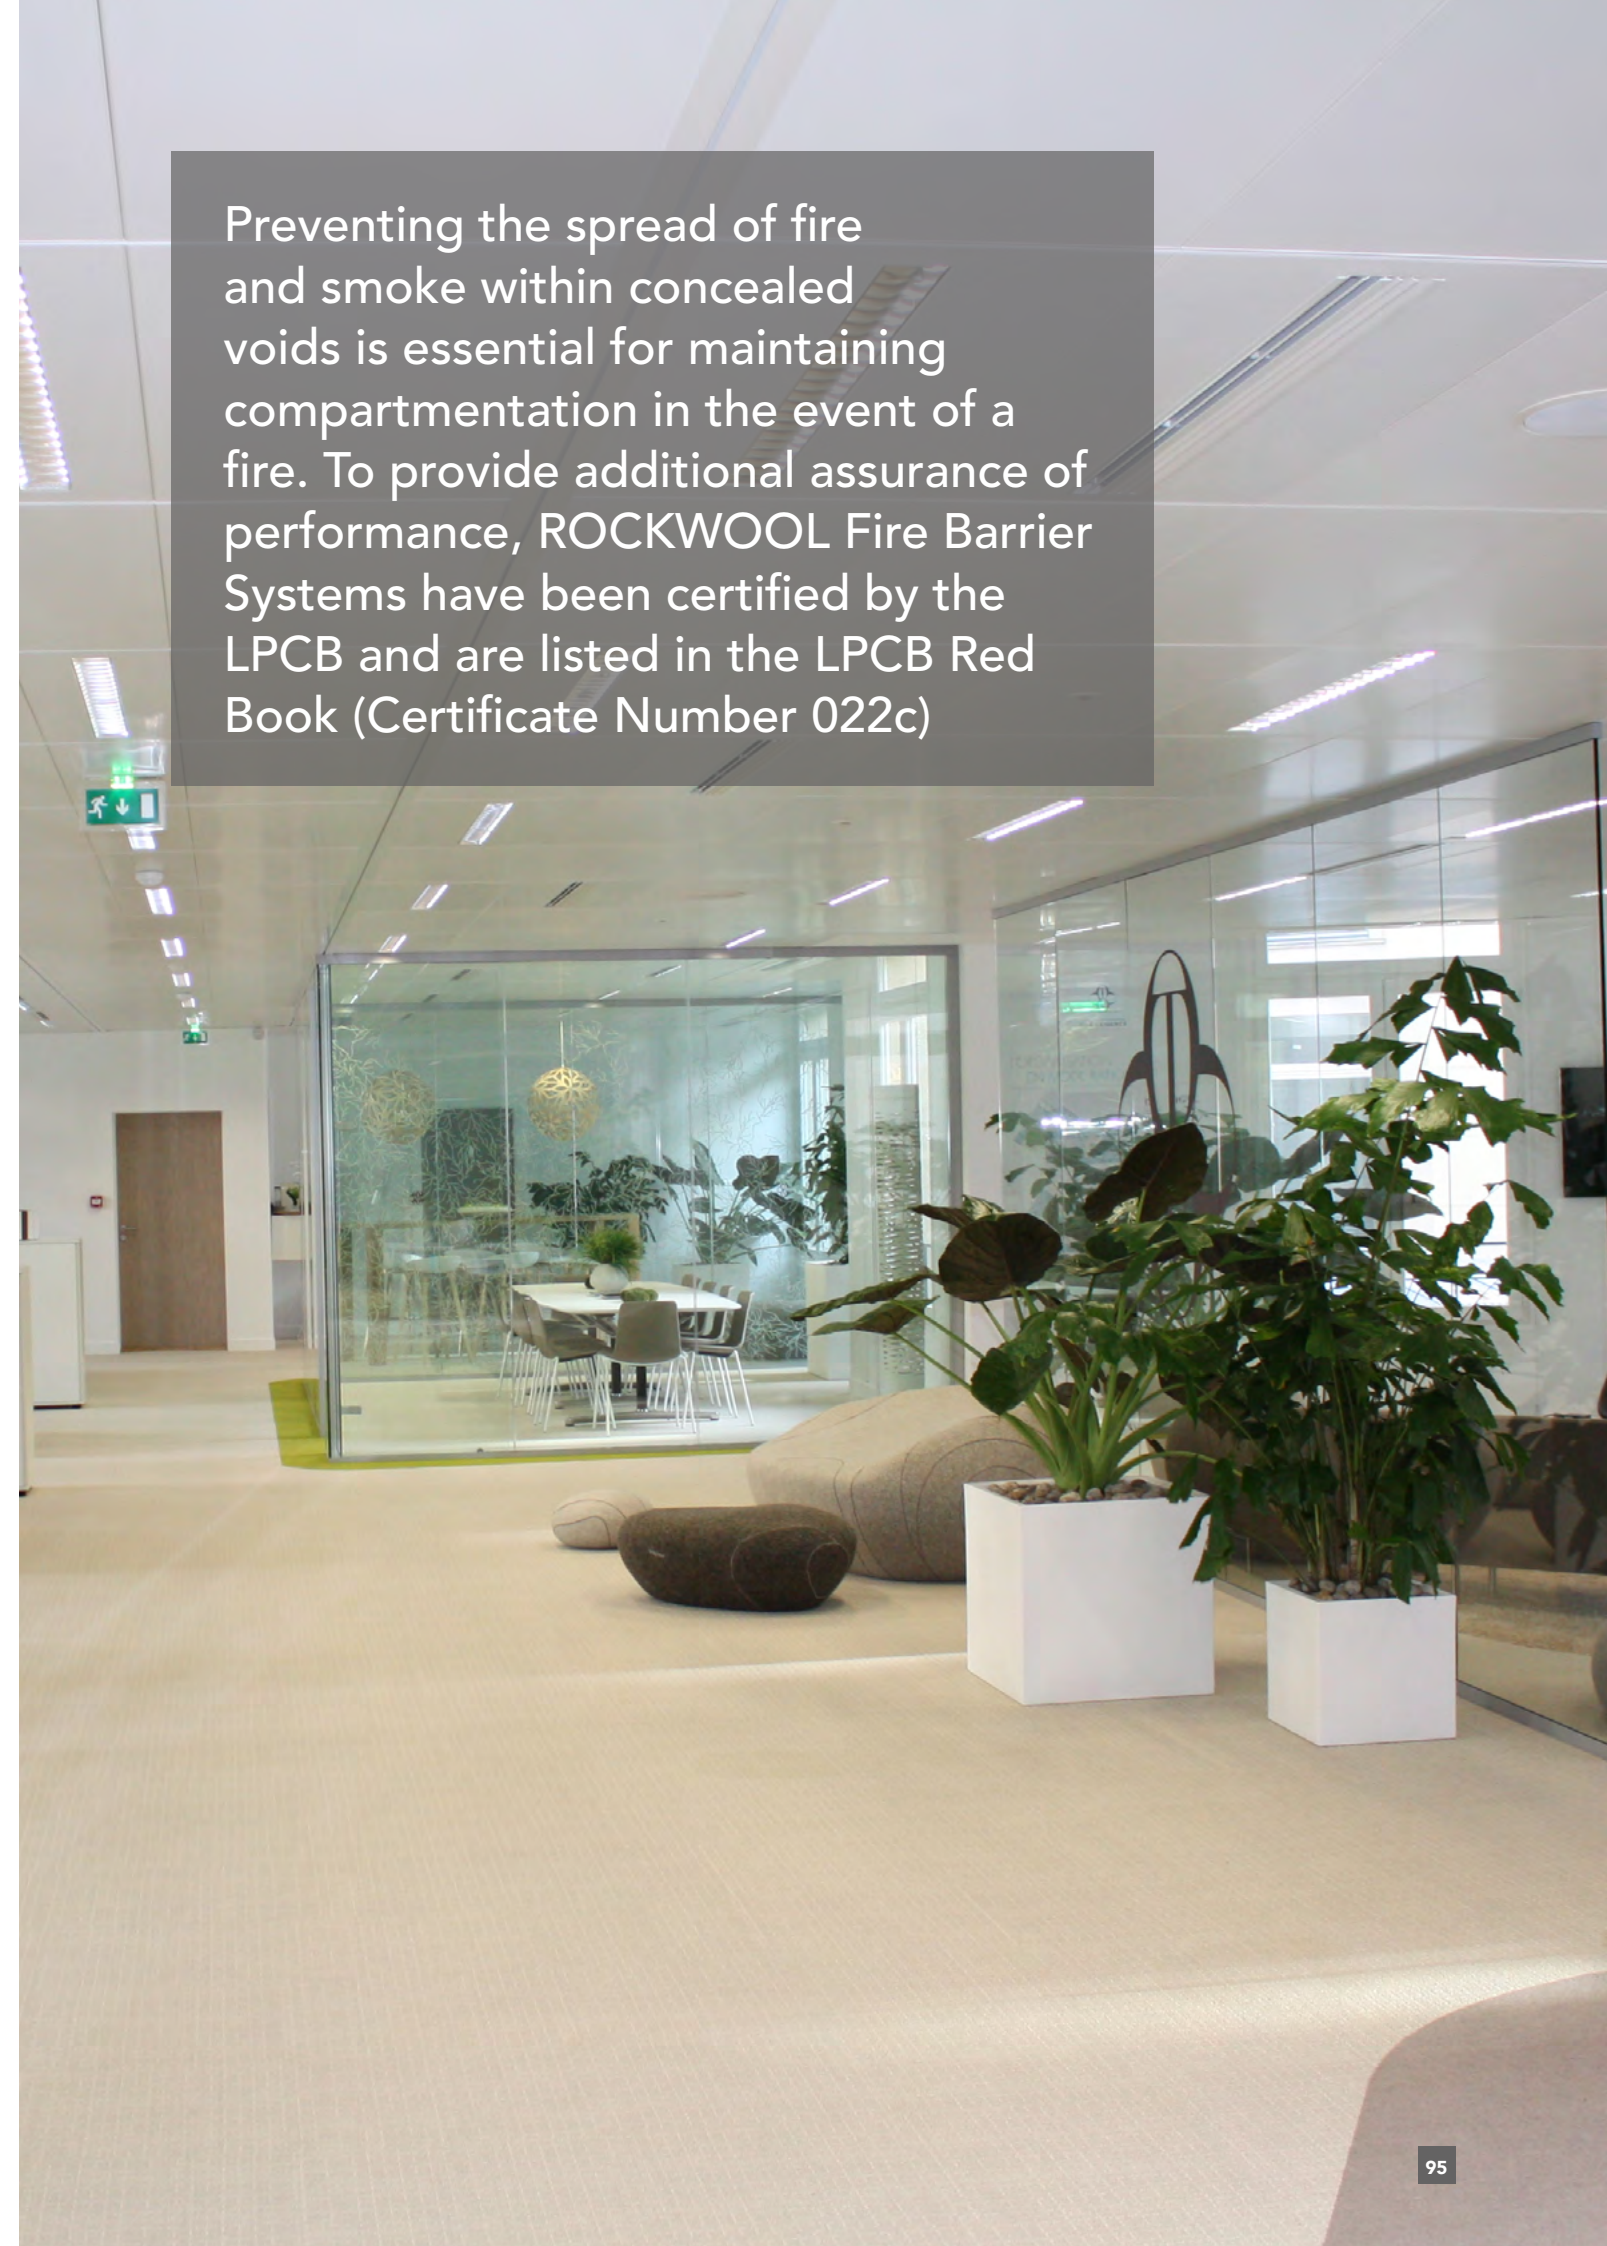



TCB & PWCB Cavity Barriers



Description

ROCKWOOL TCB & PWCB cavity barriers are manufactured from non-combustible stone wool, encapsulated within a resilient polythene sleeve which eliminates the need for weather protection during installation. The sleeves are also colour-coded to differentiate between the two products, TCB's being red and PWCB's white.

Advantages

- Easy to install
- Fire resistance up to 60 minutes (EI)
- Reduce acoustic flanking transmission
- Improves air leakage & heat loss
- Unaffected by building movement
- Suitable for vertical and horizontal applications
- Site durable & weather protected

Applications

ROCKWOOL TCB & PWCB Cavity barriers can be used in both vertical and horizontal applications, providing an effective fire, acoustic and thermal barrier within external wall cavities and separating party walls.

All ROCKWOOL Cavity barriers are 1200mm long and are designed to be compression fitted within the cavity (min 10mm-15mm compression). The barriers do not rely on the polythene flanges to hold them in place in the event of a fire. It is essential that the correct cavity barrier size is specified to suit the as-built cavity width. TCB & PWCB cavity barriers are available in a range of thicknesses to suit cavity widths (refer to the tables at the end of the data sheet for more information).

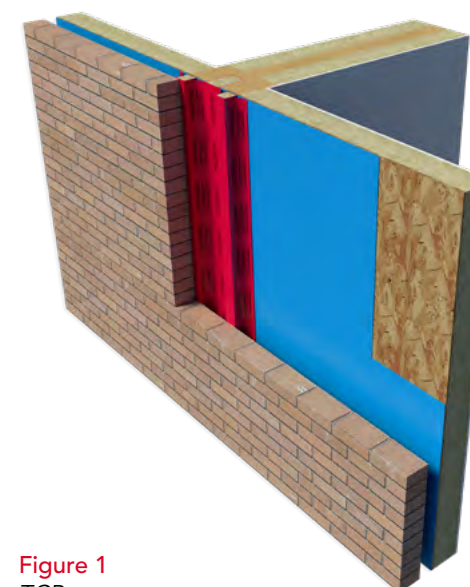


Figure 1
TCB

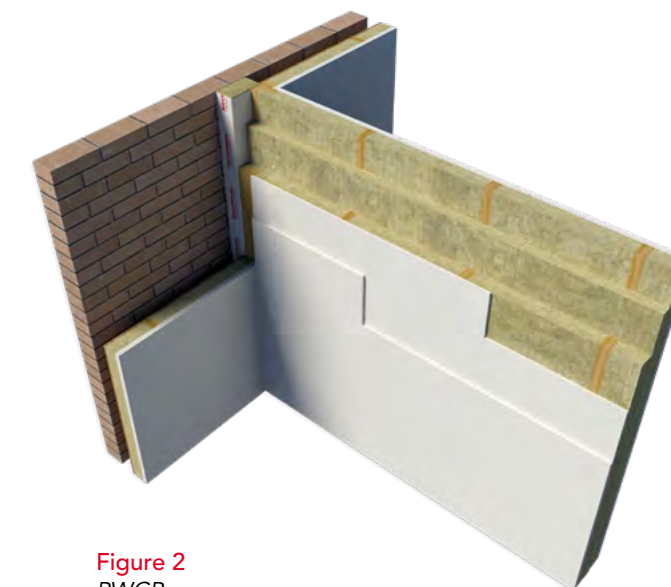


Figure 2
PWCB

Performance

Fire performance

The use of ROCKWOOL Cavity Barriers satisfies the requirements of:

- Approved Document B (Domestic) B3 - Section 6: Concealed spaces (Cavities)
- Approved Document B (Non-domestic) B3 - Section 9: Concealed spaces (Cavities)
- Scottish Technical Handbook Section 2 - Fire Section 2.4: Cavities
- NI Technical Booklet E - Section 3: Provision of cavity barriers.

Fire performance – BS 476: Part 20: 1987 (TCB & PWCB)

Table 1: PWCB

Cavity width (mm)	PWCB size (mm)	Fire resistance per construction	
		Integrity (mins)	Insulation (mins)
50-55	200x65	60	60
75-80	200x90	60	60
90-100	200x110	60	60
101-110	200x120	60	60
111-120	200x130	60	60
121-130	200x140	60	60
131-140	200x150	60	60
141-150	200x160	60	60



Table 2: TCB

Cavity width (mm)	TCB size (mm)	Fire resistance per construction	
		Timber to timber	Masonry to masonry
50 - 55	65x65	30min integrity 30min insulation	60min integrity 30min insulation
56 - 65	75x75	60min integrity 30min insulation	60min integrity 30min insulation
75 - 80	90x90	60min integrity 30min insulation	60min integrity 60min insulation
90 - 100	110x110	60min integrity 60min insulation	60min integrity 60min insulation
101 - 110	120x120	60min integrity 60min insulation	60min integrity 60min insulation
111 - 120	130x130	60min integrity 60min insulation	60min integrity 60min insulation
121 - 130	140x140	60min integrity 60min insulation	60min integrity 60min insulation
131 - 140	150x150	60min integrity 60min insulation	60min integrity 60min insulation
141 - 150	160x160	60min integrity 60min insulation	60min integrity 60min insulation

Fire performance - BS EN 1366-4: 2006 +A1 2010 (TCB only)

Table 3: Wall

Cavity size (mm)	TCB range (mm)	Masonry to masonry (mins)	Masonry to steel (mins)	Masonry to timber (mins)	Masonry to ROCKWOOL (100kg/m) (mins)
50-285	Min: 65x65 Max: 300x150	Integrity: 60 Insulation: 30	Integrity: 180 Insulation: 30	Integrity: 60 Insulation: 60	Integrity: 120 Insulation: 20

Table 4: Floor

Cavity size (mm)	TCB range (mm)	Masonry to masonry (mins)	Masonry to steel (mins)	Masonry to timber (mins)
50-285	Min: 65x65 Max: 300x150	Integrity: 120 Insulation: 90	Integrity: 120 Insulation: 20	Integrity: 60 Insulation: 20

PWCB cavity barrier

All ROCKWOOL PWCB's are 200mm wide, and are specifically designed for use at party wall/external wall cavity junctions. PWCB's also achieve the requirements for fire safety, acoustic flanking and thermal bypass in one single product.

Thermal: party wall thermal bypass

PWCB meets the requirements for an effective party wall perimeter edge seal, by restricting air flow around the exposed edges of party wall cavities.

Fire: acts as an effective cavity barrier

PWCB is non-combustible and exceeds minimum fire resistance requirements for cavity barriers as set out within the Building Regulations.

Acoustic

ROCKWOOL PWCB provides an excellent acoustic absorber by reducing flanking transmission between adjoining properties, (as required by Approved Document E and Robust details).

If installed correctly, ROCKWOOL PWCB will help minimise the thermal party wall bypass effect, by restricting air leakage and heat loss between the party wall cavity and the external cavity.

Thermal bypass effect

Approved Documents L1A & L2 A of England and Wales's Building Regulations and Section 6 of Scotland's Building standards (domestic), have recognised that considerable heat loss can occur where party wall cavities interface with external cavity walls. A key feature of a SAP calculation is that Building Regulations now assign a U-value of 0.5 W/m²K to be taken for a separating party wall cavity unless specific action is taken to improve its performance.

Ways to limit heat Loss

Perimeter edge sealing only: Thermal regulations allow a U-value of 0.20W/m²K to be claimed when effective perimeter edge sealing is used around all exposed edges of the party wall.

Perimeter edge sealing plus fully filling the party wall cavity

A U-value of zero can be claimed if the party wall cavity is fully filled with appropriate mineral wool insulation, and effective perimeter edge sealing is provided around all exposed edges.

Acoustic performance

ROCKWOOL TCB & PWCB Cavity Barriers comply with the generic description for cavity closers to prevent flanking noise transmission, along concealed cavities in both external and separating walls.

Table 5

Cavity type in party wall	U-value claim for SAP
Unfilled cavity with no effective edge sealing	0.5 W/m²K
Unfilled cavity with effective edge sealing only	0.20 W/m²K
Fully filled cavity and effective edge sealing	0.00 W/m²K



Technical Information

Standards and approvals

TCB & PWCB Cavity Barriers have been tested and assessed BS476: Part 20: 1987 and can achieve a fire resistance rating of up to 60 minutes (EI).

TCB Cavity Barriers have been tested to BS EN 1366-4: 2006 +A1 2010 using the general principles of BS EN 1363-1:2012 achieving a fire resistance rating of up to 60 minutes (EI).

TCB & PWCB Cavity Barriers are manufactured using non-combustible stone wool which is classified A1 in accordance with BS EN 13501-1: 2007 +A1 2009.

TCB Cavity Barriers are third party approved for performance and quality by the Loss Prevention Council Certification Board (LPCB) and are listed in their Fire and Security 'Red Book' – certificate no: 022b (3).

Product information

Property	Description
Length	1200mm
Width	TCB – Up to 150mm / PWCB – 200mm
Thickness	TCB – Up to 300mm / PWCB – Up to 160mm
Cavity sizes	TCB – Up to 285mm / PWCB – Up to 150mm
Reaction to fire	Euroclass A1 (ROCKWOOL Core)
Fire resistance	60 minutes (EI)

Installation

All joints between adjacent cavity barriers and intersections should be closely butted to ensure that a continuous fire seal is maintained.

In vertical applications, both flanges of the Cavity Barrier can be fixed to the inner leaf at 150mm centres, using staples or clout nails prior to compression fitting by outer cavity wall.

In horizontal applications, only the top flange of the polythene sleeve should be fixed.

Fully filled cavities in external walls

Where the external wall cavity is fully filled external cavity barriers are generally not required in the outer wall.

Partially filled cavities in external walls

Where partial fill insulation is used in the external wall, the insulation should be cut back to permit the cavity barrier to be compression fitted between the inner and outer leaves. The head of the cavity wall should be closed at eaves level with the ROCKWOOL TCB Cavity Barrier.

Specification clauses

ROCKWOOL TCB & PWCB Cavity Barriers are associated with the following NBS clauses:

F30 Accessories / sundry items for brick / block / stone walling

- 180 Cavity Closers

K10 Gypsum board dry linings / partitions / ceilings

- 530 Cavity barriers within partitions/wall linings

P10 Sundry insulation / proofing work

- 420 Sleeved mineral wool small cavity barriers

ROCKWOOL TCB Cavity Barriers have been tested to BS EN 1366-4 and are fully certified with warringtonfire certifire (CF 5861)





FIREPRO® SP Firestop System



Description

ROCKWOOL SP Firestop System comprises of both the SP Firestop Slab and SP Firestop fixing brackets. The SP Firestop Slab is a medium density stone wool slab which incorporates a foil facing to both sides. The foil facing includes cutting lines to support accurate installation.

Advantages

- Easy to install, dry fit system
- Can accommodate limited movement
- Tested to provide up to 2 hours of fire resistance
- Resists the passage of smoke – aluminium foil faced on both sides
- Suitable for cavity widths up to *1000mm

Applications

SP Firestop System may be installed horizontally or vertically and is suitable for cavity widths between 50mm and 600mm. SP Firestop can also be used horizontally in cavity widths up to 1000mm for further information please contact ROCKWOOL Technical Solutions.

SP Firestop System is suitable for:

- Masonry constructions
- Curtain walling systems
- Large cavity voids
- Rainscreen facades (vertical use only)

SP Firestop System is not suitable for use as a horizontal fire barrier in ventilated façade systems. For these applications consider using the ROCKWOOL SP Firestop VRB

Performance

Standards and approvals

SP Firestop System has been tested and assessed to BS 476: Part 20. It has also been tested to BS EN 1366-4: 2006 and classified to BS EN 13501-2.

Achieves Euroclass A1 in accordance with BS EN 13501-1.

SP Firestop System is third party approved with LPCB – certificate no. 022b.

FIREPRO® SP Firestop System has been third party accredited through Certifire.

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet. Please refer to the LUL Approved Product Register at www.LU-apr.co.uk for specific details. LUL Ref: 2244.

Fire performance

The SP Firestop System can achieve a fire resistance rating of up to 2 hours in voids of up to 600mm.

Product	Wall	Floor	Cavity (mm)	Test standard
SP60 (standard)	EI60	EI60	400	BS 476 Part 20
SP120 (standard)	EI120	EI120	400	BS 476 Part 20
Fire performance with +/- 3% Movement				
SP60 (standard)		EI60	300	BS EN 1366-4
SP120 (standard)		EI120	300	BS EN 1366-4
SP Plus (with XL bracket)	EI120	EI120	600	BS EN 1366-4
SP Plus (with XL bracket)		EI60	1000	BS EN 1366-4



Movement testing



SP Firestop Slab has been tested with movement applied in accordance with the provisions set out in Annex B of BS EN 1366-4: 2006. SP60 and SP120 can accommodate +/- 3% movement in cavities up to 300mm

Masonry support bracket penetration

The SP Firestop System has been tested in conjunction with the AnconOptima Masonry Support System where the Masonry Support System penetrated the SP 60 Firestop Slab.

For further information on the use of masonry support brackets with the SP Firestop System please contact ROCKWOOL Technical Solutions.

Product	Bracket penetration	Fire resistance	Cavity (mm)	Test standard
SP60 Firestop Slab	50%	EI60	400	BS EN 1366-4
SP60 Firestop Slab	100%	EI60	400	BS EN 1366-4

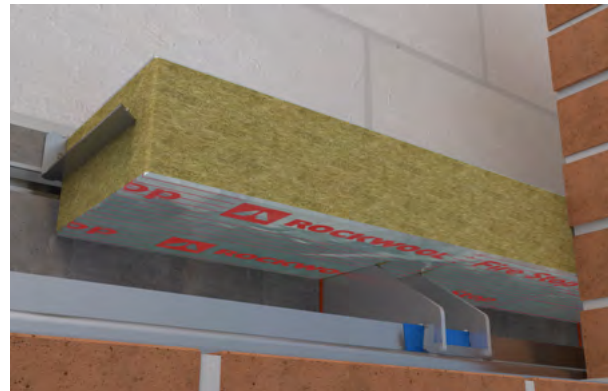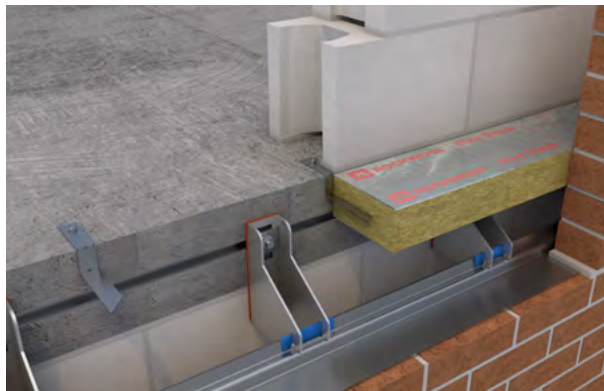

Acoustic performance

ROCKWOOL products have excellent acoustic properties and can significantly reduce the levels of airborne sound transmission through wall and floor cavities. For further information please contact ROCKWOOL Technical Support.

Product information

Property	Description
Length	1000mm
Width	650mm
Thickness	75 & 90mm
Fire resistance	Up to 2 hours

Handling

ROCKWOOL SP Firestop Slabs are light and easy to handle. They are supplied in compression-wrapped polyethylene, which will provide short-term protection.

For long-term storage they must be protected by a waterproof covering.

Installation

ROCKWOOL SP Firestop Slabs are designed for cutting on site with a sharp knife or saw and a straight edge. The cavity to be fire stopped should be measured and the ROCKWOOL SP Firestop Slab cut to suit this dimension, using one piece only per gap width - see Figures 4 and 5.

For easy compression fitting and to accommodate the fixing pattern, cutting should be along the 1000mm length as indicated in figure 1.

The SP Fixing Brackets are then re-profiled by hand and cut as necessary to allow at least 75% penetration of the fire stop material – see Figures 2 and 3.

They should be placed as shown in the diagrams, or fixed by other suitable mechanical means.


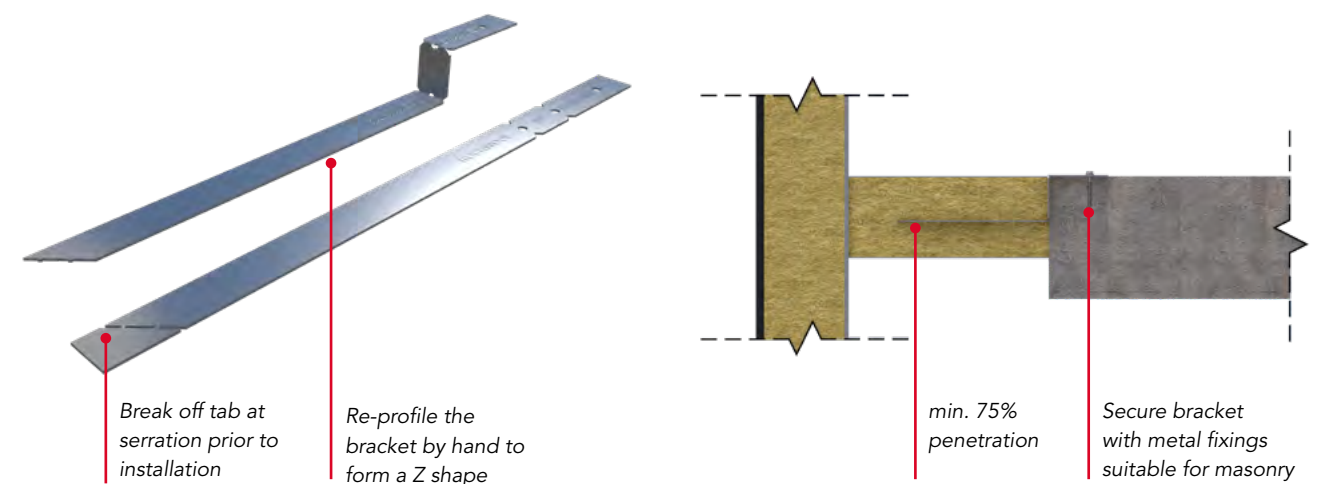


Figure 2
SP Firestop Fixing Bracket

Figure 3
Sectional view of Firestop Slab and Bracket

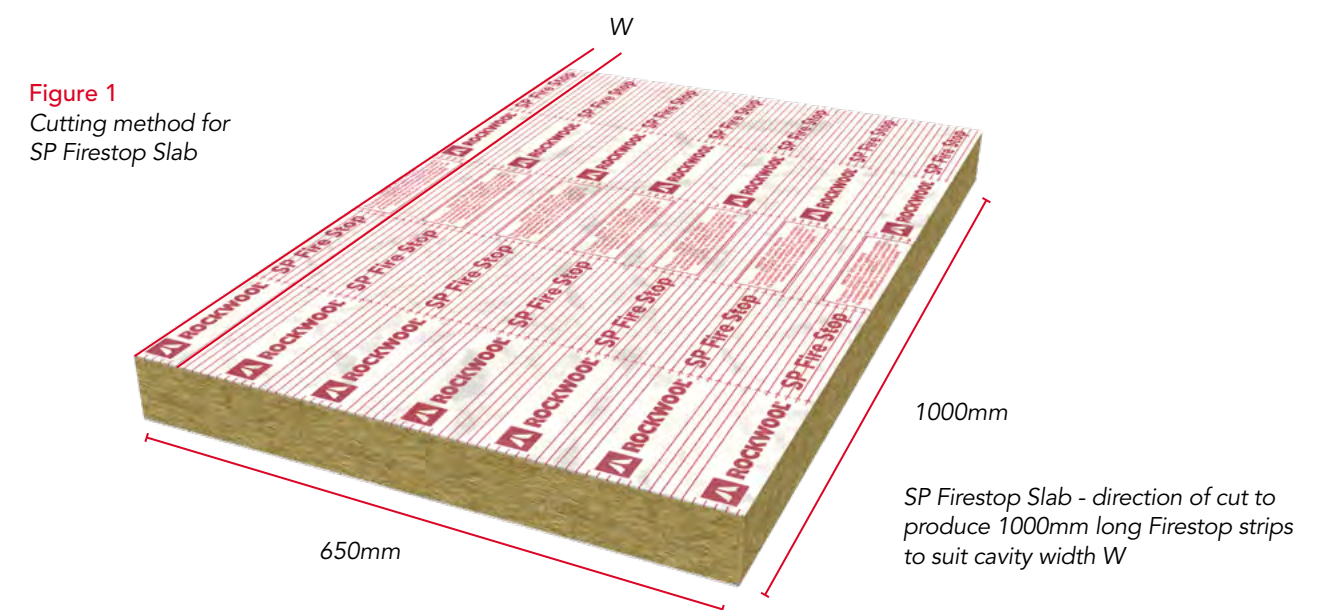

Fire stopping: Section 2 - Cavity barriers & cavity firestops

Fixing within cladding & curtain walling systems

1. Cut the ROCKWOOL SP Firestop Slab to suit the *cavity size, allowing for additional compression of up to 10mm.
2. The ROCKWOOL SP60 or SP120 Firestop Slab is impaled onto the SP Fixing Brackets at the rate of 2 per 1000mm length, fixed at 500mm \pm 10mm centres as shown in Figure 4. The SP Fixing Brackets should be placed 250mm \pm 10mm in from each end of the ROCKWOOL SP Firestop Slab.
3. The product should then be fitted securely into the void and tightly butted to the adjacent ROCKWOOL SP Firestop Slab.
4. Once the ROCKWOOL SP Firestop Slab has been accurately fitted, the SP Fixing Brackets must then be fitted to the edge of the concrete floor slab with metal fixings suitable for masonry.

Fixing into masonry wall cavities

1. Cut the ROCKWOOL SP Firestop Slab to suit the *cavity size ensuring a tight fit.
2. After suitably re-profiling the SP Fixing Brackets they can be built into the bed joints of the internal leaf at 500mm \pm 10mm centres. Alternatively the SP Fixing Brackets may be re-profiled by hand into an 'L' shape and mechanically fixed to the face of the inner leaf.
3. The ROCKWOOL SP Firestop Slab is then impaled onto the SP Fixing Bracket after the next lift of inner leaf masonry.
4. Work on both leaves can then be continued and must include either a vertical damp proof course (vertical installation) or a cavity tray (horizontal installation) installed over the SP Firestop Slab as shown in Figure 5.

*For cavity widths of 250mm or more, joints between adjacent lengths of SP Firestop Slab should be sealed on the top surface with aluminium foil tape.

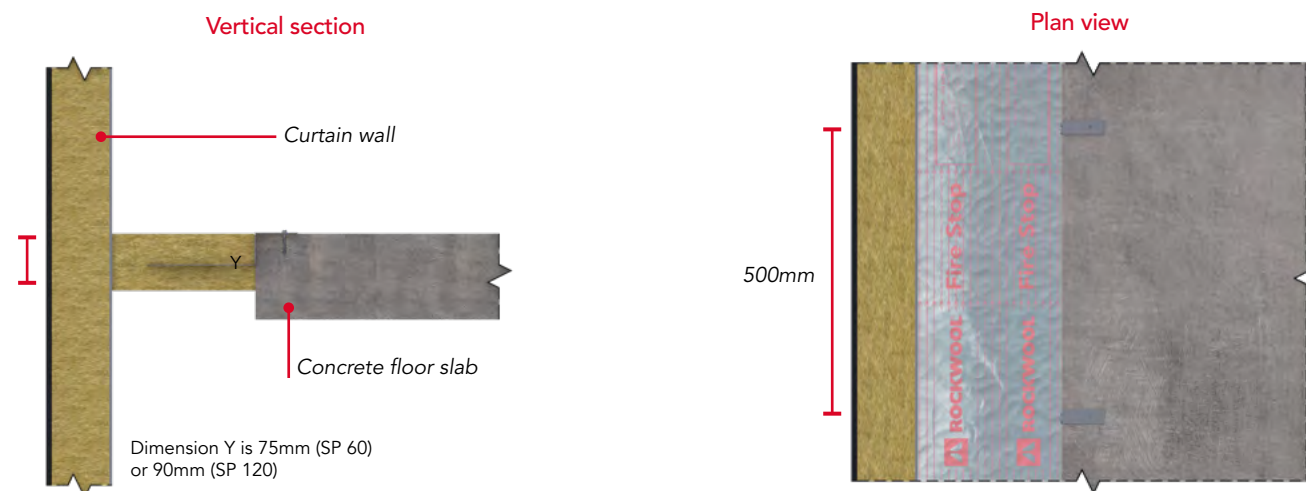


Figure 4
ROCKWOOL SP Firestop Slab between floor and curtain wall

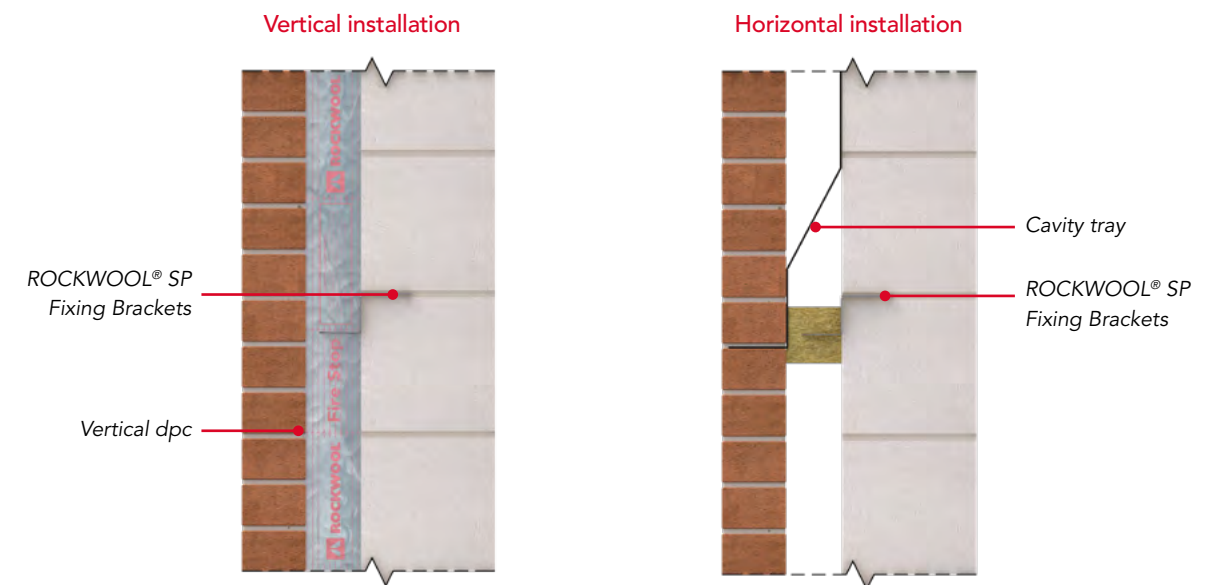


Figure 5
ROCKWOOL SP Firestop Slab between masonry leaves

Ancillaries

SP Firestop Fixing Brackets

Bracket type	Cavity size (up to mm)	Pieces / pack
SP/S	100	50
SP/L	400	50
SP/XL	600	50

ROCKWOOL SP Fixing Brackets are supplied in three standard sizes; SP/S (small), SP/L (large) and *SP/XL for cavity widths up to 600mm. The brackets are supplied in cardboard boxes of 50 pieces, flat packed and designed to be easily re-profiled by hand on site.

* SP/XL brackets are designed for use with SP Firestop Plus Slab for 2 hours fire resistance in cavities up to 600mm.

Brackets are supplied in cardboard boxes, flat packed, and are designed to be easily re-profiled by hand on site. The SP Fixing Brackets should be cut on site as necessary to allow at least 75% penetration of the Firestop.

*In order to comply with the fire test certification, only ROCKWOOL SP Fixing Brackets must be used to install the product.

Specification clauses

The SP Firestop System is associated with the following NBS Clauses:

F30 Accessories / sundry items for brick / block stone walling

- 180 Cavity Closers

P10 Sundry insulation / proofing work

- 432 cavity Barriers

P12 Fire stopping systems

- 360 Mineral Wool Rigid Batts



Section 3: Linear joint seals

Sealing construction joints between fire resistance elements within a compartment is vital. Products and systems used in this application should achieve the same level of fire resistance as the compartment elements, whilst also maintaining integrity during the expansion and contraction (movement) of construction materials.

ROCKWOOL provide a range of tested products that are designed for sealing linear joints between different construction materials, that can also accommodate movement where required. Within our product range there are products suitable for:

- Fire stopping junctions between compartments walls and floors or roof decks
- Fire stopping expansion joints within the construction
- Sealing narrow joints between different substrates



Core products



Useful documents and standards

- ASFP Technical Guidance Document – TGD 17: Code of practice for the installation and inspection of fire stopping systems in buildings
- ASFP Red Book: Fire stopping and penetration seals for the construction industry
- ASFP: Ensuring best practice for passive fire protection in buildings
- ASFP: On-site guide to installing fire stopping
- BS 476-20: Fire test on building materials and structures. Method for determination of the fire resistance of elements of construction
- BS EN 1366-4: Fire resistance test for service installations. Linear joint seals
- BS EN 1363-1: Fire resistance tests. General Requirements
- BS EN 13501-2: Fire classification of construction products and building elements. Classification using test data from resistance to fire tests, excluding ventilation services.
- BS EN 13501-2: Fire classification of construction products and building elements. Classification using test data from resistance to fire tests, excluding ventilation services.

ASFP (Association for Specialist Fire Protection) guidance documents can be sourced at www.asfp.org.uk



FIREPRO® SoftSeal System



Description

Part of the ROCKWOOL FIREPRO® range, FIREPRO® SoftSeal System incorporates a product specifically designed to accommodate movement within buildings in linear joint seals and penetration seals.

Advantages

- Suitable for penetration and linear joints
- Acoustically absorbent
- CE Marked
- Easy to handle and install
- Both vertical and horizontal joint applications
- Tested for durability to current EU guidelines
- Supplied pre-coated

Applications

The FIREPRO® SoftSeal System has been specifically developed for two key applications areas:



Figure 1
Penetration seals



Figure 2
Linear joint seals

Penetration seals

Description

As part of the comprehensive ROCKWOOL FIREPRO® range of fire protection products, FIREPRO® SoftSeal System incorporates a product specifically designed to apply to penetration seals within buildings, where the design needs to accommodate movement in the services.

The FIREPRO® SoftSeal System can be installed into apertures within masonry or drywall partitions as a standalone seal for openings up to 1000mm x 1000mm or as part of a larger ROCKWOOL Ablative Coated Batt seal (2 layers) to accommodate movement of services. *

A FIREPRO® SoftSeal Coated Strip comprises a low-density stone wool SoftSeal Lamella Strip, pre-coated with SoftSeal Flexible Coating.

The FIREPRO® SoftSeal Coated Strip is supplied in strips 1200mm x 200mm x 100mm.

The FIREPRO® SoftSeal flexible Coating is also available in 5L, 10L and 20L tubs to enable site repairs to FIREPRO® SoftSeal Coated Strips and FIREPRO® SoftSeal Linear Joint Seals, that may have been damaged during installation.

To complement the FIREPRO® SoftSeal Coated Strip, ROCKWOOL also supplies FIREPRO® SoftSeal High Expansion Intumescent Sealant (310ml) and FIREPRO® SoftSeal Flexible Acoustic Intumescent Sealant (310ml).

FIREPRO® SoftSeal Coated Strip is intended to reinstate the fire resistance, acoustic and air seal performances of concrete floors, masonry walls and dry wall systems when voids have been created for the passage of services. This includes pipes made of steel, cast iron, copper, polypropylene (PP), high density polythene (HDPE), PVC and ABS along with all sheathed cables up to 80mm and supported cable bundles up to 100mm.

*Higher levels of service movement may be accommodated by installing the product under higher compression rates, please contact ROCKWOOL Technical Solutions for guidance.



Performance

Fire performance

ROCKWOOL FIREPRO® SoftSeal Coated Strip has been tested to the dedicated fire resistance standard for penetration seals BS EN1366-3.

Table 1: Fire performance - Linear joint seals

Max seal width (mm)	Min seal depth (mm)	Integrity (mins)	Insulation (mins)
350	100	120	120
375	100	120	120
200	100	240	180
150	100	240	180

Note: The fire performances quoted in table 1 are subject to varying application techniques and movement levels. For further information please contact ROCKWOOL Technical Support

Standard details, showing the full scope of fire performance, are available from the ROCKWOOL Technical Solutions Team on 01656 862621.

FIREPRO® SoftSeal Coated Strip fire resistance tests were conducted using FIREPRO® SoftSeal Flexible Acoustic Intumescent Sealant and/or FIREPRO® SoftSeal High Expansion Intumescent Sealant.

For vertical applications the FIREPRO® SoftSeal Coated Strips are coated on both sides.

Movement

As part of the testing to BS EN 1366-4, FIREPRO® SoftSeal was assessed for its movement capabilities, prior to conducting the fire test. The product was tested to accommodate movement (expansion and contraction) of +/-15%*.

*See ROCKWOOL standard details for specific Ablative Coated Batt sizes.

Acoustic performance

Tested to EN 10140 with the following results:

- Rw 30 dB: When installed with 100mm thick SoftSeal Batt
- Dn,e,w 40 dB: When installed with 100mm thick SoftSeal Batt

Water permeability

- Tested to EN 1027 - No leakage observed up to 300Pa.

Air permeability

- Tested to EN 1026 up to 600Pa.
- Leakage at 50Pa - 0.1/1.4 m³/m²/h.

Technical information

Standards and approvals

FIREPRO® SoftSeal has been tested and assessed to BS EN1366-3 2009 and classified to EN 13501-2. FIREPRO® SoftSeal Coated Strip System has been CE marked against ETAG026-2.

Product information

Property	Description
Length	1200mm
Width	200mm
Thickness	100mm
Fire resistance	Up to 2 hours
Coating	2 sides
Density	80kg/m³
Movement	+/- 15%

Installation

1. Measure the height of the aperture to be sealed.
2. Cut the FIREPRO® SoftSeal Coated Strips 15% bigger than the height of the void to be filled, so when installed they are under compression.
3. Ensure substrate is clean and free of dust and debris.
4. Apply a bead of FIREPRO® SoftSeal Acoustic Intumescent Sealant around the internal edges of the aperture.
5. Install the FIREPRO® SoftSeal Coated Strips horizontally, so that the lamellas are running horizontally.
6. Apply a bead of FIREPRO® SoftSeal Acoustic Intumescent Sealant to butt joints between different sections of SoftSeal Coated Strip and around services.
7. FIREPRO® SoftSeal High Expansion Intumescent Sealant shall be used around plastic pipes in accordance with ROCKWOOL standard details.
8. Apply FIREPRO® SoftSeal Flexible Coating to the face of all joints between SoftSeal Coated Strip and substrate/ Ablative Coated Batt.

Note: Ensure adequate space above and below services to accommodate the FIREPRO® SoftSeal product, for the movement levels required.



Linear joint seals

Description

As part of the comprehensive FIREPRO® range of fire protection products, ROCKWOOL FIREPRO® SoftSeal System incorporates a product specifically designed to form a linear joint seal within buildings, where the design needs to accommodate movement in the joint.

It may be installed horizontally or vertically and is suitable for linear joint widths up to 300mm*. FIREPRO® SoftSeal Linear Joint Seal can also be used as a 'head-of-wall' barrier to extend the fire resistance and acoustic performances of masonry walls that finish at suspended ceiling height, up to the concrete soffit above. FIREPRO® SoftSeal Linear Joint Seal can be used in conjunction with ROCKWOOL Ablative Coated Batt for head-of-wall applications.

A FIREPRO® SoftSeal Linear Joint seal comprises a low-density stone wool FIREPRO® SoftSeal batt, pre-coated with FIREPRO® SoftSeal Flexible Coating. Depending on the application, FIREPRO® SoftSeal Linear Joint Seal can be supplied on either one or both sides. (Single Sided for Horizontal Applications. Double sided for Vertical Applications).

The FIREPRO® SoftSeal Flexible Coating is also available in 5L, 10L and 20L tubs to enable site repairs to FIREPRO® SoftSeal Coated Strips and FIREPRO® SoftSeal Linear Joint Seals, that may have been damaged during installation.

The FIREPRO® SoftSeal Linear Joint Seal is supplied in strips 1200mm x 200mm x 100mm.

*Linear Joints over 300mm wide can be accommodated, with the addition of steel Z brackets.
For further information and advice on sizes or applications, please contact Rockwool Technical Solutions Team on 01656 862621.

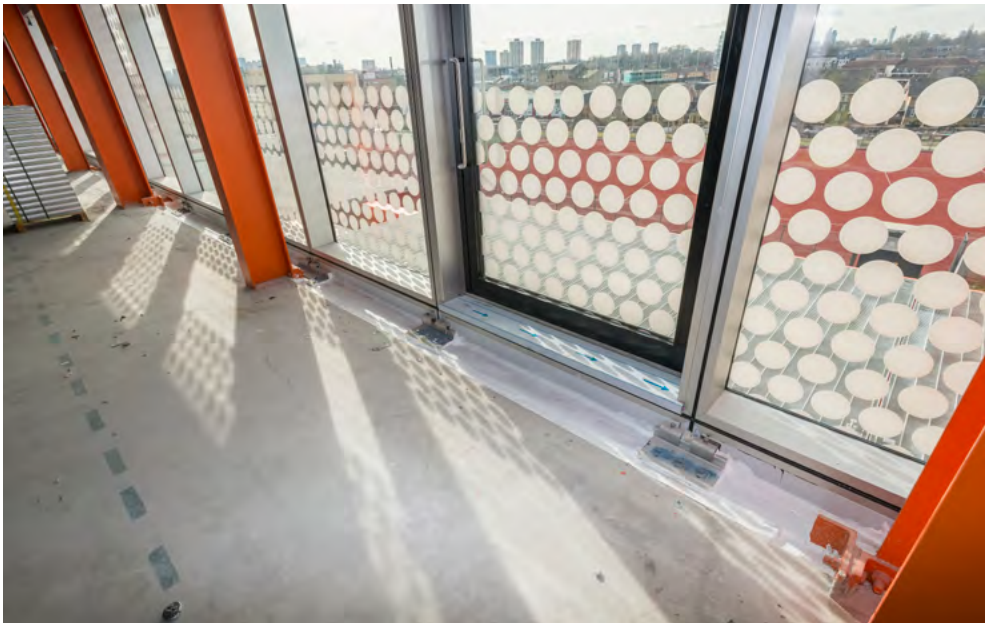


Figure 3
SoftSeal installed as a linear joint seal

Performance

Fire performance

ROCKWOOL FIREPRO® SoftSeal Linear Joint Seal has been tested to the dedicated fire resistance standard for linear joint seals BS EN1366-4 and shown to provide up to 4 hours fire performance (E240 & EI80).

Movement

As part of the testing to BS EN 1366-4, FIREPRO® SoftSeal was assessed for its movement capabilities, prior to conducting the fire test. The product was tested to accommodate movement (expansion and contraction) of +/-25%.

Acoustics

Tested to EN 10140 based on two thicknesses with the following results:

- Rw 30 dB: When installed with 100mm thick SoftSeal Batt
- Rw 39 dB: When installed with 200mm thick SoftSeal Batt
- Dn,e,w 40 dB: When installed with 100mm thick SoftSeal Batt
- Dn,e,w 49 dB: When installed with 200mm thick SoftSeal Batt

Water permeability

Tested to EN 1027 - No leakage observed up to 300Pa.

Air permeability

- Tested to EN 1026 up to 600Pa.
- Leakage at 50Pa - 0.1/1.4 m³/m²/h.

Technical information

Standards and approvals

FIREPRO® SoftSeal has been tested and assessed to BS EN1366-4: 2006 + A1: 2010 and classified to EN 13501-2. FIREPRO® SoftSeal Linear Joint Seal system has been CE marked against ETAG026-3.

Product information

Property	Description
Length	1200mm
Width	200mm
Thickness	100mm
Fire resistance	Up to 4 hours
Coating	1 side
Density	80kg/m³
Movement	+/- 25%

Installation

1. Measure the width of the linear joint to be sealed.
2. Cut the FIREPRO® SoftSeal Coated Strips up to 25% bigger than the joint width (dependent on movement required), so when installed they are under compression.
3. Ensure substrate is clean and free of dust and debris.
4. Install the FIREPRO® SoftSeal Linear Joint Seal with the coating on the top surface.
5. Apply FIREPRO® SoftSeal Flexible Coating to the face of all joints between the seal and the substrate, overlapping by 20mm.
6. Apply FIREPRO® SoftSeal Flexible Coating to the faces of all butt joints between pieces of Soft Seal Linear Joint Seal.

Specification clauses

FIREPRO® SoftSeal System is associated with the following NBS clauses:

P12 Fire stopping systems

- 160 – Linear gap sealing



Linear & Trapezoidal Firestop System



Description

Linear and Trapezoidal Firestop products are made from dense, moisture resistant stone wool, allowing adequate compression yet retaining the necessary lateral stiffness for ease of installation.

The Linear and Trapezoidal Firestop System can be manufactured to suit a wide range of steel profile dimensions.

Advantages

- Up to 4 hours fire resistance
- Suitable for walls ranging from 400kg/m³
- Manufactured for a wide range of profiles
- Easy installation

All Firestop products are supplied in standard lengths of 1m.

Linear Firestop 2A

- Rectangular strips (installed under min. 5% compression)
- Thicknesses: 12.5, 20, 30, 40, 50, 60, 70, 80, 90, 100mm
- Widths: 100, 150, 200, 300, 400mm
- Fire resistance: Up to 4 hours

Trapezoidal Firestop 2B

- Trapezoidal strips (tight fit required)

Available for all profiled decks. Deck profile to be named at time of order, e.g. Ribdeck 60, Alphalok etc.

Dovetail Infill Firestop Strip

- Supplied as narrow rectangular strips for pinched installation into nominated dovetail shaped deck profiles; e.g. Holorib, Quickspan, Q51

Applications

Linear and Trapezoidal Firestop Systems have been developed to provide up to 4 hours firestopping at the junctions of compartment walls and floors.

Solutions illustrated are for masonry walls with a density of at least 400kg/m³ and include both fire integrity and insulation criteria for concrete decks, composite decks and simple profiled sheeting.



Figure 1
Linear Firestop 2A



Figure 2
Linear Firestop 2A and 2B



Figure 3
Linear Firestop 2A and Dovetail Infill Strip

Performance

Fire performance

All fire ratings apply to gaps over walls constructed of dense aggregate blocks, lightweight aggregate concrete, clay bricks or concrete blocks with a minimum density of 400kg/m³

For further information on dry wall systems, please contact ROCKWOOL Technical Support.

Fire resistance includes integrity and insulation criteria to BS 476: Part 20: 1987.

Min. wall thickness/ fire stop width	Fire resistance (integrity and insulation)
100mm	2 hours
150mm	3 hours
200mm	4 hours

Note: Stated performance assumes fire resistance of supporting wall is no less than fire stop.

Chemical

ROCKWOOL stone wool insulation has a basaltic composition in which the refractory oxide components have been enhanced for stability at high temperatures. Stone wool is chemically inert. An aqueous extract of the wool is neutral (pH7) or slightly alkaline.

Biological

Linear and Trapezoidal Firestop Systems are completely rot proof, do not offer sustenance to vermin and do not encourage the growth of fungi, moulds and bacteria.

Compatibility

ROCKWOOL products are compatible with all normal building and constructional materials with which they are likely to come into contact.

Durability

ROCKWOOL materials will perform effectively throughout the lifetime of the building with a minimum of maintenance (unless disturbed).



Technical information

Standards and approvals

Linear and Trapezoidal Firestops have been tested to BS 476: Part 20: 1987 and can provide up to 4 hours fire protection.

Achieves Euroclass A1 in accordance with BS EN 13501-1.

Linear and Trapezoidal Firestops are third party approved with LPCB – certificate no. 022b.

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet. Please refer to the LUL Approved Product Register at www.LU-apr.co.uk for specific details.

Product information

Property	Description
Length	1000mm
Width	Up to 400mm
Thickness	12.5 – 100mm
Deck profiles	Various
Density	110kg/m ³
Fire resistance	Up to 4 hours

Handling / storage

Linear and Trapezoidal Firestop materials are light and easy to handle and should be cut using a sharp bladed knife. Store in dry conditions.

Maintenance

Once installed, Linear and Trapezoidal Firestop materials will need no maintenance unless disturbed.

Other information

For areas such as clean rooms, Firestop systems are available totally enclosed in shrink wrap.

Installation

The following installation requirements must be met in order to reliably achieve the stated fire resistances.

- Linear Firestop 2A must be fitted as rectangular pieces, tightly butt jointed and compressed by at least 5% in thickness.
- Up to 3 layers may be used. Single layer firestopping will always be preferred, with multi-layer methods limited to those occasions where building tolerances demand practicality. All layers should be installed simultaneously. The height of void should not exceed the width of the Firestop.
- Gaps associated with perimeter floor slab/wall fire stopping should be achieved using ROCKWOOL SP Firestop Systems.

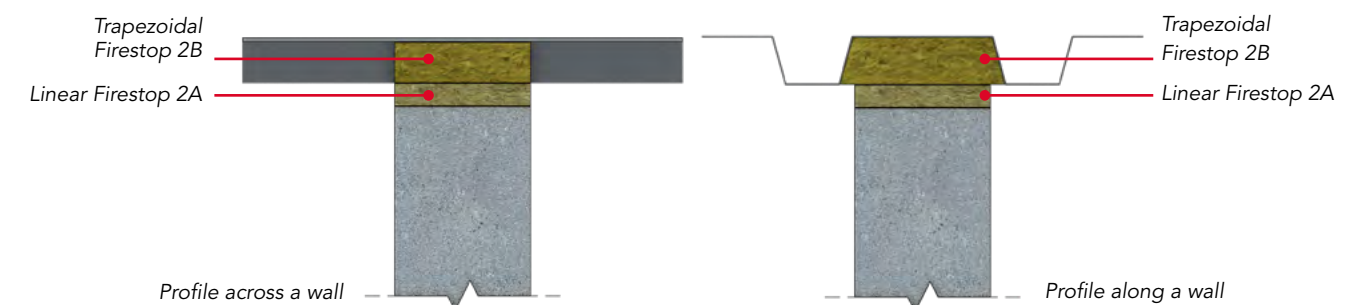


Figure 4
Profiled metal deck over blockwork wall

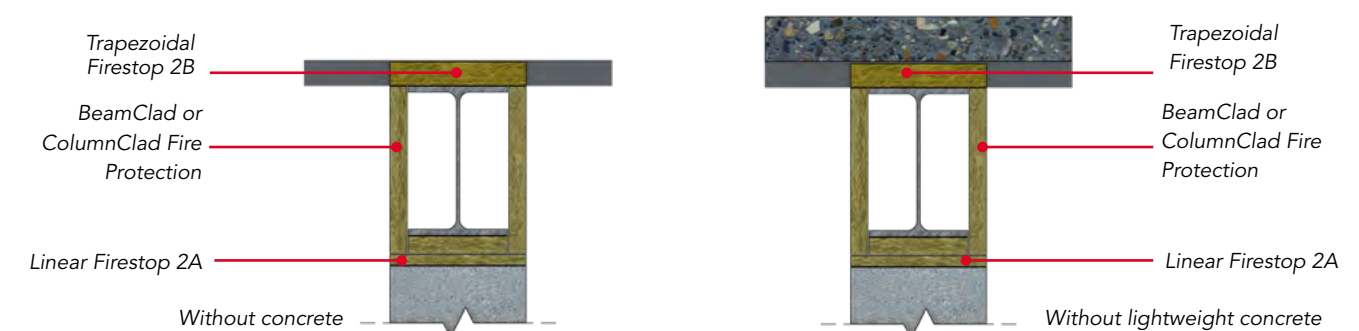


Figure 5
Profiled metal deck with/without concrete over a universal beam

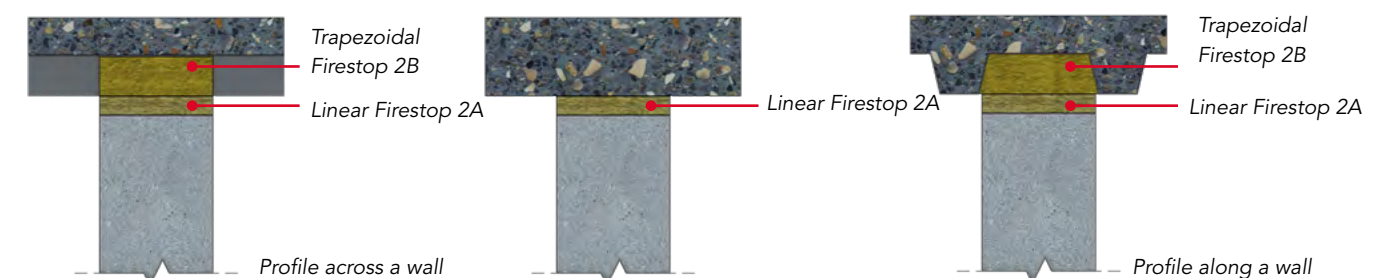


Figure 6
With / without profiled metal deck under a lightweight concrete slab



Fire stopping: Section 3 - Linear joint seals

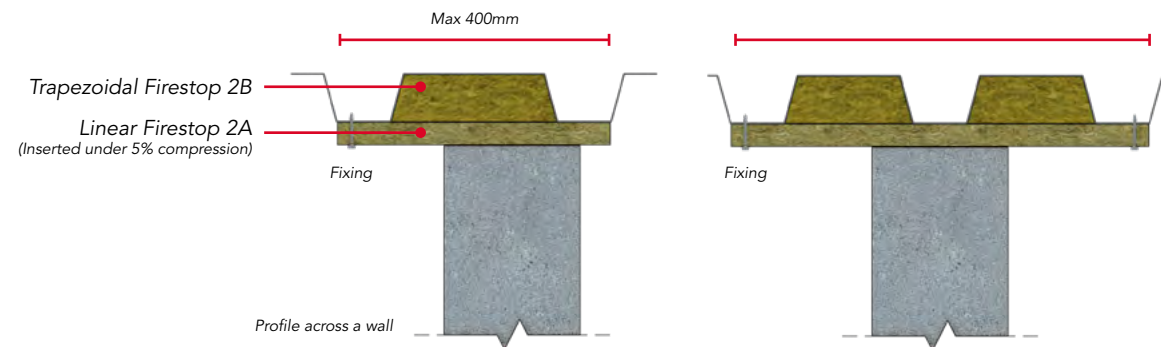


Figure 7a & 7b

Metal profiles parallel but offset from the wall line

Fig 7a: The 'overhang' of the Linear Firestop 2A should be supported with steel self-tapping screws or 'hammer fix' anchors into deck / concrete soffit at 350mm maximum centres (minimum of 3 fixings per 1m length of fire stop).

Fig 7b: Where the Linear Firestop 2A is required to be fixed to the deck at distances in excess of 400mm, turn the 1m length of fire stop 90° and cut to required size to suit profile spacing. In such cases, secure each length of fire stop to the soffit using at least 2 fixings at both ends.

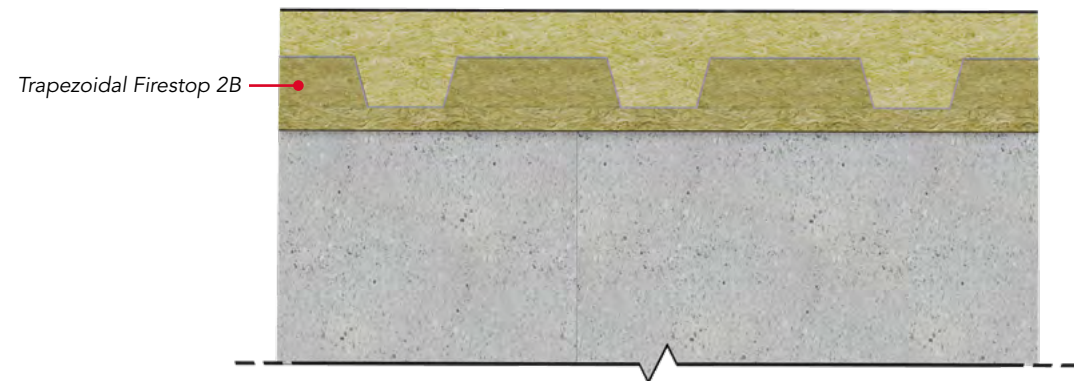


Figure 8

ROCKWOOL Insulated flat roof deck with profiles perpendicular to the wall line

When fire stopping between the head of a fire resistant wall and the underside of a perforated roof deck insulated with ROCKWOOL HARDROCK® Multi-Fix [DD] flat roof insulation, it should be considered best practice to fill both the upper and lower deck profiles with Trapezoidal Firestop 2B products. In such cases, when placing an order it should be noted that the sizes of the two profiles may differ.

In cases where combustible thermal insulation passes over the head of a fire resisting wall, guidance on maintaining fire compartmentation is provided in Approved Document B (Volume 2, Section B3) of The England and Wales Building Regulations 2000 (2006 edition). To reduce the risk of fire spreading to an adjacent compartment in such cases, it may be necessary to extend the wall through the roof line or introduce a 'protected zone' 1500mm either side of the fire resisting wall.

Specification clauses

Linear and Trapezoidal Firestops are associated with the following NBS clauses:

F30 Accessories/sundry items for brick/block/stone walling

- 670 Tops of non-loadbearing walls

G30 Metal profiled sheet decking

- 240 Fire resisting profile fillers



A wide range of linear and trapezoidal firestop sizes are available to suit most metal deck profiles. Please contact the ROCKWOOL Customer Support Centre for more information



FIREPRO® Intumescent Expansion Joint Seal



Description

Intumescent Expansion Joint Seal is a compressible strip formed by shrink wrapping a graphite based intumescent polymer to both faces of a ROCKWOOL core.

Intumescent Expansion Joint Seal is supplied in one metre lengths to suit the joint to be filled. The width of the product is dependent on the fire rating required (see Table 1).

Advantages

- Up to 4 hours fire resistance
- Easy to install compression fit
- Dry fix solution
- Water resistant

Applications

FIREPRO® Intumescent Expansion Joint Seal is installed by simply compressing by hand and then pushing into the joint. Adjacent pieces of the product are tightly butted together. There is no need to use any adhesives or intumescent sealant in conjunction with the product.

In a fire, the graphite based intumescent material swells to form a hard char, which prevents the passage of fire and smoke through the joint.

Intumescent Expansion Joint is suitable for use in:

- Blockwork cavities
- Curtain wall/Concrete slab interfaces
- Expansion joints
- Structural joints


Performance

Fire performance

ROCKWOOL Intumescent Expansion Joints to provide up to 4 hours rating for linear joints in walls & floors.

Table 1: Fire resistance performance

Seal depth 'X' (mm) [thickness of seal in brackets]	Gap width 'Y' (mm)			
	10-14	15-30	31-50	51-75
	Integrity rating (minutes)			
25 [x16] single	120	NA	NA	NA
50 [x16] single	240	NA	NA	NA
25 [x32] double	NA	120	NA	NA
50 [x32] double	NA	240	NA	NA
50 [x52] double	NA	NA	240	NA
50 [x78] double	NA	NA	NA	240

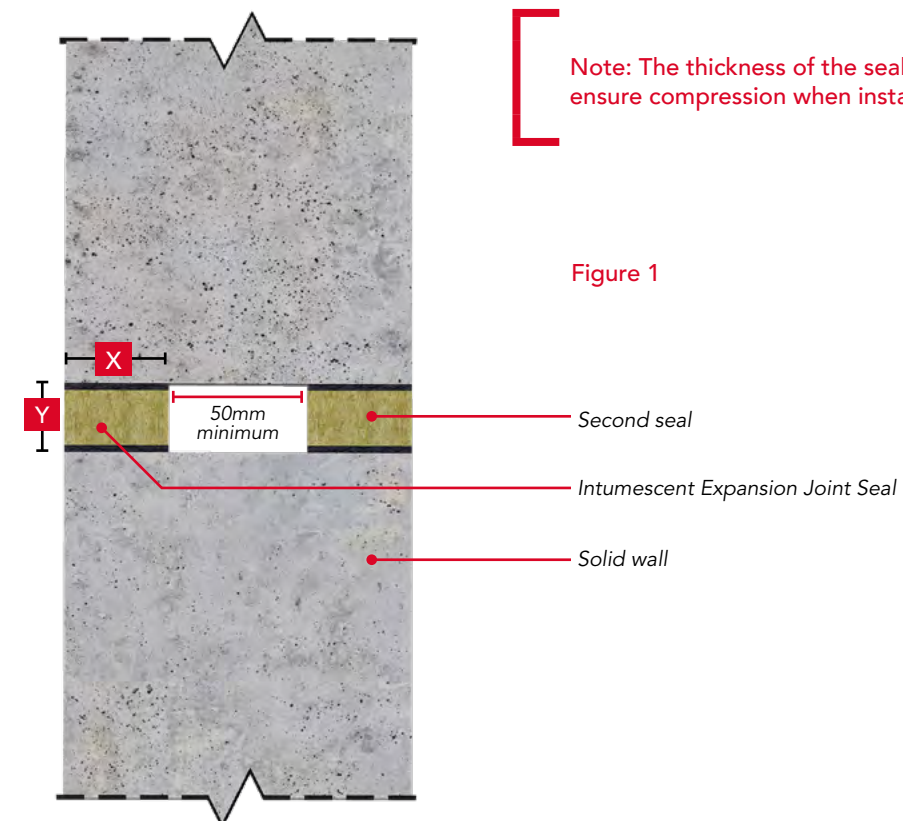



Technical information

Standards and approvals

FIREPRO® Intumescent Expansion Joint Seal has been tested to BS 476: Part 20: 1987 and can provide up to 4 hours fire protection in joints.

FIREPRO® Intumescent Expansion Joint Seal is third party accredited through IFC and Certifire.

Product Information

Property	Description
Length	1000mm
Width	15-78mm
Thickness	25mm, 50mm
Fire resistance	Up to 4 hours

Installation

Installation In floors

Intumescent Expansion Joint is used to prevent fire penetration through movement joints and gaps in walls and concrete floors (Figure 2) for a specified period up to 4 hours. They are manufactured oversize to fit under compression.

1. Remove all loose debris and loose debris from within the gap
2. Ensure correct width is installed to suit the required Fire Rating
3. Where the gap varies in the length to be sealed, ensure that the correct thickness is installed under compression
4. Do NOT remove sleeving
5. Keep material dry and protect from impact damage
6. Compress and insert the strip into the gap ensuring tight butt joints

Specification clauses

FIREPRO® Intumescent Expansion Joint Seal is associated with the following NBS clauses:

E40 Designed joints in in-situ concrete
▪ 545 Compressible sealing strip system
F30 Accessories / sundry items for brick / block stone walling
▪ 616 Fire resistant movement joints without sealant
▪ 670 Tops of non-loadbearing walls



Figure 2



FIREPRO® Acoustic Intumescent Sealant



Description

Acoustic Intumescent Sealant is a high specification, one part water based acrylic sealant. Acoustic Intumescent Sealant is designed for use in the installation of ROCKWOOL Ablative Coated Batt, sealing linear joints and some individual service penetrations passing through various substrates..

Advantages

- Up to 4 hours fire protection
- Acoustically tested
- Air leakage tested
- Suitable for linear joints up to 50mm wide
- Suitable with multiple substrates and services
- Increased movement capability
- Available as a trowel grade option

Applications

Acoustic Intumescent Sealant is comprehensively tested for a wide range of applications which include:

- Sealing service penetrations
- Linear joint seals
- Installation of Ablative Coated Batt

This product should NOT be allowed to come into direct contact with cPVC type piping.

Performance

Standards and approvals

Acoustic Intumescent Sealant has been tested to BS EN 1366-3: 2009 and BS EN 1366-4: 2006 +A1:2010 and classified to EN 13501-2, providing up to 4 hours fire protection in joints up to 30mm.

Acoustic Intumescent Sealant has been CE marked against ETAG026-2.

Acoustic Intumescent Sealant is third party accredited through IFC and Certifire.

Acoustic Intumescent Sealant is third party approved with LPCB – certificate no. 022b(4)

Fire performance

AIS Tables – Fire protection

BS & EN Data for aerated concrete walls and floors with substrates						
Approval	Application	Gap width	Substrate combination	Integrity	Installation	Certifier document place
BS 476-20	Floor	up to 50mm	Variable	up to 120 mins	Single sided	CF5577 - PG 4
EN 1366-3	Floor	up to 50mm	Variable	up to 240 mins	Upper face	CF5577 - PG 7
EN 1366-4	Wall	up to 50mm	Variable	up to 120 mins	single sided	CF5577 - PG 5 & 6

Substrates include AAC, Softwood and Steel – please refer to CF5577 for combinations and individual ratings

CERTIFICATE No CF 5577 - EN1366-4 +A1 Approval Matrix

ROCKWOOL® FIREPRO® Acoustic Intumescent Sealant							
Configuration		Max. joint width (mm)	Min. seal depth (mm)	Backing material	Integrity (mins)	Insulation (mins)	Movement %
Wall constructions (min 150mm thick)	Autoclaved aerated concrete	60*	20 (both faces)	Polyethylene 20mm & 50mm diameter	240	120	24 Shear 8.3 Lateral
		60*	5 (either face)	75mm deep, compressed 15%, stonewool 60kg/m³	240	60	25 Shear 12.5 Lateral

* Pre movement

Application technique: For good adhesion the surfaces of the building element shall be free of any dust or grease and may need to be primed. On good clean, virgin concrete & masonry, no priming required.



Fire stopping: Section 3 - Linear joint seals

CERTIFICATE No CF 5577 - EN1366-4 +A1 Approval Matrix

ROCKWOOL® FIREPRO® Acoustic Intumescent Sealant							
	Configuration	Max joint width (mm)	Min seal depth (mm)	Backing material	Integrity (mins)	Insulation (mins)	Movement %
Floor constructions (min 150mm thick)	Autoclaved aerated concrete	60*	20 (both faces)	Polyethylene 20mm & 50mm diameter	180	60	16.6 Lateral
		60*	5 (either face)	100mm deep, compressed 15%, stonewool 60kg/m³	240	240	25 Lateral

* Pre movement

Application technique: For good adhesion the surfaces of the building element shall be free of any dust or grease and may need to be primed. On good clean, virgin concrete & masonry, no priming required.

EN 1366-3:2009 – Rigid and flexible wall min 120 mm thick					
Service type	Pipe O/D	Pipe wall thickness	Annular gap	Depth of sealant	Classification
Copper and steel pipes	15 mm ≥ 159 mm	0.8 mm ≥ 14.2 mm	10 mm	25mm (both faces)	E120*

* for insulation ratings please contact Rockwool Technical solutions

CERTIFICATE No CF 5577 - EN1366-3 Approval Matrix

Wall installations: Double sided seals - ROCKWOOL® FIREPRO® Acoustic Intumescent Sealant						
	Cable and cable tray size	Cut out (mm)	Minimum seal depth (mm)	Backing material	Integrity (mins)	Insulation (mins)
Flexible or rigid wall constructions (min 150mm thick)	Cables ≥ to 21mm	490mm long x 100mm high	25 (both faces)	75mm x 80kg/m³ stone wool	120	90
	Perforated cable tray 450 x 50mm	490mm long x 100mm high	25 (both faces)	70mm x 80kg/m³ stone wool	120	90
	Cables ≥ 21-60mm	200mm long x 100mm high	25 (both faces)	N/A	90	60

Application technique: For good adhesion the surfaces of the building element shall be free of any dust or grease and may need to be primed. On good clean, virgin concrete & masonry, no priming required.

Rigid walls:

The wall must have a minimum thickness of 150mm and comprise concrete, aerated concrete or masonry with a minimum density of 450kg/m³.

Flexible walls:

The walls must have a minimum thickness of 120mm and comprise timber or steel studs lined on both faces with a minimum of 2 layers of 12.5mm thick “Type F” Gypsum board according to EN 520. In timber stud walls no part of the penetration shall be closer than 100mm to a stud, the cavity must be closed between the penetration seal and the stud and a minimum of 100mm of insulation of Class A1 or A2 according to EN 13501-1 must be provided within the cavity between the penetration and the stud.

For further information, please refer to the ROCKWOOL standard details’

ROCKWOOL® FIREPRO® Acoustic Intumescent Sealant- Approval Matrix

	Pressure (PA)	Positive pressure (m³/h/m²)	Negative pressure (m³/h/m²)
Air Permeability: EN1026	50	0	0
	100	0	0
Acoustic Rating: BS EN ISO 10140-3:1995	R _w (C;C _p) :38(-2;-7) dB		
Smoke Toxicity BS 6853: 1999 Annex B.1 Incorporating Amendment No.1	R value of 0.19		
Weather capability	Not evaluated by this approval		
Movement capability	Movement parameters provided in the scope above		
Smoke Density BS 6853 D.3: 1999 Incorporating Amendment No.1	A _o (max) value 0.004		



Acoustic performance

Weighted Sound Reduction Index (Rw) of up to 57dB dependant on:

- Type of construction
- Type of seal backing
- Size of joint

For specific information on acoustic performance please contact ROCKWOOL Technical Solutions on 01656 868490 or technical.solutions@rockwool.co.uk.

Product information

Property	Description
Application temperature	>5°C
Yield	up to 5.9lm
Weighted sound reduction index	up to 57dB
Fire resistance	up to 4 hours
Shelf life	18 months

Installation

All surfaces must be thoroughly clean and free of bond breaking contaminants prior to application of the sealant. No priming is required for most commercial substrates; however, it is recommended that before installation the sealant is applied to a small area of the substrate to assess adhesion.

The sealant should not be applied if the ambient temperature is below 5°C as adhesion may be impaired.

The sealant is fast curing, approximately 15-minute tack free time. When fully cured, the sealant can be overpainted.

Each cartridge/sausage is intended to provide the following application rates:

Joint size (mm)	Depth of sealant (mm)	Yield per cartridge (m)	Yield per sausage (m)
10	10	3.10	5.90
20	15	1.03	1.95
30	20	0.51	0.95

Specification clauses

FIREPRO® Acoustic Intumescent Sealant is associated with the following NBS clauses:

E40 Designed joints in in-situ concrete

- 530 Sealant

F30 Accessories / sundry items for brick / block stone walling

- 610 Movement joints with sealant

L10 Windows / rooflights / screens / louvres

- 790 Fire resisting frames

L20 Doors / shutters / hatches

- 820 Sealant joints

P12 Fire stopping systems

- 395 Sealant: One part fire resisting acrylic



FIREPRO® Acoustic Intumescent Sealant has been CE marked against ETAG 026-02 and is fully certified with warringtonfire certifire (CF 5577)

FIREPRO® Acoustic Intumescent Sealant has also been successfully tested to achieve Indoor Air Comfort Gold®



FIREPRO® Fire Resistant Silicone Sealant



Description

ROCKWOOL Fire Resistant Silicone Sealant is a one party alkoxy cure silicone supplied in 310ml cartridges. ROCKWOOL Fire Resistant Silicone Sealant offers excellent adhesion to a number of substrate types which include steel and masonry.

Advantages

- Up to 4 hours fire resistance
- Easily applied cartridge application
- Sealing joints up to 40mm
- Suitable with multiple substrates
- Suitable in joints with high movement capability
- Durable – Up to 25 years service

Applications

ROCKWOOL Fire Resistant Sealant is a high performance silicone which has been designed for use in joints with high movement capability or where joints are formed between multiple substrate types. ROCKWOOL Fire Resistant Silicone Sealant is suitable for joints up to 40mm and can provide up to 4 hours fire resistance.

Performance

Fire performance

Table 1 - Fire performance

Joint size (mm)	Sealant depth (mm)	Backing material	Dimensions	Single or dual seal	Integrity (in mins)	Insulation (in mins)
15	10	PE	25mm diameter	Single	240	120
15	10	Mineral wool (density 90kg/m ²)	15mm thick x 10mm depth	Dual	240	240
25	15	PE	30mm diameter	Single	240	120
40	25	Mineral wool (density 90kg/m ²)	40 x 25mm depth	Dual	240	240

Technical information

Standards and approvals

Fire Resistant Silicone Sealant is tested to BS 476: Part 20

Fire Resistant Silicone Sealant is third party accredited through IFC and Certifire.

Product information

Property	Description
Pack size	310ml cartridge
Colour	White
Application temperature	≥ 5°C
Yield	27lm/L
Fire resistance	Up to 4 hours



Installation

Application of ROCKWOOL Fire Resistant Silicone Sealant it is a simple process as the product is extruded from a cartridge loaded into a standard sealant gun. The depth of the joint will depend on the gap to be filled and the fire rating required (see Table 1).

All surfaces must be thoroughly clean and free of bond breaking contaminants prior to application of the sealant. No priming is required for most construction substrates; however, we recommended that a small area be tested on substrates.

The sealant should not be applied if the ambient temperature is below 5° C as adhesion will be impaired.

Coverage

ROCKWOOL Fire Resistant Silicone Sealant is available in 310ml cartridges. One cartridge will provide the following coverage rates:

Joint size (mm)	Metres per litre
6x6	27.75
9x6	18.50
12x9	9.25
18x12	4.75
25x10	4.00

Specification clauses

ROCKWOOL Fire Resistant Silicone Sealant is associated with the following NBS clauses:

E40 Designed joints in in-situ concrete
▪ 530 Sealant
F30 Accessories / sundry items for brick / block stone walling
▪ 610 Movement joints with sealant
L10 Windows / rooflights / screens / louvres
▪ 790 Fire resisting frames
L20 Doors / shutters / hatches
▪ 820 Sealant joints
P12 Fire stopping systems
▪ 395 Sealant: One part fire resisting acrylic





SP Firestop OSCB



Description

Exclusively designed and tested for use only in conjunction with ROCKWOOL RAINSCREEN DUO SLAB, SP Firestop OSCB forms an open-state cavity barrier within the building facade, which allows for ventilation and drainage of the cavity under service conditions.

The product comprises of a continuous intumescent strip fixed to the leading edge of a foil faced stone wool barrier, encapsulated by a weather-resistant polythene sleeve.

Fully tested to ASFP TGD 19, the combination of non-combustible insulation with effective intumescent, supports the construction of safe façade systems and aids the design of high-rise buildings over 18m in height.

Installed horizontally and designed to ensure an appropriate open air space is maintained, the SP Firestop OSCB is suitable for cavity widths up to 600mm (see under 'Performance' for full details).

Advantages

- Fully tested to "ASFP Technical Guidance Document 19: Fire resistance Test for 'open-state' cavity barriers used in the external envelope or fabric of buildings"
- Up to 120 minutes fire integrity and insulation
- Provides 25mm or 44mm airspace
- Satisfies NHBC and CWCT guidance for ventilation gaps at cavity barrier locations
- Weather resistant
- Easy site storage and handling
- Combined with ROCKWOOL RAINSCREEN DUO SLAB it simplifies the design of high rise buildings above 18m

Applications

SP Firestop OSCB is suitable for use within ventilated façade systems.

Performance

SP Firestop OSCB	Polythene wrap	Maximum dimensions (mm)		Fire performance (minutes)	
		Overall void	Open cavity	Integrity	Insulation
60	White; red text	600	25	60	60
120 Lite	Red; black text	600	25	120	120
120	Red; white text	425	44	120	120

Note: SP Firestop OSCB must be specified at least 6mm thicker than the total thickness of RAINSCREEN DUO SLAB within in the cavity.

- SP Firestop OSCB 60 achieves up to 60 minutes, with a maximum open cavity of 25mm and maximum overall void of 600mm.
- SP Firestop OSCB 120 Lite achieves up to 120 minutes, with a maximum open cavity of 25mm and maximum overall void of 600mm.
- SP Firestop OSCB 120 achieves up to 120 minutes, with a maximum open cavity of 44mm and maximum overall void of 425mm.

Technical information

Standards & approvals

Fully tested to ASFP TGD 19, SP Firestop OSCB can comply with the following building regulations:

- England and Wales — Approved Document B
- Scotland—Technical Handbook Section 2
- Northern Ireland—Technical Booklet E
- Republic of Ireland—Technical Guidance Document B

Dimensions

Length: 1000mm
Thickness: 90mm



Total cavity size (mm)	Rainscreen Duo Slab (mm)	SP Firestop OSCB 60		SP Firestop OSCB 120 Lite		SP Firestop OSCB 120	
		Product width (mm)	Open cavity (mm)	Product width (mm)	Open cavity (mm)	Product width (mm)	Open cavity (mm)
100	50	75	25	75	25	56	44
110	60	85	25	85	25	66	44
120	70	95	25	95	25	76	44
125	75	100	25	100	25	81	44
130	80	105	25	105	25	86	44
140	90	115	25	115	25	96	44
150	100	125	25	125	25	106	44
160	110	135	25	135	25	116	44
170	120	145	25	145	25	126	44
175	125	150	25	150	25	131	44
180	130	155	25	155	25	136	44
190	140	165	25	165	25	146	44
200	150	175	25	175	25	156	44
210	160	185	25	185	25	166	44
220	170	195	25	195	25	176	44
230	180	205	25	205	25	186	44
240	190	215	25	215	25	196	44
250	200	225	25	225	25	206	44
260	210	235	25	235	25	216	44
270	220	245	25	245	25	226	44
275	225	250	25	250	25	231	44
280	230	255	25	255	25	236	44
290	240*	265	25	265	25	246	44
300	250*	275	25	275	25	256	44
310	260*	285	25	285	25	266	44
320	270*	295	25	295	25	276	44
330	280*	305	25	305	25	286	44
340	290*	315	25	315	25	296	44
350	300*	325	25	325	25	306	44
360	310*	335	25	335	25	316	44
370	320*	345	25	345	25	326	44
380	330*	355	25	355	25	336	44
390	340*	365	25	365	25	346	44
400	350*	375	25	375	25	356	44
410	360*	385	25	385	25	366	44
420	370*	395	25	395	25	376	44
425	375*	400	25	400	25	381	44

*Thicknesses of RAINSCREEN DUO SLAB over 230mm comprise two layers.
Larger sizes available as per the table under 'Performance'. Please contact Customer Service to order.

Ancillary products

SP Firestop OSCB Fixing Brackets

Required for installation, these galvanised steel brackets are supplied with SP Firestop OSCB at a rate of two per metre length. Brackets are packaged in a separate cardboard box located at the bottom of a pallet - the location will be marked with a label.

SP Fixing Brackets are designed to be easily re-profiled by hand on site, and should be cut as necessary to ensure they penetrate the barrier by approximately 75% of its width.

Stainless steel brackets are available as an option.


Pigtail Screws

These are required for SP Firestop OSCB 60 and 120 Lite, and are used to secure the front-facing intumescent strip. They are supplied at a rate of 3 per metre length and will be packaged with the SP Firestop fixing brackets.

Care should be taken to ensure that the pigtail screws protrude from the front face of the firestop by a maximum of 25mm.



SP Firestop OSCB Fixing Brackets

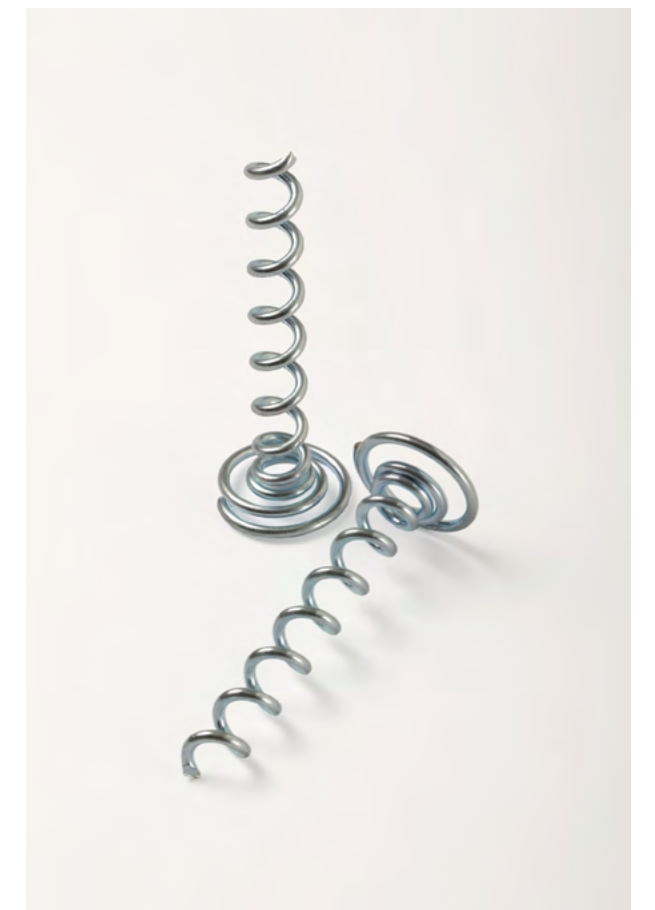

Pigtail Screws



Installation

SP Firestop OSCB is only tested and certified for horizontal applications in conjunction with RAINSCREEN DUO SLAB®.

Note: The polythene wrap covering each section of barrier is not to be removed, and if cut must be reinstated.

SP Firestop OSCB is supplied ready to install with two galvanised steel fixing brackets and four pigtail screws per meter length.

The brackets should be mechanically and securely fixed to the wall at a maximum of 500mm centres using non-combustible fixings.

The product is impaled mid-barrier depth onto the fixing brackets, which should penetrate the barrier by approximately three-quarters of the product width. The barrier must be pushed back sufficiently to ensure full contact with the supporting wall.

For SP Firestop OSCB 60 and 120 Lite only, the front facing intumescent strip is secured to the barrier using the supplied pigtail screws, three per metre length at a maximum of 333mm centres. These screws should protrude from the front face of the barrier by a maximum of 25mm.

SP Firestop OSCB 120 should oversail the front face of the insulation, protruding into the cavity by at least 6mm.

Adjacent lengths of barrier should be tightly butt jointed together.

At a corner detail where two runs of OSCB meet (for clarity; referred to as A and B): A should be continued out past the corner to tightly butt against the outer cladding, and B should tightly butt against A.

Where OSCB meets a vertical firestop, OSCB should be stopped and tightly butted against it.

For cut lengths, a minimum of two fixing brackets should be used.

Imperfections of up to 10mm can be filled with ROCKWOOL Acoustic Intumescent Sealant.





Section 1: Structural steel/concrete

Many building materials can lose significant strength when exposed to high temperatures. Providing fire resistance to the load bearing structure of a building ensures that the building remains structurally stable in the event of a fire.

The ROCKWOOL® range of fire protection products can withstand temperatures in excess of 1000°C providing protection to steel and concrete structures for periods of up to 4 hours. This vital protection ensure occupants can escape and firefighters can operate without the risk of collapse.



Core products



Useful documents and standards
ASFP Technical Guidance Document – TGD 14: Code of practice for the installation and inspection of board systems for the fire protection of structural steel
ASFP Yellow Book: Fire protection for structural steel in buildings
ASFP: Ensuring best practice for passive fire protection in buildings
BS 476-21: Fire test on building materials and structures. Method for determination of the fire resistance of load bearing elements of construction
BS EN 1365-2: Fire resistance test for load bearing elements. Floors & roofs
BS EN 1365-3: Fire resistance test for load bearing elements. Beams
BS EN 1365-4: Fire resistance test for load bearing elements. Columns
BS EN 1363-1: Fire resistance tests. General Requirements
BS EN 13501-2: Fire classification of construction products and building elements. Classification using test data from resistance to fire tests, excluding ventilation services.

ASFP (Association for Specialist Fire Protection) guidance documents can be sourced at www.asfp.org.uk



Soffit Slab



Description

ROCKWOOL Soffit Slab is manufactured using high performing, non-combustible stone wool insulation. Available with a plain, foil or tissue facing which can provide up to 4 hours fire protection to the underside of concrete soffits.

Hi-impact Soffit Slab

With a 6mm rigid fiber cement board facing, this combination of two non-combustible products provides increased impact resistance and durability. Available in various thicknesses, the off-white facing can be easily decorated to match design and colour schemes.

Advantages

- Excellent thermal performance
- Effective acoustic insulation
- Non-combustible stone wool insulation and facing options
- Up to 4 hours fire resistance
- Water repellent
- Easily cut to accommodate services
- Simply butt together at joints
- Hi-impact option for durability

Applications

Suitable for use with concrete soffits where a thermal, fire or acoustic performance is required.

Performance

Fire performance

Soffit Slabs have been tested to BS EN 1363-1 to offer fire protection to reinforced concrete soffits. When applied to the soffit using the recommended fixings and pattern, 130 and 140mm thick products, with and without facings, provide 3 hours fire insulation and integrity to a minimum 90mm thick floor slab. 150 and 160mm thicknesses provide 4 hours to a minimum 150mm thick slab.

Thermal performance

ROCKWOOL® Soffit Slab has a thermal conductivity (k value) of 0.034 W/mK.

Thermal resistance of un-faced Soffit Slab:

- 130mm Soffit Slab: 3.82 m²K/W
- 145mm Soffit Slab: 4.26 m²K/W
- 160mm Soffit Slab: 4.70 m²K/W

A typical construction comprising of a 150mm concrete floor slab underlined with 130mm thick Soffit Slab would achieve a U-value of 0.25W/m²K. A U-value of 0.20W/m²K can be achieved using 160mm thick Soffit Slab

Technical information

Standards and approvals

ROCKWOOL® Soffit Slab achieves a reaction to fire classification of A1 as defined in BS EN 13501-1.

Compatibility

ROCKWOOL® Soffit Slabs are chemically inert and compatible with most materials with which they are likely to come into contact in normal building applications.

Biological

ROCKWOOL® Soffit Slabs offer no sustenance to vermin and do not encourage the growth of fungi, moulds or bacteria.

Product information

Property	Description
Length	1000mm (High Impact – 1200mm)
Width	600mm
Thickness	130, 145, 160mm
Thermal conductivity	0.034 W/mK
Reaction to fire	Euroclass A1
Fire resistance	Up to 4 hours



Installation

When fixing a tile or modular system, it is advisable to start with a focus reference slab in the centre of the soffit with subsequent slabs being fixed working towards each edge. The use of string lines or laser alignment equipment will assist in ensuring alignment and squareness of the installation.

Mechanical fixings

Soffit Slabs should be fixed direct to the concrete soffit using Ejot DDS fixings with the Ejot DDT70 washer or similar. Recommended number and pattern of fixings for each slab size are shown in figures 1 and 2 below. Care should be taken not to over-tighten fixings to prevent damage to slab surface. For further information on fixing type and suitability, please refer to the fixing manufacturer.

Fixing size guide

	High impact Soffit Slab		Plain, foil & tissue faced Soffit Slab		
Thickness	136mm	166mm	130mm	145mm	160mm
Ejot fixing	DDS 7.3 x 175mm	DDS 7.3 x 200mm	DDS 7.3 x 175mm	DDS 7.3 x 175mm	DDS 7.3 x 200mm
Ejot washer	DDT 70mm				

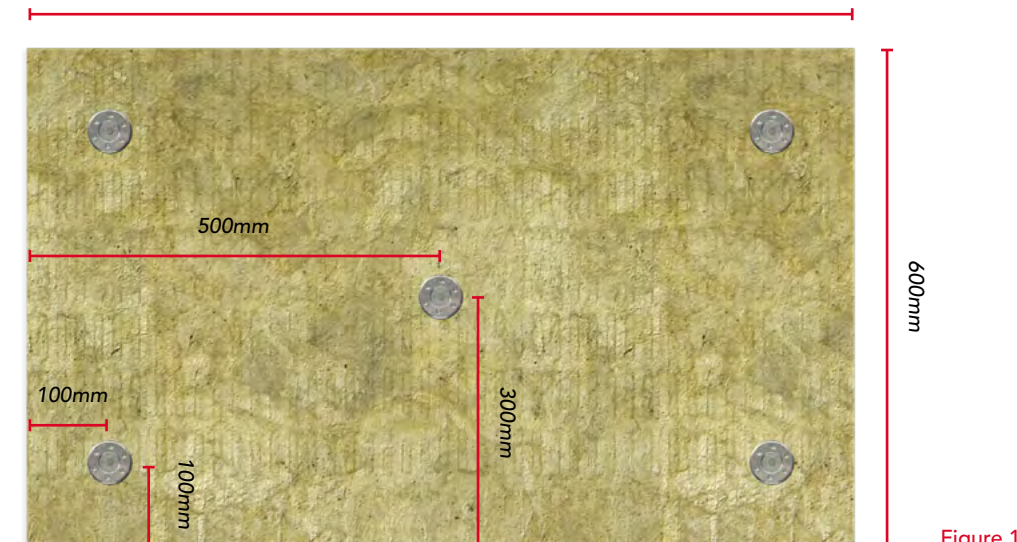


Figure 1

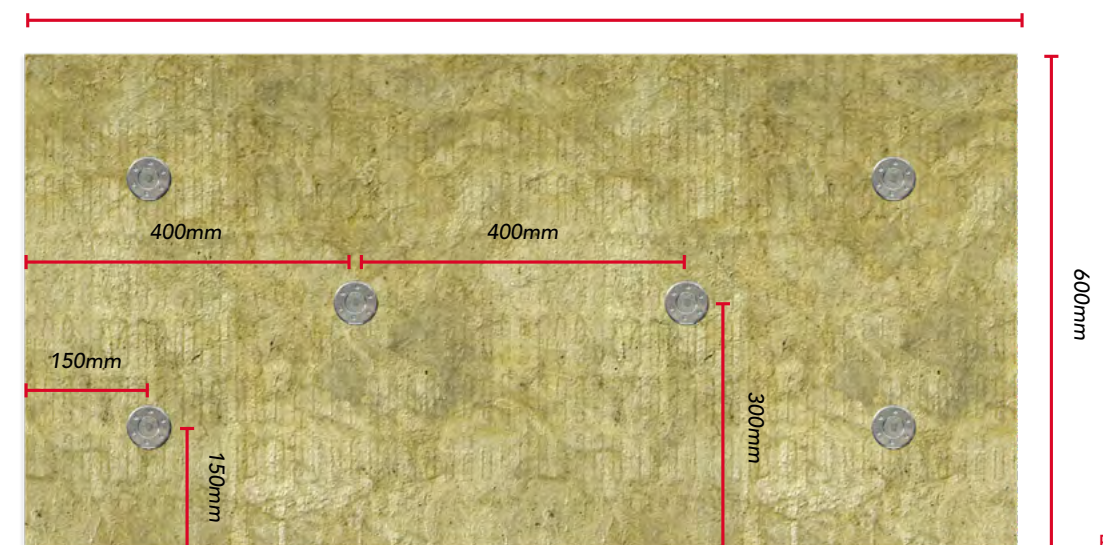


Figure 2

Light fittings and services

Soffit insulation products should not be used for supporting light fittings or services. Such installations should be supported from the concrete soffit.

Specification clauses

The insulation/fire protection of the concrete soffit is to be ROCKWOOL® Soffit Slab alu-faced / High impact / white tissue / black tissue / un-faced¹mm thick², as manufactured by ROCKWOOL® Limited, Pencoed, Bridgend CF35 6NY and installed in accordance with the manufacturer's recommendations.

¹Delete as necessary.

²Insert required thickness.

NBS specification clauses

ROCKWOOL® Soffit Slab is associated with the following NBS Specification clauses:

K11 Rigid sheet flooring / sheathing / decking / sarking / linings / casings

- 885 Fire Protection Board
- 890 Board



FIREPRO® Glue



Description

ROCKWOOL FIREPRO® Glue is a water based, fire resistant adhesive which is supplied in 17kg tubs and 300ml cartridges.

Advantages

- LUL Approved
- Easy to apply
- Sets in as little as 4 hours
- Can be used from -10°C upward

Applications

FIREPRO® Glue is suitable for use with FIREPRO® BEAMCLAD and ROCKWOOL Fire Duct Systems where glued joints or noggins are required. FIREPRO® Glue can also be used in conjunction with other ROCKWOOL Stone Wool products where there is a requirement for a fire resistant adhesive.

Frost exposure does not remove curing ability.

The use of FIREPRO® glue is not limited to particular temperatures and has been tested when applied to surfaces with temperatures of -10°C and upwards, but the curing rate in-situ can be affected by:

- Temperature (see Table 1)
- Air humidity
- Thickness of glue layer in a joint
- Air access to glued joint (i.e. not sealed off)

Note: The temperature of FIREPRO® glue must be 5°C or more when applied to surfaces at lower temperatures.

Performance

FIREPRO® Glue has been widely used in fire tests conducted on ROCKWOOL FIREPRO® Fire Protection Systems where fire ratings of up to 4 hours have been achieved. For further information tested applications please contact ROCKWOOL.

Technical information

Standards and approvals

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details.

Product information

Property	Description: Tub	Description: Cartridge
Pack Size	17kg Tub	300ml Cartridge
Application Temperature	Surface temperature of $\geq -10^{\circ}\text{C}$ (Glue must be $\geq 5^{\circ}\text{C}$)	Surface temperature of $\geq -10^{\circ}\text{C}$ (Glue must be $\geq 5^{\circ}\text{C}$)
Ph	11	11
Shelf Life	12 months	18 months
Fire Rating	Up to 4 hours (When tested with ROCKWOOL Fire Protection Systems)	Up to 4 hours (When tested with ROCKWOOL Fire Protection Systems)



Installation

Application of glue from tub is typically made by a pallet knife or trowel before pressing surfaces together. The product must always be stirred before use to ensure a uniform product consistency. Application of glue from cartridge is made using a sealant gun and spread evenly over the surface with a spatula or similarly flat bladed tool. Fixing boards together is supplemented by nails, pins or staples through noggin board joints and board joints.

Whilst steel surfaces may be acceptable when just moist to the touch, heavy water droplets, grease, scale oxide, dust etc should be removed prior to the application of FIREPRO® glue.

Testing has shown that even if glued joints are immediately subjected to heavy frost exposure, the final glued joint strength is not threatened, but curing is retarded.

Glue fixed noggins must be allowed to set fully before any attempt is made to fix cover boards. Table 1 suggests minimum times to allow such setting to occur between ROCKWOOL BEAMCLAD® noggins and steelwork.

FIREPRO® Glue may be used to attach cover boards onto cured noggins (and in glued board joints), provided that a 24 hour interval is acceptable before further trades work on such protected steelwork.

Note: When friction fitted glued joints are exposed to sub-zero temperatures either immediately, or at some time during the curing process, adequate bond stability will form in approximately 1 hour. This bond will be sufficient for cover boards to be applied. Full setting will continue as in Table 1 when frost free conditions return, but stability will be provided by the supplementary pins or nails. The final strength of the glued joints will not be affected by exposure to sub-zero temperatures during the curing process.

Noggins to steelwork

Exhaustive testing has been made under various application conditions. All noggins fitted into steelwork should be cut to provide an interference friction fit of approximately 0.5mm. Excessive oversizing causing the noggins to bend should be avoided (refer to Figures 1-3).

The noggins should be installed so as to be just proud of the flange tips. For web depths greater than 500mm 'solid' noggins or 'T' noggins ROCKWOOL BEAMCLAD® must be used. Again a nominal 0.5mm interference fit is recommended for all ambient conditions, but particularly for winter working. All noggin edges in contact with steelwork must be glued.

Figure 1

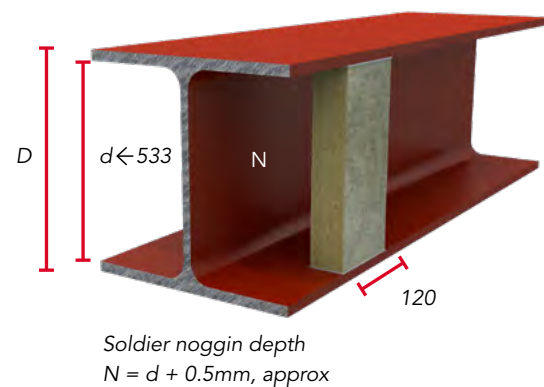


Figure 1a


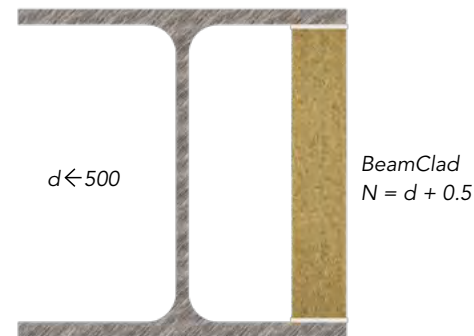


Figure 2

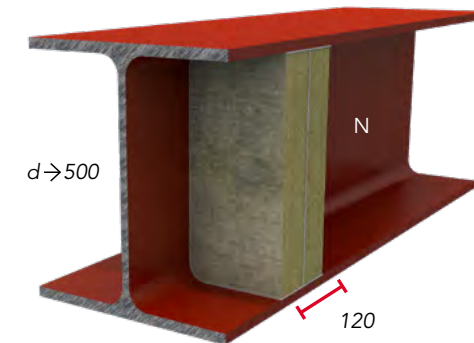

Soldier noggins may be laminated provided FIREPRO® Glue is used between laminated surfaces

Figure 2a

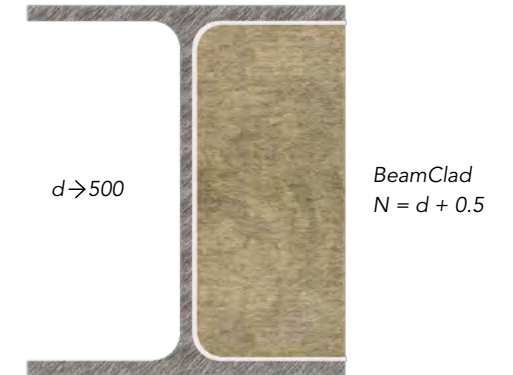


Figure 3


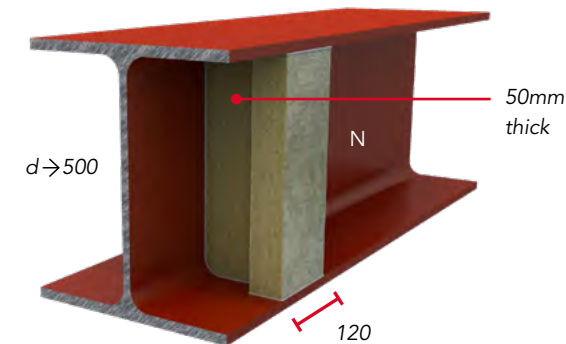


Figure 3a

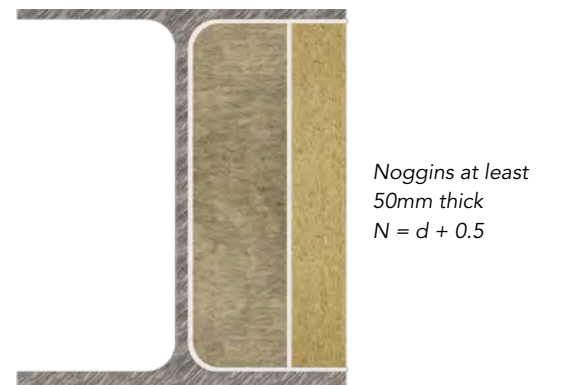

Ambient conditions & curing times

For all year round working, noggins should be cut to provide approximately 0.5mm interference fit into steelwork. Some friction in the fitting is required to satisfy all conditions and to provide a sensible limit to glue thickness.

In typical dry summer conditions of 20°C, curing of the basic glue will occur in approximately 4 hours before cover boards should be added onto the noggins.

The setting times of glue in moist air conditions is approximately 6-8 hours if the temperature is above freezing point, or in approximately 1 hour at 20°C.

Table 1: Setting times for different conditions


Conditions	Setting time
Approx 20°C dry conditions	Approx 4 hours
Approx 3°C+ with moist air conditions	Greater than 24 hours expected
-10°C to 0°C	Adequate bond forms within 1 hour but full cure may be delayed over 24 hours when temperatures 0 - 6°C

Storage

Generally storage should be made in frost free conditions. Should frost exposure occur, the glue should be thawed out and thoroughly stirred.



FIREPRO® BEAMCLAD® Systems

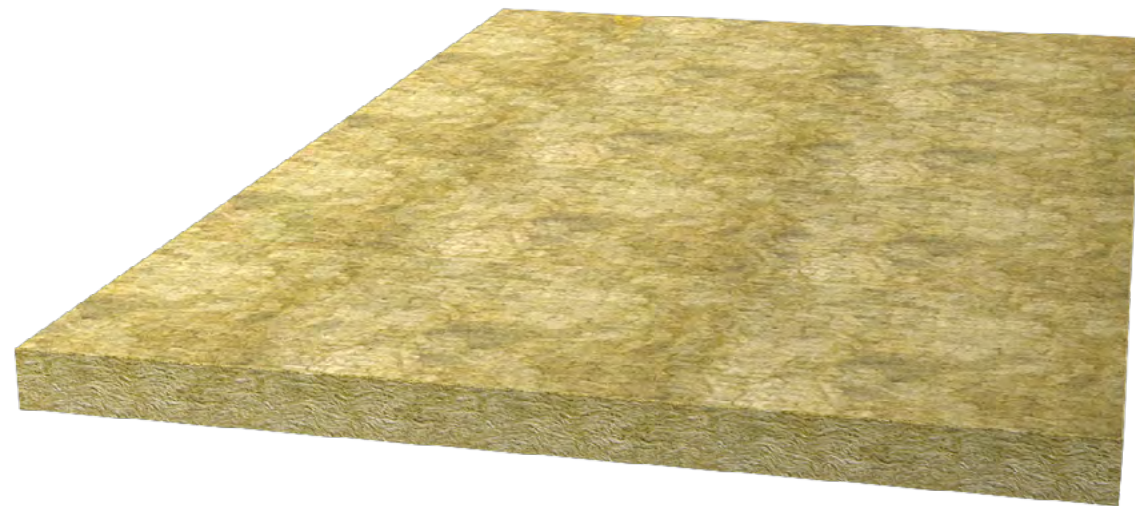

Description

ROCKWOOL BEAMCLAD® is manufactured using high performing, non-combustible stone wool insulation. Available in a plain, foil or tissue faced finish, BEAMCLAD® can provide up to 4 hours fire protection to structural steel.

ROCKWOOL BEAMCLAD® boards are sized 2000 x 1200mm, in a range of thicknesses from 25mm up to 50mm (as standard).

Advantages

- Up to 4 hours fire resistance
- *Fire rated timber floor applications
- Moisture repellent
- Quick and simple to apply
- No maintenance

*For further information on fire rated timber floor applications please contact ROCKWOOL Technical Support.

Applications

FIREPRO® BEAMCLAD® Systems have been specially designed to provide fire protection to structural steel for periods of up to 4 hours. BEAMCLAD® Systems provide a flexible range of fixing solutions for all applications, these include:

- Complete glued system
- Welded pins/glued joint system
- Welded pins/dry joint system

FIREPRO® BEAMCLAD® can also be used to provide fire protection to timber floor systems for periods of up to 90mins* with a complete dry fixed system.

High air flow applications

Un-faced ROCKWOOL BEAMCLAD® Systems have been evaluated for use in return air plenums, by the Institute of Occupational Medicine to World Health Organisation test standards and for use in subways, for train speeds up to 150km per hour.

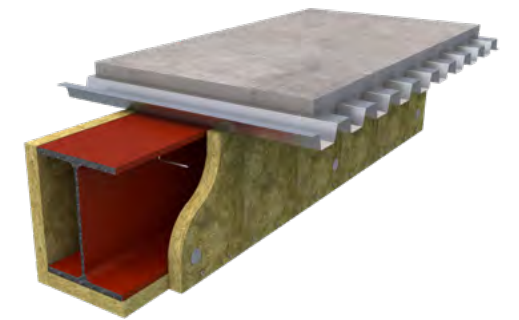


Figure 1
FIREPRO® BEAMCLAD® Systems

Performance

Fire performance

BEAMCLAD® Systems provide up to 4 hours fire resistance for structural steelwork, assessed at critical temperatures between 350°C and 800°C, including the default temperatures of 550°C (columns) and 620°C (beams). Un-faced, aluminium-foil and glass tissue faced product options comply with non-combustible definitions as referenced in UK Building Regulations.

Table 1: Fire performance of BEAMCLAD® Systems

System	Fire resistance (mins)					
	30	60	90	120	180	240
Glued noggins, glued application, glued board joints	✓	✓	✓	✓	✓	✓
Welded pins, glued board joints	✓	✓	✓	✓	✓	✓
Welded pin, dry board joints	✓	✓	✓	✓	✓	

Technical information

Standards and approvals

ROCKWOOL BEAMCLAD® fire protection materials have been assessed to ENV 13381-4:2002 & EN 13881-4:2013 for the fire protection of loadbearing steelwork for up to 4 hours protection.

ROCKWOOL BEAMCLAD® achieves a reaction to fire classification of A1 as defined in BS EN 13501:1.

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details.

Product information

Property	Description
Length	2000mm
Width	1200mm
Thickness	25 – 100mm*
Density	167 – 180kg/m ³
Reaction to fire	Euroclass A1
Fire resistance	Up to 4 hours

* Single board thickness



Installation

FIREPRO® BEAMCLAD® Systems provide a flexible range of fixing options to meet a variety of site requirements. BEAMCLAD® Systems can be broken down into two main types:

1) ROCKWOOL BEAMCLAD® dry joint systems

These use stud welded pins to secure the insulation to all structural steel sections. All board-to-board joints are straight butt joints, without the need for glue.

2) ROCKWOOL BEAMCLAD® glued joint systems

These use an inorganic and non-toxic glue to bind board-to-board joints and/or to the noggins. Galvanised nails of at least 2.5mm for nails shorter than 100mm and at least 4mm for 100mm nails or longer. Nails twice the thickness of insulation, are used to hold the joints together whilst the glue cures. Alternatively, pigtail screws can be used instead of galvanised nails. Pigtail screws should be minimum 2 x thickness of cover board -5mm.

Installation option 1: Dry board joint systems

Stud welded pin application

A dry joint system employing steel welded pins. The system is installed using 2.7mm diameter stud-welded pins.

The steelwork is cleaned in the area where the welded pin is to be positioned. The pin is then welded to the steel flange.

The ROCKWOOL BEAMCLAD® board is then impaled on to the stud welded pins and held in place with 28mm diameter spring steel non-return washers.

The stud welded pins are fixed at max. 320mm centres to top flange and to bottom flange.

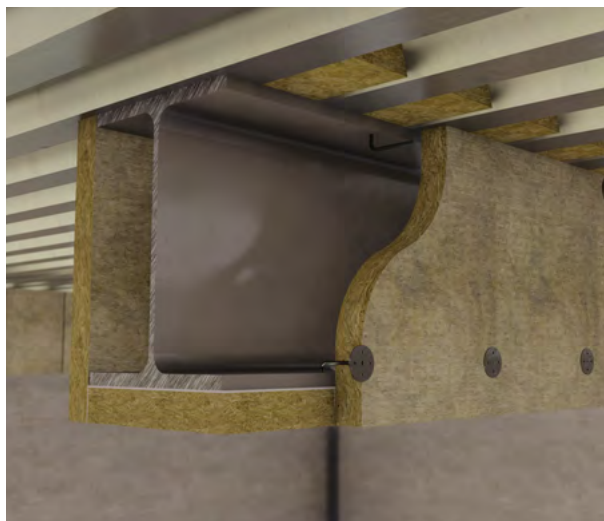


Figure 2
Stud welded pin dry joint board system
(Up to 3 hours fire protection)



Figure 3
Two-sided protection with stud welded pins
(Up to 3 hours fire protection)

Installation option 2: Glue joint systems

Glue-fixed noggins and board-to-board glued joints

ROCKWOOL BEAMCLAD® noggins (at 1000mm nominal centres) are glued between the steelwork flanges, and the ROCKWOOL BEAMCLAD® side boards are glued to the noggins, ensuring transverse board joints are coincident with the noggins. The ROCKWOOL BEAMCLAD® side boards are also glued at all vertical joints and horizontal board-to-board joints.

Round head nails (length $\geq 2 \times$ thickness of board) are fixed through the side boards into the noggins (min 2) and soffit boards (at 400mm nominal centres) to consolidate the glued joints.

Stud welded pins and board-to-board glued joints

Pins are stud welded at max. 320mm centres to top flange and to bottom flange. All board-to-board joints are glued and nailed.

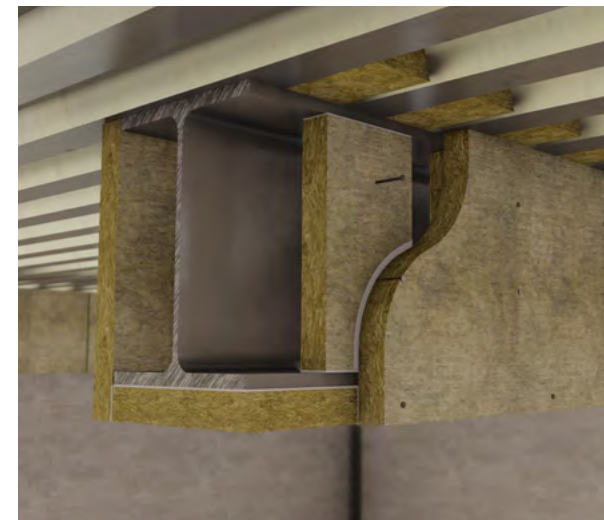


Figure 4
Glue-fixed noggins and board-to-board glued joints
(Up to 4 hours fire protection)



Figure 5
Stud welded pins and board-to-board glued joints
(Up to 4 hours fire protection)

FIREPRO® Glue – Coverage rates for glued joint systems

FIREPRO® Glue is an inorganic, non-toxic product with a pH of 11. FIREPRO® Glue is supplied pre-mixed in 17kg tubs. A variety of joint types can be used (see previous page).

Coverage rate will depend on the linear length of the joints, width of joint (board thickness) and joint depth. Assuming total, effective usage of the glue on site, the following table provides an approximate weight (kg) of glue per linear metre of joint, based on a glue depth of 1mm.

ROCKWOOL BEAMCLAD® thickness (mm)	Square butt joint
25	0.09
30	0.11
35	0.13
40	0.15
50	0.19
60	0.22

Note: Care should be taken when using FIREPRO® Glue with foil faced BEAMCLAD® as the alkalinity of the glue is very high and can react with the foil. Avoid any contact between the glue and the foil layer, if contact occurs remove the glue immediately with a damp cloth.

In practice, a degree of wastage would be expected and as such, it would be prudent to make an allowance for this when placing an order. As a very approximate guide, the coverage rate of a 17kg tub of FIREPRO® Glue would be 35m² of applied board.



Board jointing options

Butted corner joints:

Butted corner joints are made with square edge boards using either a dry joint, or FIREPRO® Glue and nails/pigtail screws at 400mm centres.

Axial joints:

All axial joints are made with square butt edges, without nails. Glue is only required for glued board systems. For Foil faced products, joints can be finished with Class 'O' foil tape.

Noggins:

ROCKWOOL BEAMCLAD® boards can be fixed to noggins, cut from ROCKWOOL BEAMCLAD® offcuts of at least the same thickness as the fascia and soffit boards.

The edges of the noggins are glued where they contact the steelwork, then, once the glue has set firmly, the cover boards are fixed in position with FIREPRO® Glue and nails/pigtail screws.

Welded steel pins:

Boards are impaled onto stud welded pins and secured with non-return washers.

Cellular beams

Thickness calculation method

The method for determining the thickness of ROCKWOOL BEAMCLAD® required to protect a cellular or castellated beam shall be determined as the highest value derived from the following:

- The section factor of the I section above the opening
- The section factor of the I section below the opening
- Calculate the effective section factor using the following equation:
 - Section factor $(m-1) = 1400 / t$, where t = the thickness (mm) of the lower steel web
- Confirm the limiting design temperature of the beam with the manufacturer. In the absence of such information, a conservative fail temperature of 450°C can be used.
- Using the calculated section factor and protection period required, determine the thickness of ROCKWOOL BEAMCLAD® for a solid beam from the appropriate fire protection table for the limiting design temperature (or 450°C) and the fixing system being considered.
- Multiply this thickness by 1.20 to obtain the ROCKWOOL BEAMCLAD® thickness for the cellular or castellated beam.

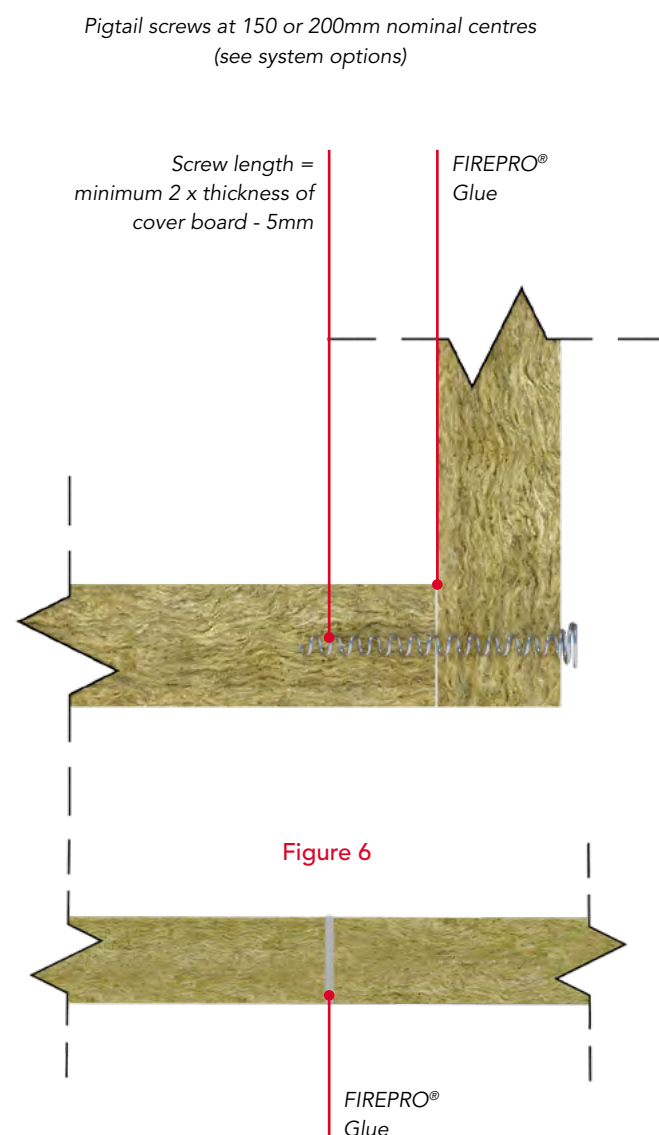


Figure 6

Installation options – cellular beams



Figure 7
Beam with circular holes
(boxed protection - glued and pinned joints)

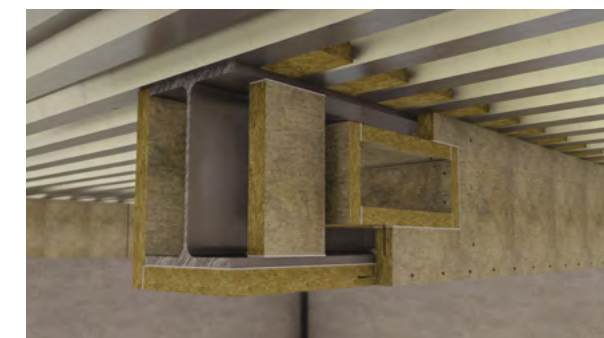


Figure 8
Beam with square or rectangular holes
(boxed protection - glued and pinned joints)



Figure 9
Beam with circular holes
(boxed protection - dry joints)



Figure 10
Beam with square or rectangular holes
(boxed protection - dry joints)

FIREPRO® BEAMCLAD® System Ancillaries

- Pigtail screws are available from ROCKWOOL stockists.
- Welded pins and sprung steel non-return washers are available from external suppliers.
- Fire Duct /Ductrock ductwork solutions are also available for steel duct protection.
- FIREPRO® Glue

Specification clauses

(To be read in conjunction with System Options on previous pages)

1. The structural steel is to be fire protected using ROCKWOOL BEAMCLAD®.....s system, with a.....f facing, to provide.....h fire resistance.
2. The main fixing system will be one of:
 - ROCKWOOL BEAMCLAD® noggin system and glued joints fixed at 1000mm centres.
 - ROCKWOOL BEAMCLAD® stud welded pin system fixed at max. 320mm centres to top flange, and to bottom flange.
3. Board-to-board joints can be dry fixed or glued and nailed/pigtail screwed in accordance with the data sheet.

^s insert system type ^f insert facing option ^h insert period of fire resistance

NBS specification clauses

FIREPRO® BEAMCLAD® Systems are associated with the following NBS specification clauses:

K11 Rigid sheet flooring / sheathing / decking / sarking / linings / casings

- 885 Fire Protection Board
- 890 Board



ROCKWOOL BEAMCLAD® Systems Contractor Fixing Guide


ROCKWOOL BEAMCLAD® Systems provide a 'tool-box' of options and have been assessed based on fire test data carried out to ENV 13381-4:2002 and EN 13381-4:2013 and in accordance with ASFP Yellow Book, Fire Protection for Structural Steel in Buildings, 5th Edition.

They offer contractors simple and economical fire protection solutions to the very real diversity of modern steel constructions.

This section explains and illustrates the installation methods using the following fixing options:

- Stud welded pin dry joint board system
- Stud welded pin glued jointed board system
- Glue fix noggin, glued jointed board system
- Tested and approved for solid and cellular sections



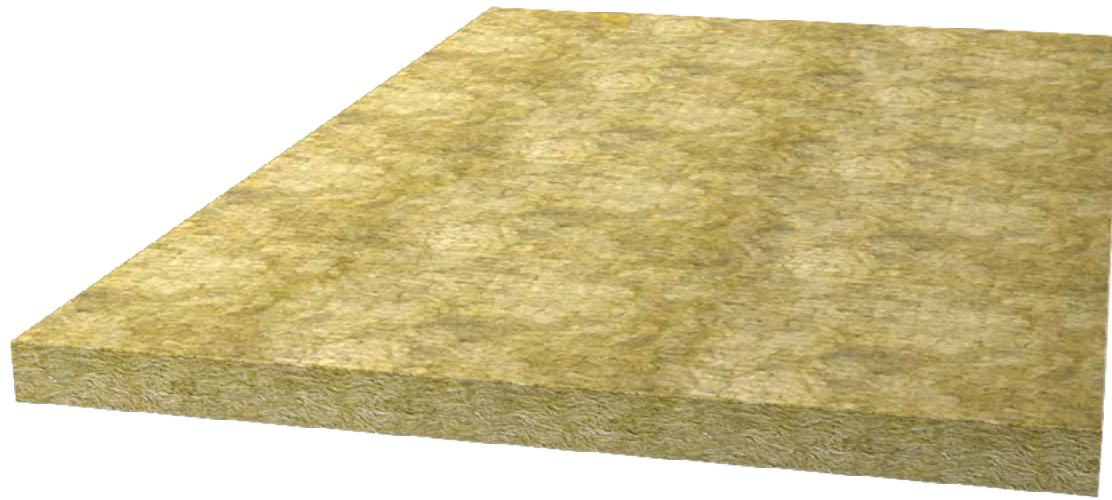

Description

BEAMCLAD® boards are available with facings of glass tissue and reinforced aluminium foil as well as plain product. Size: 2000 x 1200mm. Standard thicknesses: 25, 30, 35, 40 and 50mm. Single board thicknesses up to 100mm are available.

Scope

Contractors are required to install materials as tested and detailed in this brochure. In situations not covered by this brochure, ROCKWOOL will either recommend a suitable detail or assist in obtaining an independent Design Appraisal.

Applications

This Fixing Guide provides details of all of the standard boxed applications. It covers fixing centres and details of available facings and joint details. Dry board joints for up to 3 hours and glued joints up to 4 hours protection.

Stud welded pin, dry joint board systems

Welded pin fixing solutions with dry joints are extremely quick to apply, reduce system installation costs and eliminate the need for glue.

Glued noggin fix and stud welded pin systems – glued joints

The glued joint ROCKWOOL BEAMCLAD® systems remain for the applications that require fire protection periods of up to 4 hours.

Advantages

- Fast to install, dry fix stud welded pin system
- Only dry joint stud welded pin solution
- Stud pin fixing centres at max. 320mm for top flange and bottom flange
- Up to 3 hours fire protection

ROCKWOOL BEAMCLAD® stud welded pin dry joint board system

A traditional stud welded pin solution with dry joints. This dry fix pin solution can be used for 2, 3 and 4-sided beam protection for a period of up to 3 hours.

Installation sequence

1. Clean the local area for pin welding and fix stud pin using arc or CD welds, ensuring a good contact has been achieved. Stud-welded pins are a minimum 2.7mm diameter. Test weld by bending pin.
2. Impale the ROCKWOOL BEAMCLAD® boards onto the stud welded pins using the deck soffit as a guide.
3. Push 28mm diameter sprung steel non-return washers onto the exposed pin until tight to the cover board face. Crop pins as necessary.
4. Tape joints using aluminium foil tape or scrim, if required.
5. In the case of beams, the pins are welded to the steel section along the flange tips and in two rows along the face of the bottom flange, nominally 50mm in from each edge.
6. Transverse joints in the boards fixed to the webs are offset with respect to those fixed to the flange by a minimum of 100mm.



Figure 1
Stud welded pin, dry joint board system



Chart 1 - ROCKWOOL BEAMCLAD® stud welded pin dry joint system:
Critical steel temperature 620°C, 3 sided protection for beams


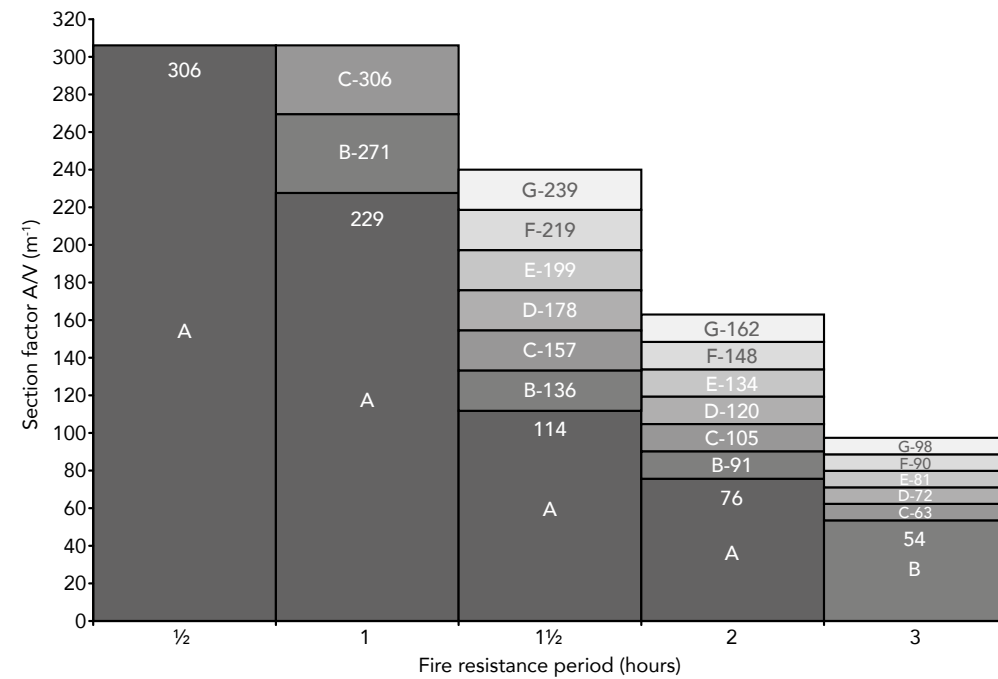


Chart 2 - ROCKWOOL BEAMCLAD® stud welded pin dry joint system:
Critical steel temperature 550°C, 4 sided protection for beams and columns

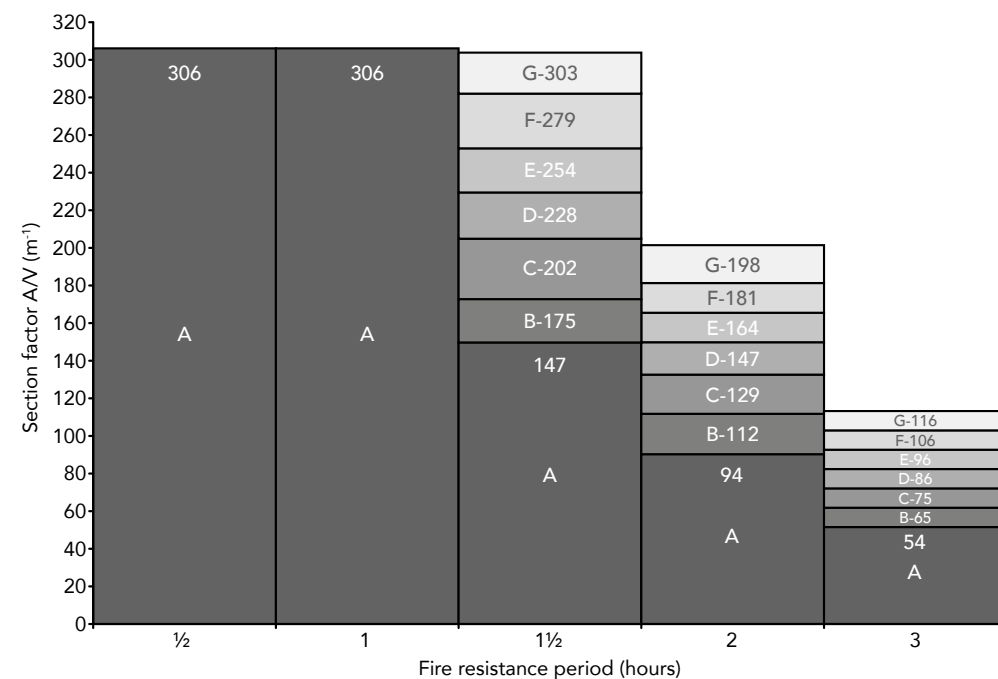

The following key provides the required minimum thicknesses of ROCKWOOL BEAMCLAD® for the Section Factors given in the tables above.

A = 25mm B = 30mm C = 35mm D = 40mm E = 45mm F = 50mm G = 55mm

Typical details

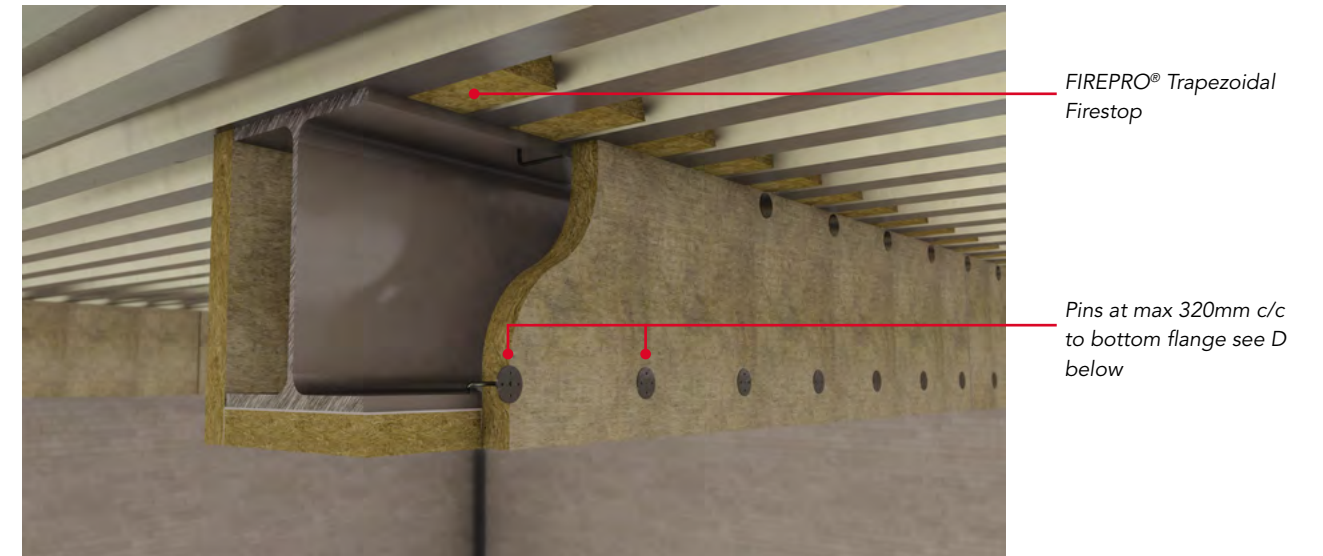


Figure 2
3-sided box

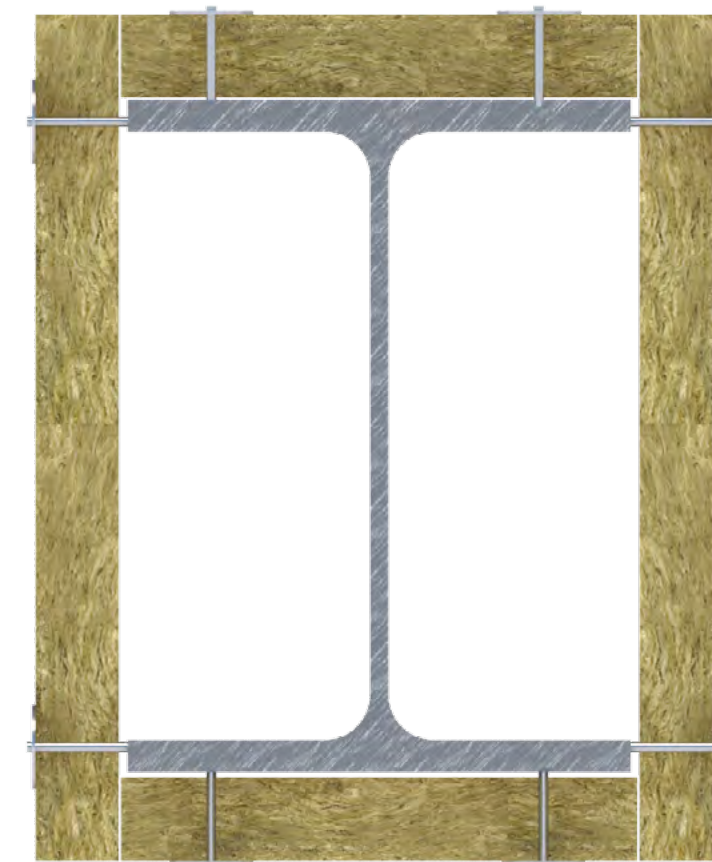


Figure 3
4-sided box



Fixing patterns

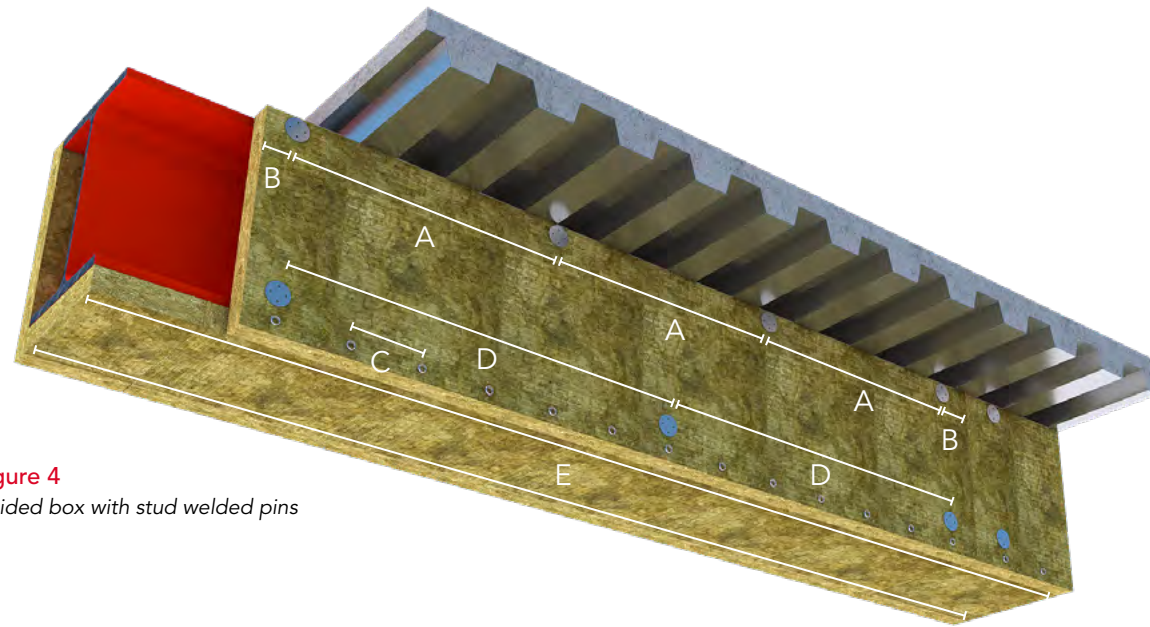


Figure 4
3-sided box with stud welded pins

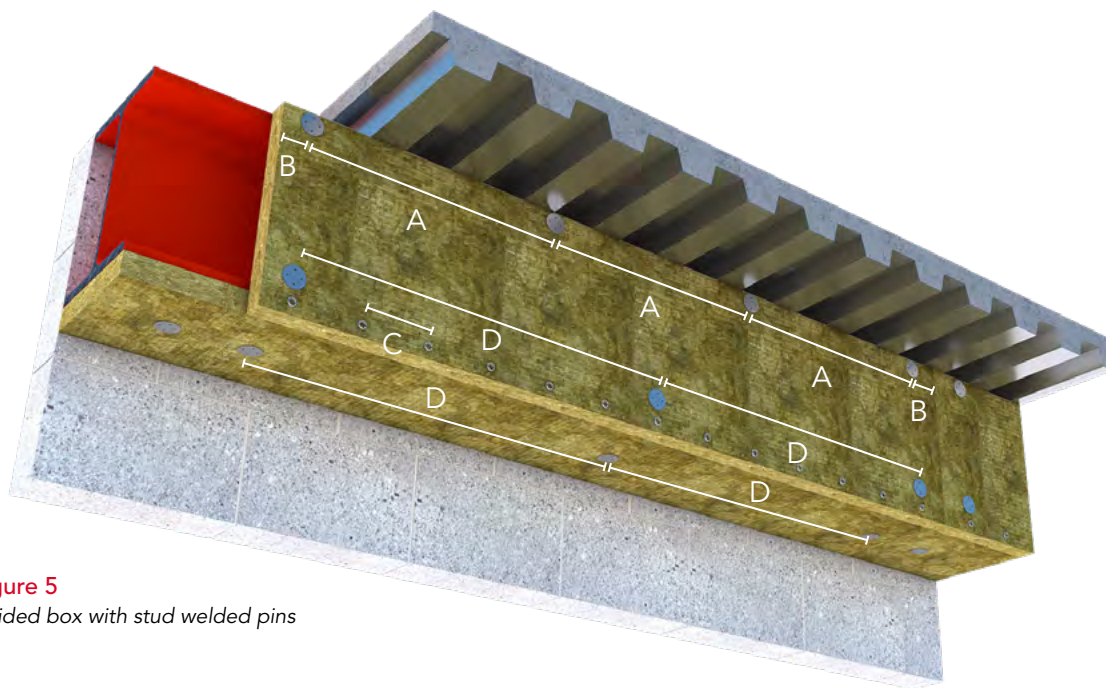


Figure 5
2-sided box with stud welded pins

Dimensions

- A = Stud welded pins at max. 320mm centres
- B = Stud welded pins, nominally 50mm in from edge of board
- C = Bottom flange stud welded pins at max. 320mm centres
- D = Transverse joints in the side boards are offset with respect to those fixed to the flange by a minimum 100mm
- E = $\leq 100\text{mm}$ Flange Width - 1 row of welded pins, $\geq 100\text{mm}$ Flange Width - 2 rows of pins required

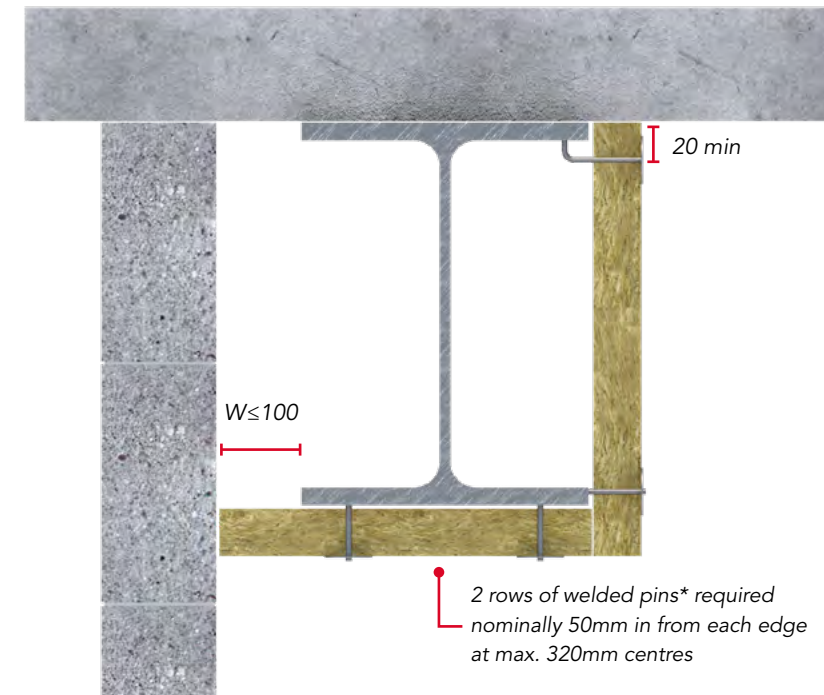


Figure 6
2-sided box

2 rows of welded pins* required
nominally 50mm in from each edge
at max. 320mm centres

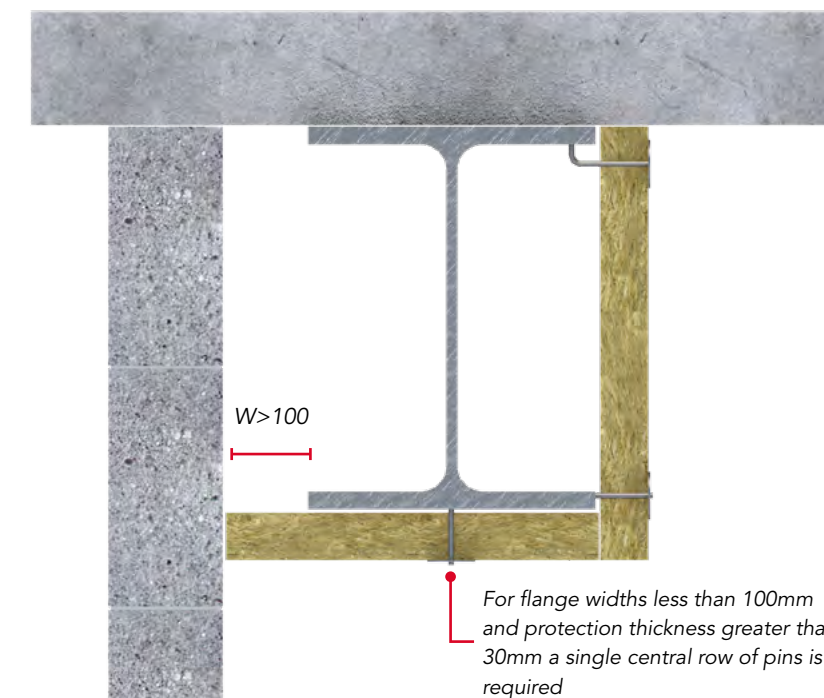


Figure 7
2-sided box - W limit is 100mm. Where $W > 100\text{mm}$ a shelf angle or similar should be fixed to the wall

* For flange widths greater than 100mm, 2 rows of pins are required, each row approx. 50mm from flange tips.

For flange widths less than 100mm
and protection thickness greater than
30mm a single central row of pins is
required



ROCKWOOL BEAMCLAD® glued joint systems

The following two systems are well established having been used for many years. The application of FIREPRO® Glue enhances the fire performance over the dry joint systems for 2, 3 and 4 hour periods. The glue joint systems are capable of providing up to 4 hours fire protection.

Fixing boards to noggins

Wherever three or four-sided protection is required, fixing to noggins is a practical option. No power supply is required

Fixing boards with stud welded pins

Situations will always occur where noggins do not afford a practical choice, e.g. for two-sided box constructions or diverse perimeter bracketing.

Stud welded pins allow the installer a simple, tested alternative to noggins.

Installation sequence (noggin fix)

Fixing noggins

Cut 120mm wide noggins to suit web depth, using same thickness material as the cover protection. For web depths of 500mm and up to (C)600/(B)604mm* use either solid noggins or 'T' shaped noggins. For stability purposes, it is recommended that the face of the 'T' noggin is made from the same thickness as the cover board but the thickness of the return into the web should be at least 50mm. These are then glued into position at 1000mm centres.

Fixing boards

Apply FIREPRO® Glue liberally to face of noggins. Quickly apply vertical boards and secure with nails/pigtail screws long enough to pierce full thickness of noggins before FIREPRO® glue forms a hardened surface.

Apply glue continuously and liberally to all board interfaces. Tightly butt to adjoining boards and nail/pigtail screw through edge joints with same length nails/pigtail screws as for noggins, at 400mm maximum centres.

*(C) denotes Column

*(B) denotes Beam

Installation sequence (stud welded pin fix)

1. Fit stud welded pins (2.7mm diameter).
2. A selection of pins should be mechanically tested by bending from the vertical and returning it to the original position.
3. 28mm sprung steel non-return washers to secure boards.
4. Apply FIREPRO® Glue to all board-to-board joints.
5. Offer up flange boards and nail/pigtail screw through glued corner joints at 400mm maximum centres.
6. If using faced boards, apply foil or scrim tape over joints for uniformity of appearance.

For A/V charts, see Charts 1 and 2 (Stud Welded).

Typical details

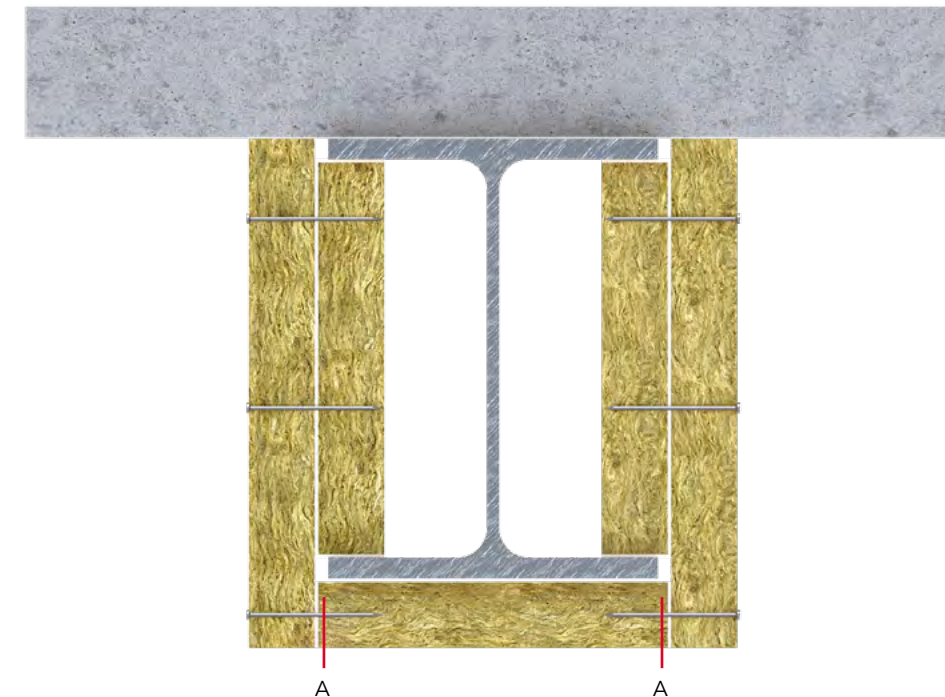


Figure 8
3-sided box, noggins to project slightly beyond flange

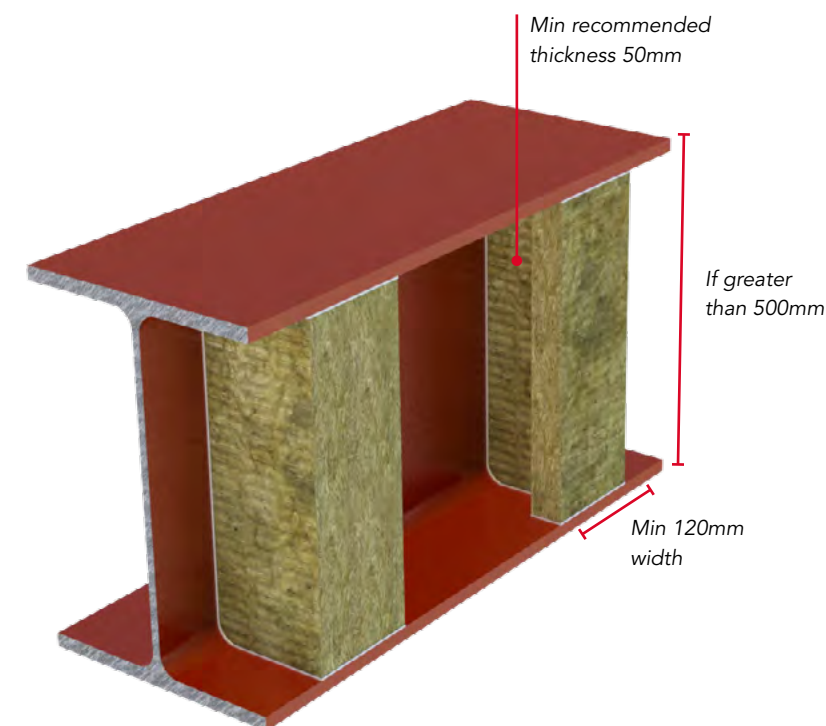


Figure 9
Full depth noggin or 'T' noggin for web depths greater than 500mm, up to 604mm for beams and 600mm for columns



Fixing patterns

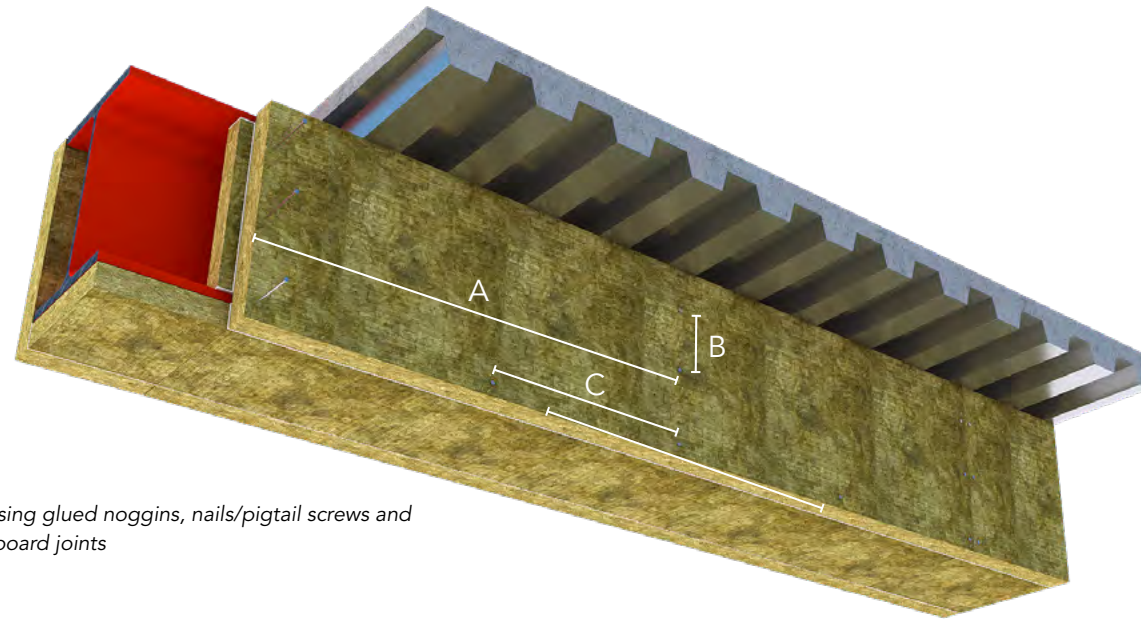


Figure 10

Fixing method using glued noggins, nails/pigtail screws and glued board-to-board joints

Dimensions

A = Noggins at max. 1000mm centres

B = Nails/pigtail screws at max. 150mm centres

C = Nails/pigtail screws at max. 400mm centres (max. 50mm from edge of board joint)

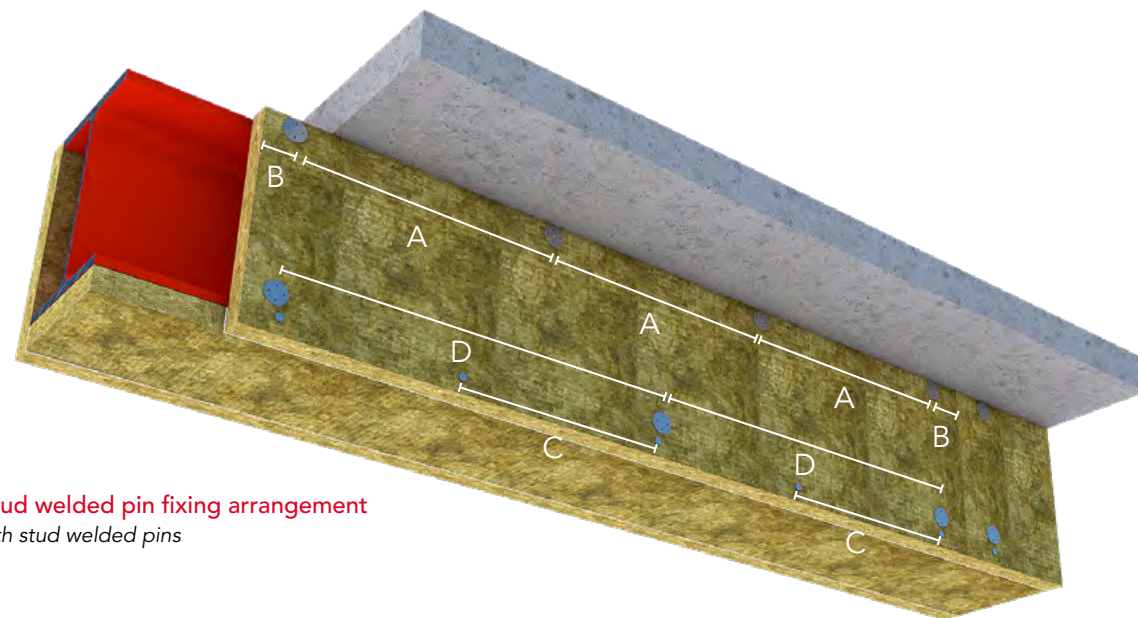


Figure 11 - Stud welded pin fixing arrangement

3-sided box with stud welded pins

Dimensions

A = Stud welded pins at 320mm centres

B = Stud welded pins at max. 50mm from edge of board

C = Nails at max. 400mm centres

D = Stud welded pins at 320mm centres

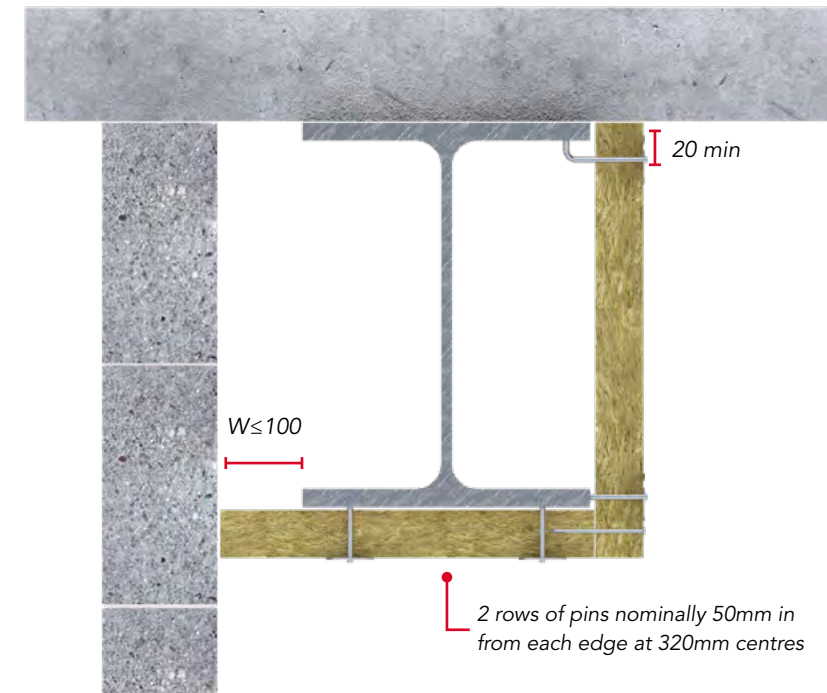


Figure 12

2-sided box

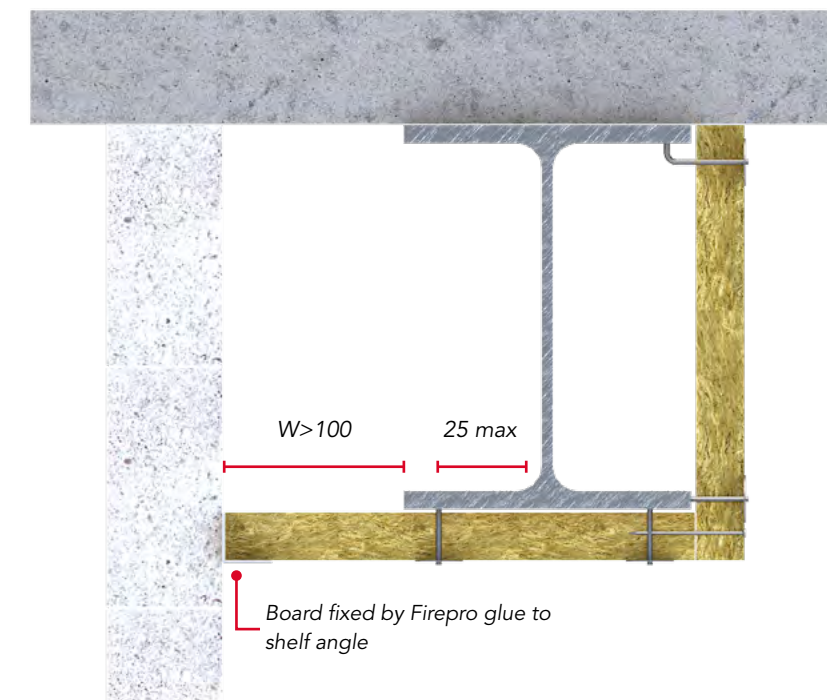


Figure 13

2-sided box - W. Limit is 100mm. For $W > 100\text{mm}$, a shelf angle or similar should be fixed to the wall

* For flange widths greater than 100mm, 2 rows of pins are required, each row approx. 50mm from flange tips.



Fire resistance period (hours)	Section factor A/V (m⁻¹)	Structural Element
1/2	350	A
1	350	A
1 1/2	307	A
2	124	A
2	150	B-150
2	177	C-177
2	204	D-204
2	260	E-260
2	317	F-317
2	350	G-350
3	57	A
3	68	B-68
3	80	C-80
3	92	D-92
3	116	E-116
3	140	F-140
3	165	G-165
3	190	H-190
3	215	I-215
3	241	J-241
4	51	C
4	59	D-59
4	74	E-74
4	90	F-90
4	105	G-105
4	121	H-121
4	137	I-137
4	153	J-153

Figure 1 is a chart showing the relationship between fire resistance period (hours) and section factor A/V (m^{-1}). The x-axis represents fire resistance period in hours, ranging from 0.5 to 4. The y-axis represents section factor A/V in m^{-1} , ranging from 0 to 360. The chart is divided into several regions labeled A, B, C, D, E, F, G, H, I, J, and K, each corresponding to a specific fire resistance period and section factor range.

Fire resistance period (hours)	Section factor A/V (m^{-1})	Region
0.5	0 to 350	A
1	0 to 350	A
1.5	0 to 196	A
1.5	196 to 255	B-255
1.5	255 to 325	C-325
1.5	325 to 350	D-350
2	0 to 82	A
2	82 to 102	B-102
2	102 to 124	C-124
2	124 to 147	D-147
2	147 to 198	E-198
2	198 to 258	F-258
2	258 to 329	G-329
2	329 to 350	H-350
3	0 to 46	B
3	46 to 55	C-55
3	55 to 64	D-64
3	64 to 83	E-83
3	83 to 103	F-103
3	103 to 124	G-124
3	124 to 147	H-147
3	147 to 172	I-172
3	172 to 199	J-199
4	0 to 52	E
4	52 to 64	F-64
4	64 to 76	G-76
4	76 to 89	H-89
4	89 to 103	I-103
4	103 to 117	J-117
4	117 to 130	K

A = 25mm B = 30mm C = 35mm D = 40mm E = 50mm
F = 60mm G = 70mm H = 80mm I = 90mm J = 100mm

In practice, a degree of wastage would be expected and as such, it would be prudent to make an allowance for this when placing an order. As a very approximate guide, the coverage rate of a 17kg tub of FIREPRO® Glue would be 35m² of applied board.

The diagram illustrates the application of Firepro® Glue for a pigtail joint. A horizontal section of a fire-resistant board is shown on the left, and a vertical section is on the right. The glue is applied in a zigzag pattern along the joint. A red vertical line indicates the glue application area. A red dot on the horizontal section indicates the location of a pigtail screw. A blue pigtail screw is shown passing through the horizontal section into the vertical section. The text 'Screw length = minimum 2 x thickness of cover board - 5mm' is written above the horizontal section. The text 'Pigtail screws at 150 or 200mm nominal centres (see system options)' is written below the horizontal section. The text 'FIREPRO® Glue' is written above the vertical section.

Screw length = minimum 2 x thickness of cover board - 5mm

FIREPRO® Glue

Pigtail screws at 150 or 200mm nominal centres (see system options)

Figure 30


FIREPRO®
Glue

ROCKWOOL BEAMCLAD® thickness (mm)	Square butt joint
25	0.09
30	0.11
35	0.13
40	0.15
50	0.19
60	0.22



Table 2: Universal beams A/V table (as per 2006)

Designation serial size	Mass per metre (kg)	Depth per section D (mm)	Width per section B (mm)	Thickness web t (mm)	Flange T (mm)	Area of section (cm ²)	m ⁻¹	m ⁻¹
914x419	388	921.0	420.5	21.5	36.6	494.5	45	55
	343	911.4	418.5	19.4	32.0	437.5	50	60
914x305	289	926.6	307.8	19.6	32.0	368.8	60	65
	253	918.5	305.5	17.3	27.9	322.8	65	75
	224	910.3	304.1	15.9	23.9	285.3	75	85
	201	903.0	303.0	15.2	20.2	256.4	80	95
838x292	226	850.9	293.8	16.1	26.8	288.7	70	80
	194	840.7	292.4	14.7	21.7	247.2	80	90
	176	834.9	291.6	14.0	18.8	224.1	90	100
762x267	197	769.6	268.0	15.6	25.4	250.8	70	85
	173	762.0	266.7	14.3	21.6	220.5	80	95
	147	753.9	265.3	12.9	17.5	188.1	95	110
686x254	170	692.9	255.8	14.5	23.7	216.6	75	90
	152	687.6	254.5	13.2	21.0	193.8	85	95
	140	683.5	253.7	12.4	19.0	178.6	90	105
	125	677.9	253.0	11.7	16.2	159.6	100	115
610x305	238	633.0	311.5	18.6	31.4	303.8	50	60
	179	617.5	307.0	14.1	23.6	227.9	70	80
	149	609.6	304.8	11.9	19.7	190.1	80	95
533x210	122	544.6	211.9	12.8	21.3	155.8	85	95
	109	539.5	210.7	11.6	18.8	138.6	95	110
	101	536.7	210.1	10.9	17.4	129.3	100	115
	92	533.1	209.3	10.2	15.6	117.8	110	125
	82	528.3	208.7	9.6	13.2	104.4	120	140
457x191	98	467.4	192.8	11.4	19.6	125.3	90	105
	89	463.6	192.0	10.6	17.7	113.9	100	115
	82	460.2	191.3	9.9	16.0	104.4	105	125
	74	457.2	190.5	9.1	14.5	95.0	115	135
	67	453.6	189.9	8.5	12.7	85.4	130	150
	82	465.1	153.5	10.7	18.9	104.5	105	120
457x152	74	461.3	152.7	9.9	17.0	95.0	115	130
	67	457.2	151.9	9.1	15.0	85.4	125	145
	60	454.7	152.9	8.0	13.3	75.9	140	160
	52	449.8	152.4	7.6	10.9	66.5	160	180
	74	412.8	179.7	9.7	16.0	95.0	105	125
406x178	67	409.4	178.8	8.8	14.3	85.5	115	140
	60	406.4	177.8	7.8	12.8	76.0	130	155
	54	402.6	177.6	7.6	10.9	68.4	145	170
	46	402.3	142.4	6.9	11.2	59.0	160	185
406x140	39	397.3	141.8	6.3	8.6	49.4	190	215
	67	364.0	173.2	9.1	15.7	85.4	105	125
356x171	57	358.6	172.1	8.0	13.0	72.2	120	145
	51	355.6	171.5	7.3	11.5	64.6	135	160
	45	352.0	171.0	6.9	9.7	57.0	150	180
	39	352.8	126.0	6.5	10.7	49.4	165	195
356x127	33	348.5	125.4	5.9	8.5	41.8	195	225
	54	310.9	166.8	7.7	13.7	68.4	115	140
305x165	46	307.1	165.7	6.7	11.8	58.9	135	160
	40	303.8	165.1	6.1	10.2	51.5	150	185
	48	312.7	102.4	6.6	10.8	41.8	175	200
305x127	42	308.9	101.9	6.1	8.9	36.3	200	230
	37	304.8	101.6	5.8	6.8	31.4	225	255
	43	259.6	147.3	7.3	12.7	55.1	120	150
254x146	37	256.0	146.4	6.4	10.9	47.5	140	170
	31	215.5	146.1	6.1	8.6	40.0	165	200
254x102	28	260.4	102.1	6.4	10.0	36.2	175	200
	25	257.0	101.9	6.1	8.4	32.2	190	225
	22	254.0	101.6	5.8	6.8	28.4	220	255
203x133	30	206.8	133.8	6.3	9.6	38.0	145	180
	25	203.2	133.4	5.8	7.8	32.3	170	210

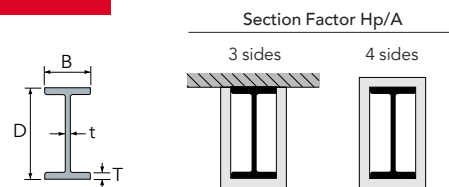

Determining protection thickness

The table opposite indicates the effect on A/V for three and four sided schemes Determine A/V factor from the table or by calculating for other exposure situations, ensuring the correct mass per metre is used.

Establish the period of fire protection required.

For A/V factors in excess of 300, contact ROCKWOOL for advice on both thicknesses and fixing methods preferred.

Bracing members: These do not generally require protection. If required as an essential element to the fire resistance, use A/V not greater than 200 m-1.

Where steel beams are fixed to composite steel and concrete decks, the profiled re-entrant void may not need additional protection if allowances for board thickness or steelwork section factor are made.

See the ASFP Yellow Book A.3.5 for current independent guidance.

Profiled re-entrant voids above steel beams will need to be infilled-

- Where steel beams are positioned to form a continuation of a compartment wall
- Where non-composite beams support a trapezoidal steel deck

FIREPRO® Linear and Trapezoidal Firestop systems have been developed to provide up to 4 hours fire stopping at the junctions of compartment walls and floors and can be manufactured to suit the trapezoidal/dovetail profile.

General notes for systems

Ensure steel is free from grease, dust or loose particles where noggins are to be glued or pins welded.

Dry off steelwork where large water droplets are present. Steel damp to the touch is acceptable.

Ensure that all noggins have the correct friction fit. Avoid excessive interference that may cause noggins to bend.

Fix additional noggins (if required) at beam ends, beam-to-beam joints and large penetrations. For stud welded pin systems it may be necessary to introduce soldier noggins into webs behind board to board joints to increase stability of the system on steelwork with large web depths (up to 603mm).

For glued system options ensure that all noggin-to-beam, noggin to-board and board-to-board surfaces are glued, and that the required setting time is allowed.

Remove any excess glue for neatness.

Any localised board shaping to be made at the point of installation should be carried out with a sharp knife or fine-toothed saw.

Avoid 'nuisance dust' from cutting operations lying on boards prior to installation Always use sharp-edged cutting tools.

The length of all nails used should be at least twice the thickness of the board being fixed.

Pigtail screw length should be twice the thickness of the board being fixed, less 5mm.

All board to board joints must be tightly butted.

Vapour barriers

Glass-reinforced aluminium foil-faced ROCKWOOL BEAMCLAD® A/F provides an excellent vapour seal. For integrity of the foil, all edges should be taped (with a minimum 75mm wide) plain foil tape. Idenden T 303 tape is recommended as being suitable. Taped joints also prevent damage to foil edges during construction.

Board joints (glued)

No glue is required where boards meet wall or soffit surfaces, except in cases where a temporary fix to flange faces may be advantageous to the work sequence. Close contact between boards at joints is always essential.

Painted steel

Painting of structural steelwork is not always essential for corrosion protection. BS 8202: Part 1: 1995 permits the use of unpainted steel which is both interior to the building and in an area which will be constantly heated.

ROCKWOOL BEAMCLAD® thickness

In selecting ROCKWOOL BEAMCLAD® thicknesses, due consideration must be given to the required period of fire resistance and the A/V value of the steel sections concerned.

Supply

ROCKWOOL BEAMCLAD® slabs are supplied on pallets, shrink-wrapped in polyethylene. Pigtail screws are available from ROCKWOOL stockists. Welded pins and sprung steel non-return washers are available from external suppliers.

References

ROCKWOOL BEAMCLAD® systems are part of the ROCKWOOL FIREPRO® range of fire stopping and fire protection range. A range of building solutions to prevent fire spread and protect the structural integrity of the building.



Section 2 – Building services

Building services are an essential part of nearly every building, whether it's the distribution of cold and warm air through HVAC systems or providing active measures of fire protection through sprinkler systems they play an important role in all building types.

As building services often reach out to all parts of a building it is common for these services to pass through compartment walls and floors. In addition, some building services like smoke extract systems or sprinkler systems provide active measures of fire protection which often require their own level of fire resistance.

Ensuring that building services can operate safely and do not contribute towards the spread of fire within the building are key considerations for any fire safety strategy.

ROCKWOOL® provide a range of products which have been specially designed for fire protecting ductwork systems, sprinkler and service pipes for periods up to 2 hours on ductwork and 4 hours on service pipes.



Fire Tube

FIREPRO® DuctRock

Core products



Fire Duct Systems



RockLap H&V Pipe Sections



FIREPRO® DuctRock



FIREPRO® Fire Tube

Useful documents and standards

ASFP Technical Guidance Document – TGD 18: Code of practice for the installation & inspection of fire resisting duct systems

ASFP Blue Book: Fire Resisting Ductwork

ASFP Grey Book: Fire and smoke resisting dampers

ASFP: Ensuring best practice for passive fire protection in buildings

BS 476-24: Fire test on building materials and structures. Method for determination of the fire resistance of ventilation ducts

BS EN 1366-1: Fire resistance test for service installations. Ventilation ducts

BS EN 1366-8: Fire resistance test for service installations. Smoke extraction ducts

BS EN 1363-1: Fire resistance tests. General requirements


BS EN 13501-3: Fire classification using test data from resistance to fire tests on products and elements used in building service installations. Fire ducts and dampers

BS EN 13501-4: Fire classification using test data from resistance to fire tests on components of smoke control systems

ASFP (Association for Specialist Fire Protection) guidance documents can be sourced at www.asfp.org.uk



FIREPRO® Fire Duct Systems

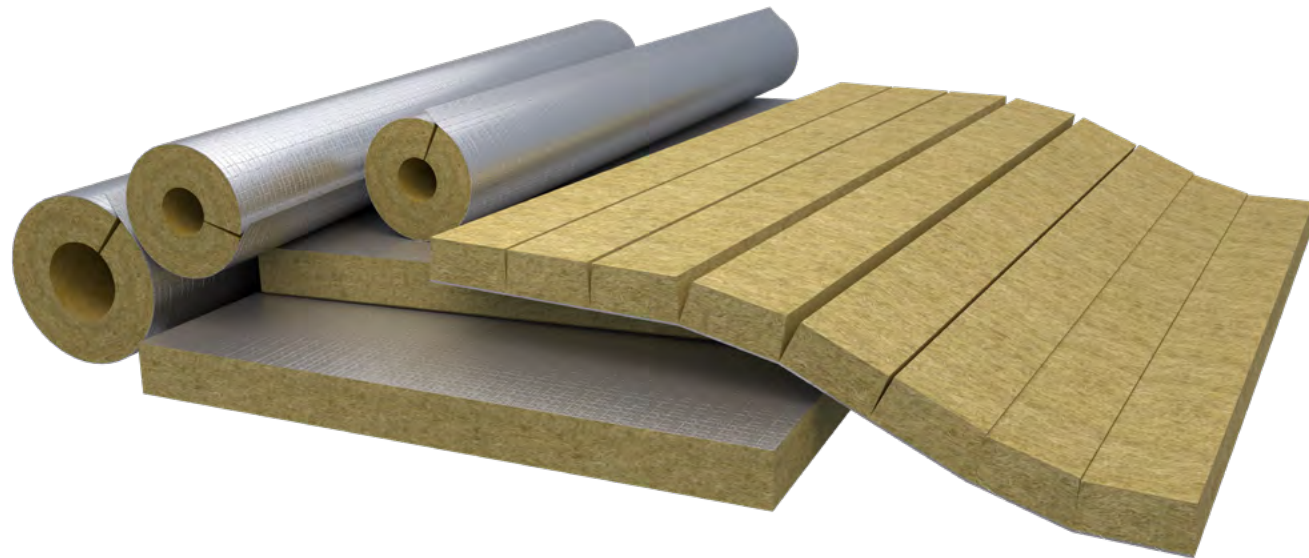

Description

Three products are available in the Fire Duct Systems range:

- Fire Duct Slab – for rectangular ducts
- Fire Duct Section – for circular ducts between 60mm and 356mm diameter
- Fire Duct PSM – for circular ducts greater than 406mm diameter

All three Fire Duct products are supplied faced on one side with reinforced aluminium foil.

Fire Duct Slab is a high density insulation slab faced with reinforced aluminium foil.

Fire Duct Section is a high density pre-formed pipe section faced with reinforced aluminium foil.

Fire Duct PSM is a high density slab with factory machined grooves to facilitate installation around a circular duct, faced with reinforced aluminium foil.

Advantages

- Quick and easy to install
- Fully certified to BS 476–24 (duct types A and B)
- ½, 1, 1½ and 2hour fire protection for stability, integrity and insulation
- Choice of fixing options
- Single layer, enabling verification of system installation
- Space efficient, non-brittle, strong and safe
- Multi-role insulation: fire protection, acoustic and thermal
- Can be installed on standard DW144/42 ductwork

Applications

System options – Rectangular ducts

Welded pin fixing method

Attachment by welded pins allows extremely rapid installation with slab joints simply butted together.

Welded pins are generally spaced at 350mm maximum centres along the length of the duct and at 500mm maximum centres across the width and depth of the duct. Pins are required on all four sides of vertical ducts, but may be omitted from the top face of horizontal ducts, see Figures 5 and 6 on page 10.

Longitudinal corner joints fixed with pigtail screws at 250mm maximum centres (screw length to be 2 x slab thickness). Side wall slabs must overlap top and bottom slabs (as shown). Cross joints bonded with FIREPRO® Glue.

Alternative joint methods

Instead of pigtail screws, longitudinal joints can be fixed with FIREPRO® Glue and nails, at 500mm max. centres.

Instead of glue, cross joints can be protected with centrally positioned, 100mm wide Fire Duct strips fixed along both edges with pigtail screws at 250mm max. centres.

Mitre-joint fixing methods

The use of mitre-joints at slab corners allows installation in situations where welding may not be practical.

Mitre-joint method

All joints bonded with ROCKWOOL FIREPRO® Glue. Longitudinal corner joints secured with nails while ROCKWOOL FIREPRO® Glue cures.

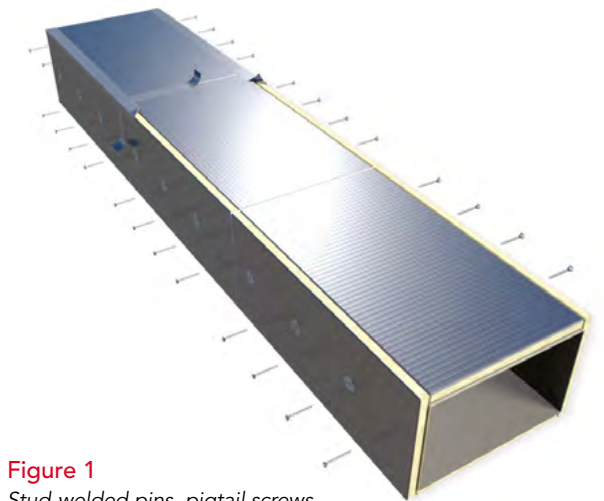


Figure 1
Stud-welded pins, pigtail screws

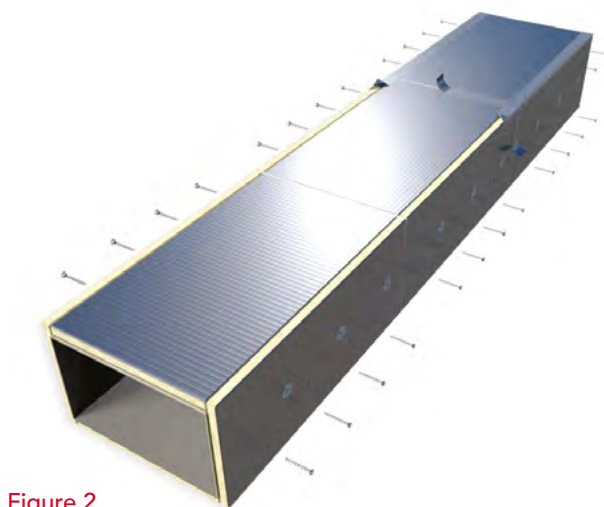


Figure 2
Stud-welded pins, nail and glue

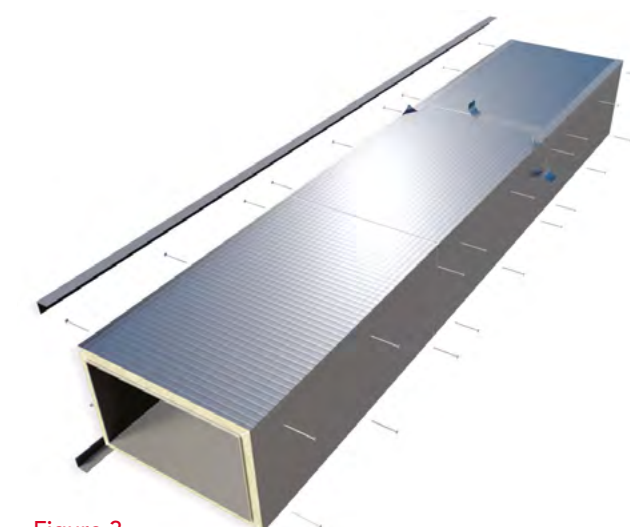


Figure 3
Mitre joint, nails and glue



System options – Circular ducts

Fire Duct Section

Circular steel ducts of between 60mm and 356mm diameter may be protected using Fire Duct Section. Fire Duct Section must be glued with ROCKWOOL FIREPRO® Glue at the joints and in the grooves. Steel bands or wires must be fitted circumferentially to the system at 300mm nominal centres to hold all joints and grooves tightly closed while the glue cures.

Where required, cover strips and bearer protection pieces are to be cut from Fire Duct Section (or Fire Duct PSM) of the appropriate diameter. The foil covering is to be removed from the area of Fire Duct Section immediately beneath the cover strips prior to gluing into position and securing with steel nails or pins.

All joints are to be securely taped with 75mm wide plain soft aluminium foil self-adhesive tape (Idenden type T303, or similar and approved) to maintain a continuous vapour barrier.

The hanger system is as described on page 66 of our FIREPRO® Brochure and as shown in Figures 1 and 2, with the angle bearer formed into a circular shape to suit the diameter of the duct or the Fire Duct Section (depending on whether the hanger is located inside or outside the protection).

Fire Duct Section is used to protect the drop rods as described on page 8 of this brochure. General installation principles are as otherwise described in this Product Data Sheet for Fire Duct Slab.

Fire Duct PSM

Circular steel ducts of 406mm and greater diameter may also be protected using Fire Duct PSM.

Fire Duct PSM must be glued at the joints and in the grooves with ROCKWOOL FIREPRO® Glue. Steel bands or wires must be fitted circumferentially to the system at 300mm nominal centres to hold all joints and grooves tightly closed while the glue cures.

General duct, hanger and installation details are as described for Fire Duct Section.

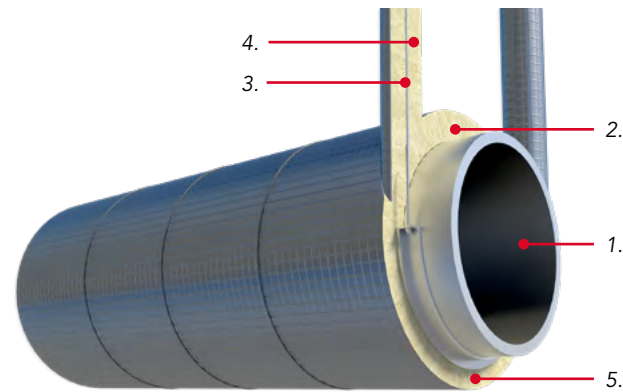


Figure 1
Fire Duct Section applied to circular duct

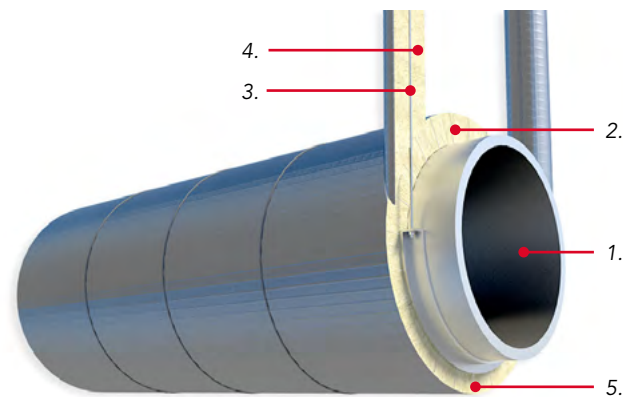


Figure 2
Fire Duct PSM applied to circular duct

Key to Figures 1 and 2

1. Circular steel duct to DW/144
2. Fire Duct Section/Fire Duct PSM
3. M10 steel drop rods at 1500mm maximum centres
4. Fire Duct Slab/Section – protection to hanger system
5. 30 x 30 x 3mm minimum steel angle bearer

Performance

Fire Duct Slab & Fire Duct PSM

Non-combustibility: Class A1 to BS EN 13501-1

Fire Duct Section

Non-combustibility: Class A2 to BS EN 13501-1

Fire resistance

Performance summary – Fire Duct Slab, Section and PSM.

Three performance criteria; stability, integrity and insulation, are required in equal measure for all ducts which pass through fire-rated walls or floors.

Fire Duct System test data

The Fire Duct products have been tested and assessed by the Loss Prevention Certification Board (LPCB) of the BRE in accordance with BS 476 – 24, 'Fire tests on building materials and structures – Methods for determination of the fire resistance of ventilation ducts'. Fire Duct products can be used to provide fire protection to horizontal, vertical, rectangular, circular, ventilation and smoke extract steel ductwork fully in accordance with BS 476 – 24, ducts 'Type A' and 'Type B', "Fire outside duct" and "Fire inside duct".

The ½, 1, 1½, and 2 hour periods of fire resistance stated in this manual are for stability, integrity and insulation in equal measure. For example, the 60 minutes duct constructions shown are certified for 60 minutes stability, 60 minutes integrity and 60 minutes insulation.

pH Neutrality

ROCKWOOL insulation is chemically compatible with all types of pipes, ducts, equipment and fittings. (Guidance is given in BS 5970 regarding the treatment of austenitic stainless steel pipework and fittings). Stone wool insulation is chemically inert. A typical aqueous extract of ROCKWOOL insulation is neutral or slightly alkaline (pH 7 to 9.5).

Standards & approval

The product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this data sheet – please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details.

Fire Duct Systems are third party approved by the Loss Prevention Council Certification board (LPCB) for performance and quality and are listed in the "Red Book" - certificate no. 022f. Certificates can be accessed online at www.rockwool.co.uk or www.redbooklive.com.

'Kitchen extract' ducts

These are subject to separate BS 476–24 requirements and are additionally covered for ½ and 1 hour protection periods.

Fire resistance (hours)	Duct type	Required Fire Duct thickness (mm)	Joint options	Hanger protection Fire Duct Slab (mm)	Hanger protection Hanger Section (mm)	Max. duct size for mitre-joint, glued system (mm)
½	HVAC & smoke extract	40	BC	40	17 x 30	1500 x 1500
½	Kitchen extract	40	BC	40	17 x 30	1500 x 1500
1	HVAC & smoke extract	40	BC	40	17 x 40	1000 x 1000
1	Kitchen extract	90	ABC	40	17 x 40	1500 x 1500
1½	HVAC & smoke extract	70	ABC	50	17 x 50	1200 x 1200
2	HVAC & smoke extract	90	ABC	60	17 x 70	1000 x 1000



Product information

Dimensions

Fire Duct Slab

- Size: 1200 x 2000mm
- Thicknesses: 40, 50, 70 and 90mm*
- Facing: reinforced aluminium foil

Fire Duct Section

- Diameters: 60 to 356mm
- Thicknesses: 30, 40 and 90mm*
- Facing: reinforced aluminium foil

Fire Duct PSM

(Made of Fire Duct Slab with factory machined grooves to suit specific duct diameters)

- Diameters: 406mm and above*
- Thicknesses: 40 and 90mm*
- Facing: reinforced aluminium foil

Fire Duct Section for use on hangers

- Nominal OD from 17mm
- Thicknesses: from 30mm*
- Facing: reinforced aluminium foil

Durability

ROCKWOOL stone wool insulation products have been proven in service for over 60 years, in a wide range of climates and degrees of exposure. ROCKWOOL insulation will generally perform effectively for the lifetime of the building, plant or structure.

Biological

ROCKWOOL stone wool is a naturally inert and rot-proof material that does not encourage or support the growth of fungi, moulds or bacteria, or offer sustenance to insects or vermin.

*Some thicknesses may be subject to minimum order quantities. Some combinations of diameter and thickness may not be available or may be subject to a minimum order quantity.

Installation instructions

Hangers, bearers and flanges

Fire Duct products are approved to provide fire protection to steel ductwork, wholly constructed using steel fixings in accordance with current B&ES specification DW/144 and superseded specification DW/142.

Where there are constructional options within DW/144 and DW/142, these are expanded upon below. These details are primarily concerned with duct joint types and the suspension method.

DW/142 flanged cross joint types J3, J4, J5 and J6 are acceptable for use with the Fire Duct System, without modification.

Fire Duct Slab, Fire Duct Section or Fire Duct PSM may be installed either outside or inside the hanger system.


Bearers will require additional protection only when positioned outside the Fire Duct layer.

Drop rods will normally be protected with Fire Duct Section or with Fire Duct Slab blocks (see Figure 4).


Alternatively, the support steelwork may be sized so that separate protection is not required. Design of this 'unprotected support' method is independent of the Fire Duct System.

Figure 3


Joint Option A - Rebated protection

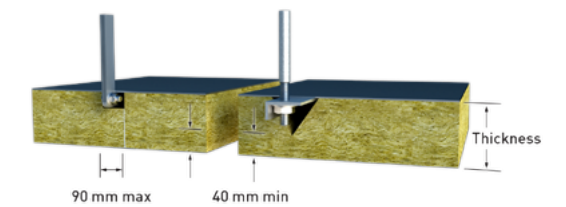

Joint Option B - Protection using 'T' section

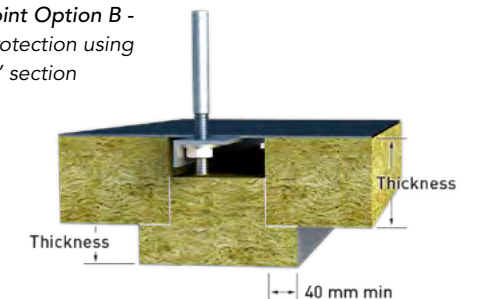

Joint Option C - Protection using block cover strip

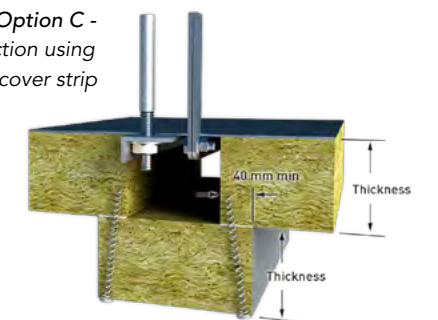

Item	Duct size (mm)		
	Up to 1500 x 1500	Up to 2000 x 2000	Up to 3000 x 3000
Max hanger centres (mm)	1500	1500	1500
Min drop rod size	M10	M10	M12
Min angle bearer (mm)	30 x 30 x 3	50 x 50 x 5	50 x 50 x 6

* DW/144 and DW/142 do not specifically cover ducts larger than 3m wide. Please contact ROCKWOOL for details (contact details on back cover).

Protection of hangers outside Fire Duct System

Hangers outside the Fire Duct System are protected by cutting a rebate into a block of Fire Duct Slab, Fire Duct PSM or Fire Duct Section.

The rebate should be no larger than necessary to accommodate the bearer. The block should be glued and pinned in position (see Figure 3, Option A) or secured using pigtail screws.

Other J Joints

If type J1 or J2 cross joints are fitted, then the joints must be upgraded to at least the J3 specification. This can be done by adding steel fixing bolts and fastenings in line with the J3 joint type. Also a minimum S3 stiffener should be fitted to the duct adjacent to the cross joint. This will upgrade the cross-sectional stiffness of the duct.

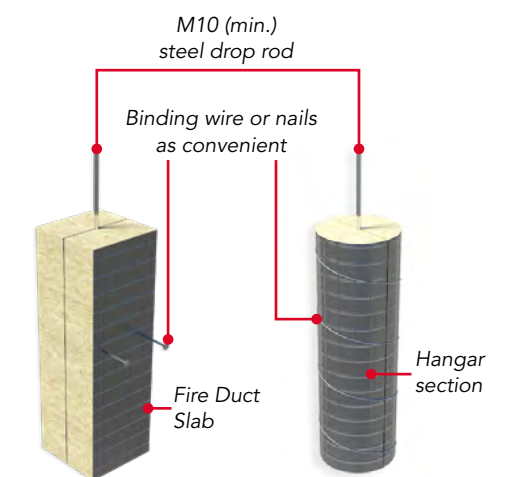


Figure 4

Isometric view of drop rod protection options



ROCKWOOL FIREPRO® Glue

ROCKWOOL FIREPRO® Glue has a pH value of 11. It is available in 300ml cartridges or 17kg tubs. Always stir the tubs before use.

Where required, 1–1.5mm of glue should be applied to each Fire Duct joint. The glue is generally applied by spatula or trowel.

Where present, any foil facing must be removed from surfaces prior to the application of FIREPRO® Glue. Take care to remove any FIREPRO® Glue from all aluminum foil surfaces with a damp cloth

Nails (for use only with mitre-joint 'glued' systems)


The nail length is to be 2 x board thickness (see Figure 7 for positions)

Pigtail screws

Pigtail screws are to be used at all corner joints where FIREPRO® Glue is not used, and to secure cross joint cover strips.

Pigtail screws are to be positioned at 250mm maximum centres, and the screw length is to be 2 x slab thickness.

For horizontal ducts, pigtail screws must be inserted horizontally.



Optional edge protection

Light gauge metal angles may be glued in position to provide optional edge protection. The metal angles must be de-greased. Small pins may be required to hold the angle to the underside of the duct.

Vapour barrier

Where a vapour barrier is required, all exposed Fire Duct edges and penetrations through the foil must be sealed using aluminium foil tape.

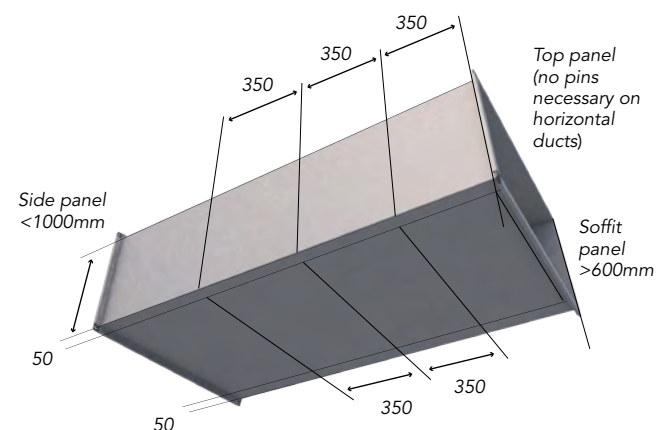


Figure 5
Steel pin arrangement where side panel does not exceed 1000mm and soffit panel does not exceed 600mm

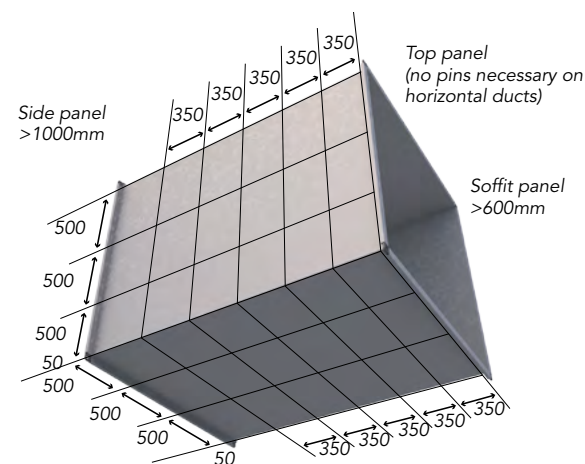


Figure 6
Steel pin arrangement where side panel is greater than 1000mm or soffit panel is greater than 600mm

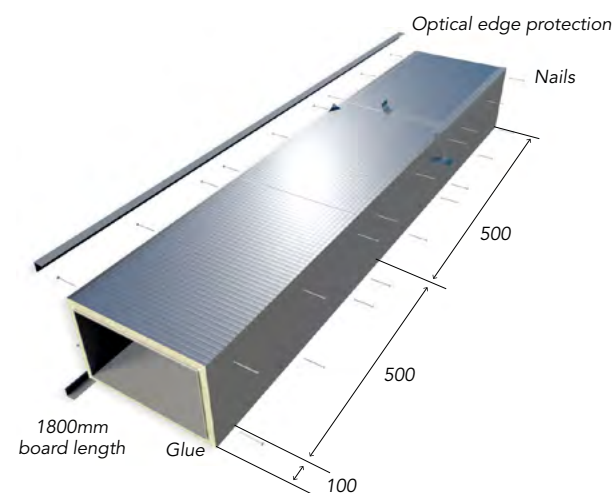


Figure 7
Rectangular ducts – 45° mitre joint system, showing installation sequence

Wall penetrations, elbows, 2 and 3-sided applications and access hatches

Wall and floor penetrations

Support to duct sides is required at all penetrations for stability purposes. This support can be provided by:

- A 30 x 30 x 2mm mild steel angle frame fixed to the duct at the penetration mid-point. Steel rivets should be used at 300mm maximum centres (Figure 8),
- Locating the duct joint at the penetration mid-point.

In all cases, low density ROCKWOOL stone wool, typically RWA45, is packed tightly into the void between the Fire Duct product and the wall opening.

120mm wide blocks of Fire Duct are glued (or secured with pigtail screws) to the duct insulation and to the wall on both sides of the penetration.

All Fire Duct to wall joints are glued. Aluminium foil is located in Fire Duct joints at wall penetrations (as shown).

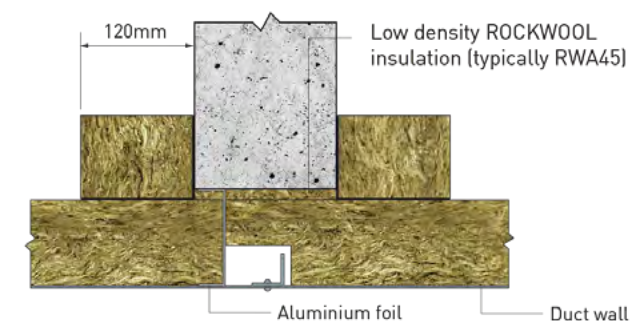


Figure 8
Steel angle frame support to duct at penetration mid point

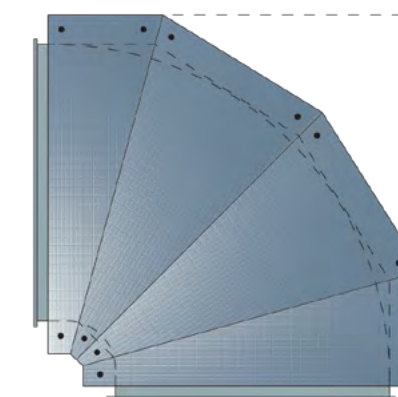


Figure 9
Typical elbow detail for rectangular ducts

Proprietary penetration seals

Where proprietary penetration seals are used, compatibility with the separating element, duct construction and Fire Duct System must be demonstrated by independent test or assessment.

Elbows (rectangular ducts)

Small elbows may simply be boxed or 'squared off'. Larger elbows may need to be protected by cutting fan shaped pieces, generally in accordance with the illustration (Figure 9).

2 and 3-sided applications (rectangular ducts)

The use of Fire Duct products incorporating welded pins is recommended for 2 and 3-sided applications.

The method illustrated (Figure 10) for three-sided applications, may also be used for two-sided applications where the duct is securely braced in the corner of a room.

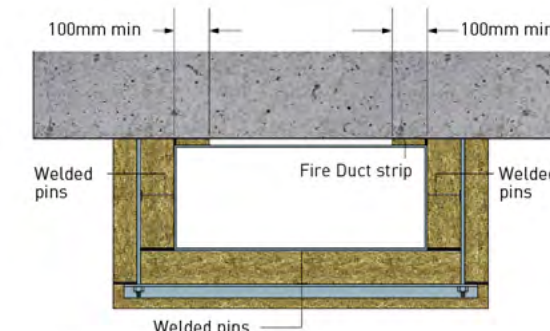


Figure 10
Three sided protection for rectangular ducts, using welded pin fixing method



Access hatches (rectangular ducts)

Steel access hatches which are constructed and fitted in accordance with DW/144 may be protected with Fire Duct Slab (Figure 11).

The Fire Duct cover may be fitted in any face of the duct. However, if the sliding cover is not in the horizontal plane the guides must be positioned so as to prevent movement of the cover due to weight, vibration etc.

The sliding cover must be a tight fit in the guides. No part of the arrangement may be within 50mm of edges or joints within the main duct protection layer of Fire Duct Slab.

All Fire Duct Slab joints (excluding sliding joints) are to be glued and pinned as previously detailed.

Access hatches (circular ducts)

Details of access hatches for circular ducts are available on request.

Handling

The Fire Duct range of products is light, easy to handle and simple to fix. The products can be cut and shaped using knives, saws, etc.


Ancillaries

Welded steel pins

Welded pins are generally spaced at 350mm maximum centres along the length of the duct and at 500mm maximum centres across the width and depth of the duct. Pins are required on all four sides of vertical ducts, but may be omitted from the top face of horizontal ducts (see Figures 5 and 6).

Details of alternative mechanically fixed pins are available from ROCKWOOL on request.

Figure 11
Removable cover panel for steel access hatch

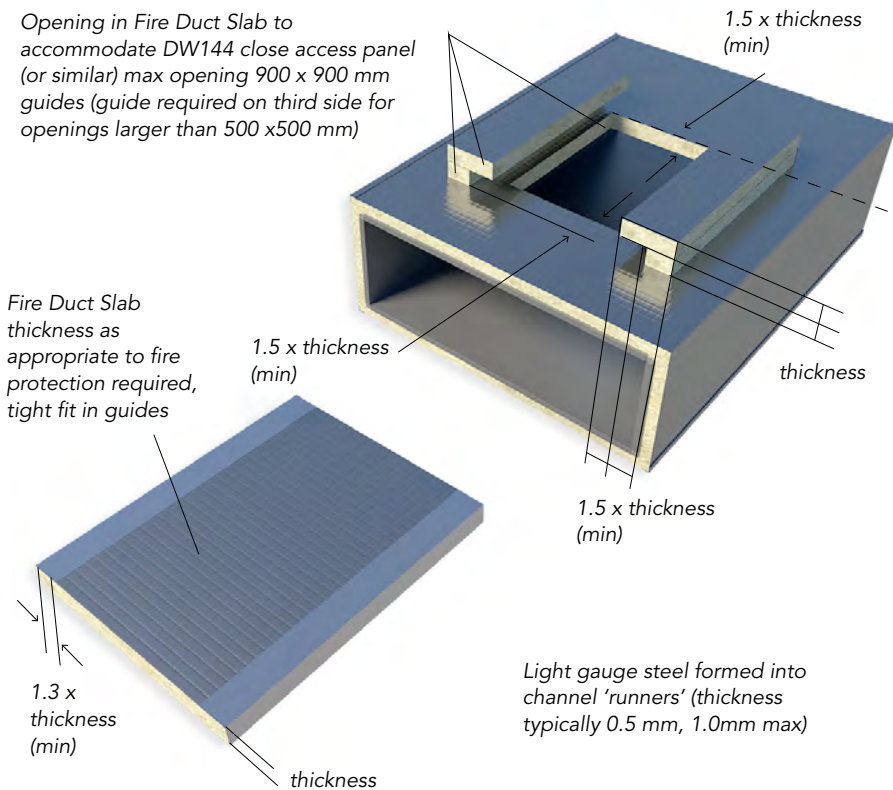

Criteria for preparation of ductwork prior to insulation

Fire Duct products are certified to provide fire protection to ductwork conforming to Construction Details 1 to 12 in the table below and to the requirements of B&ES Specification DW/144. The table may be used as a check list for on-site verification of ductwork construction.

Construction detail	Requirement	Details of modification where needed
1. Duct sheeting	Rigid steel (zinc-coated, alu-zinc coated, black or stainless)	
2. Sheet thickness	0.8mm or greater. See DW/144 for ducts larger than 1500mm	
3a. Welded pin fixing methods	Up to 1500 x 1500 mm: no additional system modifications Up to 2000 x 2000mm: increase angle bearer size to 50 x 50 x 5mm min Up to 3000 x 3000mm: increase angle bearer size to 50 x 50 x 6mm min Increase drop rod diameter to M12 min Up to 4000 x 4000mm: 50 x 50 x 6mm min. bearer. M12 min. drop rod Incorporate additional drop rod mid-width through duct and bearer* Weld (or fasten with with nuts and large washers) M15 min. strengthening rod. at mid-width of each flanged joint and penetration point to maintain cross section Seal all holes with mastic Above 4000 x 4000mm: 50 x 50 x 6mm bearer. M12 min. drop rod Incorporate additional drop rods through duct and bearer to ensure 1500mm max. spacing along bearer*. Weld (or fas- ten with nuts and large washers) M15 min. strengthening rod at each flanged joint and penetration point to ensure 1500mm max. spacing along joint. Seal all holes with mastic. *Additional drop rods to pass through duct and bearer. Rods to support bearer. 'Top' of duct to be held in position with steel nuts and large steel washers	
3b. Mitre-joint fixing methods		If duct dimensions exceed those shown, use welded steel pins as per Fire Duct system manual (see item 3a)
½ hr HVAC & smoke extract	1500mm x 1500mm	
½ hr kitchen extract	1500mm x 1500mm	
1 hr HVAC & smoke extract	1500mm x 1500mm	
1 hr kitchen extract	1500mm x 1500mm	
1½ hr HVAC & smoke extract	1200mm x 1200mm	
2 hr HVAC & smoke extract	1000mm x 1000mm	
4. Flanged cross joint	Type J3, J4, J5 or J6 to HVAC specification DW/142 and DW/144	Strengthen joints (contact ROCKWOOL)
5. Joint seal	May be included or omitted	
6. Constructional fixings	Steel	
7. Bearers	30 x 30 x 3mm (min.) steel angle. See item 3a for ducts larger than 1500mm	



Construction detail	Requirement	Details of modification where needed
8. Drop rods		
9. Drop rod anchors		
Fixed through steel suspension frame	Steel frame to be independently fire rated	Fire protect steelwork
Fixed into concrete	Anchors to have confirmed fire rating. M10 (min.) mild steel. See item 3a for ducts larger than 2000mm	If fire rating is un-confirmed and anchor is all-steel, ie without plastic or chemical components; affix 300mm x 300mm collar of unfaced Fire Duct Slab to soffit with FIREPRO® Glue, keeping anchor central. Collar thickness to equal duct encasement layer. Optional self-tapping screws may be used to support collar. Glue adjacent Fire Duct drop rod protection to collar.
10. Spacing of suspension system		
10a. Horizontal ducts	1500mm max. centres	
10b. Vertical ducts: 2 or 3 sided protection	1500mm max. centres	Install additional supports
10c. Vertical ducts: 4 sided protection	Support at every floor (4 m max. centres)	
11. Stiffening of duct at penetration detail	Duct flange or 30 x 30 x 3mm steel angle frame fixed with steel fixings at 300mm max. centres. To be positioned within the width of the penetration. See item 3a for ducts larger than 3000mm.	Install steel angle frame
12. Compartment wall	Fire rated masonry, concrete, brick, block, plasterboard or other fire rated construction	

Specification clauses

Typical specification clauses for rectangular ducts to be read in conjunction with system options on pages 4 and 5

Welded pin fixing method

1. All ductwork is to be insulated with*mm ROCKWOOL Fire Duct Slab, having a factory applied reinforced aluminium foil to one face and complying with Building Regulations Class ‘O’ requirements.
2. The Fire Duct Slab is to be fixed to the duct using 2.5mm diameter welded steel pins and 38mm spring steel washers in accordance with the ROCKWOOL Product Data Sheet ‘Fire Duct systems’.
3. The foil facing is to be removed from any surfaces to which FIREPRO® Glue is to be applied.
4. All corner joints are to be fixed with pigtail screws at 250mm maximum centres. Screw length is to be 2 x slab thickness.
5. All cross joints are to be filled with FIREPRO® Glue and held tightly closed.
6. Drop rods and bearers are to be at 1500mm maximum centres and to be M10 steel rod and 30 x 30 x 3mm steel angle respectively. Ductwork is to be generally in accordance with B&ES Specification DW/144.
7. Drop rods and exposed bearers are to be insulated with*mm Fire Duct Slab or† x*mm Fire Duct Section, as appropriate. Rebates or cover pieces are to be used at duct flange and bearer locations according to site conditions and subject to ROCKWOOL approval.
8. Where a vapour barrier is required, all exposed Fire Duct edges and penetrations through the foil should be sealed using soft self-adhesive aluminium foil tape (Idenden type T303, or similar and approved).

Alternative longitudinal joints

Delete clauses 3 and 5 in Method 1 above, and insert new clause 5:

1. All joints are to be filled with ROCKWOOL FIREPRO® Glue and held tightly closed. Use nails at 500mm centres at corner joints to aid this process.

Alternative cross joints

Delete clauses 3 and 5 in Method 1 above, and insert new clause 5:

1. All cross joints are to be covered with centrally positioned 100mm wide strips of Fire Duct Slab of the same thickness as the insulation. The cover strips are to be fixed along both edges using pigtail screws at 250mm max. centres.

* Insert Fire Duct Slab insulation thickness required. † Insert appropriate overall diameter.

Mitre-joint fixing method

1. All ductwork is to be insulated with*mm Fire Duct Slab, having a factory applied reinforced aluminium foil to one face and complying with Building Regulations Class ‘O’ requirements.
2. The Fire Duct joints at ductwork corners are to be 45° mitred. Square butt joints to be used elsewhere.
3. The foil facing is to be removed from any surfaces to which FIREPRO® Glue is to be applied.
4. All joints are to be filled with FIREPRO® Glue and held tightly closed.
5. All mitred joints are to be held tightly closed with nails (length = approx. 2 x Fire Duct Slab thickness) until the glue has fully cured. 2 nails juxtaposed at 90° are to be located at 3 points per 1200mm length of mitred joint and at 5 points per 2000mm length.
6. Drop rods and bearers are to be at 1500mm maximum centres and to be M10 steel rod and 30 x 30 x 3mm steel angle respectively. Ductwork is to be generally in accordance with B&ES Specification DW/144.
7. All drop rods and exposed bearers are to be insulated with*mm Fire Duct Slab or† x*mm Fire Duct Section, as appropriate. Rebates or cover pieces are to be used at duct flange and bearer locations according to site conditions and subject to ROCKWOOL approval.
8. Where a vapour barrier is required, all exposed Fire Duct edges and penetrations through the foil should be sealed using soft self- adhesive aluminium foil tape.

NBS specifications

ROCKWOOL Fire Duct Systems are associated with the following NBS clauses:

U90 General ventilation - domestic

- 490 Site applied insulation to ductwork

Y30 Mechanical thermal insulation

- 340 Mineral fibre slabs insulation





RockLap H&V Pipe Sections



Description

RockLap H&V Sections are pre-formed sections of stone wool insulation. Manufactured pre-slit and provided with a factory applied foil facing complete with integral self-adhesive lap.

Sizes available:
Please see the table on page xx.

Advantages

- Resilient, high performance barrier provided by one-piece, reinforced foil with integral lap
- Fast and simple installation reduces costs and time on site
- Tape requirement reduced
- European Reaction to Fire Classification of A2L, s1-d0

Applications

RockLap H&V Pipe Sections are strong lengths of pre-formed insulation with a one piece, factory applied foil facing with integral self-adhesive lap. The integral lap ensures fast and easy installation: just snap the sections onto the pipe, peel off the backing tape and smooth down for a completely sealed joint.

Performance

Standards and approvals

ROCKWOOL H&V Pipe Sections are CE marked in accordance with BS EN 14303. For more information please visit www.rockwool.co.uk/DOP

RockLap H&V Pipe Sections conform to BS 3958-4, 'Bonded preformed stone wool pipe sections' and can be used to satisfy BS 5422: 'Method for specifying thermal insulating materials.....'.

The product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this data sheet – please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details.

Fire

RockLap H&V Pipe Sections are rated Euroclass A2L*-s1,d0.

*Classifications for linear pipe thermal insulation products are followed by the sub-index 'L' (for example, A2L).

Thermal

The specific heat of ROCKWOOL stone wool is 0.84 kJ/kgK (nom.) at 20°C.

Thermal conductivity and thermal loss

Temperature °C	*Curve 1 (W/mK)	*Curve 2 (W/mK)
10	0.033	0.034
50	0.037	0.039
100	0.044	0.048
150	0.052	0.056

*The thermal conductivity curve used depends upon the size of the pipe section. For further information please refer to the DOP.

Note: Due to the low emissivity of aluminium, heat losses, which depend upon the diameter, thickness and temperature of the pipe to be insulated, are reduced by approx. 9% by using aluminium faced sections compared with painted or PVC faced sections.

Consider a 169 mm O.D. hot water pipe running at 75°C with an ambient temperature of 15°C insulated with 50 mm thick RockLap H&V Pipe Section:

Cladding type	Emissivity (ε)	Outer surface temp (°C)	Heat loss (W/m)
Aluminium	0.05	24.4	27
Cloth	0.90	19.5	29



Product information

Table 8: (BS5422:2009)

Minimum thickness of ROCKWOOL RockLap H&V to prevent condensation. Taken from BS 5422 Table 8, ambient air temperature 25°C, 80% rh, ε=0.05

Outside diameter of steel pipe on which insulation has been based (mm)	Temperature of contents (°C)					
	Temperature of contents +10°C		Temperature of contents +5°C		Temperature of contents 0°C	
	Calculated thickness (mm)	Advised thickness (mm)	Calculated thickness (mm)	Advised thickness (mm)	Calculated thickness (mm)	Advised thickness (mm)
17	16	20	22	25	28	30
21	17	20	24	25	30	30
27	19	20	26	30	32	35
33	20	20	27	30	34	35
42	21	25	29	30	37	40
48	22	25	31	35	39	40
60	24	25	33	35	41	45
76	26	30	36	40	46	50
89	28	30	38	40	48	50
102	29	30	40	40	50	50
114	30	30	41	45	52	60
140	31	35	43	45	55	60
169	33	35	46	50	58	60
219	35	35	49	50	62	70
245	36	40	51	60	64	70
273	37	40	52	60	66	70
324	39	40	55	60	70	70
356	40	40	56	60	71	80
406	41	45	58	60	74	80
456	43	45	60	60	76	80
508	44	45	61	70	78	80
558	45	45	63	70	80	80
610	46	50	64	70	82	90

Table 15: (BS5422:2009)

Indicative thickness of insulation for non-domestic heating services to control heat loss – low emissivity outer surfaces (ε=0.05).

Outside diameter of steel pipe on which insulation has been based (mm)	Hot face temperature (°C)								
	Thickness of ROCKWOOL RockLab H&V Pipe Section (mm)								
	75			100			125		
	Calculated thickness (mm)	Advised thickness (mm)	Heat loss (W/m)	Calculated thickness (mm)	Advised thickness (mm)	Heat loss (W/m)	Calculated thickness (mm)	Advised thickness (mm)	Heat loss (W/m)
17.2	24	25	8.90	24	25	13.34	24	25	17.92
21.3	28	30	9.28	30	30	13.56	30	30	18.32
26.9	31	35	10.06	37	40	13.83	37	40	18.70
33.7	33	35	11.07	44	45	14.39	46	50	19.20
42.4	35	35	12.30	48	50	15.66	64	70	19.25
48.3	37	40	12.94	49	50	16.67	67	70	20.17
60.3	39	40	14.45	57	60	18.25	71	80	21.96
76.1	44	45	16.35	60	60	20.42	76	80	24.21
88.9	45	45	17.91	62	70	22.09	79	80	25.99
114.3	47	50	20.77	65	70	25.31	85	90	29.32
139.7	48	50	23.71	68	70	28.23	89	90	32.47
168.3	49	50	26.89	70	70	31.61	92	100	36.04
219.1	50	50	32.54	72	80	37.66	96	100	42.16
273.0	50	50	38.83	74	80	43.72	99	100	48.48

Note 1: Insulation thicknesses in this table have been calculated according to BS EN ISO 12241:2008 using standardised assumptions: horizontal pipe in still air at 15°C, emissivity of outer surface of insulated system as specified.

Note 2: Heat loss relates to the specified thickness and temperature.

Note 3: The thicknesses in this table are applicable to pipes serving commercial solar hot water panels.



Table 17: (BS5422:2009)

Indicative thickness of insulation for non-domestic hot water service areas to control heat loss – Low emissivity outer surface ($\epsilon=0.05$).

Outside diameter of steel pipe on which insulation has been based (mm)	Thickness of ROCKWOOL RockLap H&V Pipe Section (mm)		Heat loss / Wm ⁻¹
	Calculated thickness (mm)	Advised thickness (mm)	
17.2	23	25	6.60
21.3	25	25	7.13
26.9	27	30	7.83
33.7	29	30	8.62
42.4	30	30	9.72
48.3	32	35	10.21
60.3	33	35	11.57
76.1	35	35	13.09
88.9	35	35	14.58
114.3	38	40	17.20
139.7	39	40	19.65
168.3	40	40	22.31
219.1	40	40	27.52
273.0	41	45	32.40

Note 1: Insulation thicknesses in this table have been calculated according to BS EN ISO 12241:2008 using standardised assumptions: horizontal pipe at 60°C in still air at 15°C, emissivity of outer surface of insulated system as specified.

Note 2: Heat loss relates to the specified thickness and temperature.

Density

The nominal density is not less than 120kg/m³.

Other product properties

Water resistance

RockLap H&V Pipe Sections are water repellent. However, when used or stored in the open, the insulation should be protected with a waterproof covering. When used to insulate cold pipes, the joints should be sealed with foil tape to prevent condensation.

Service temperature

RockLap H&V Pipe Sections are used to insulate pipes operating at temperatures in the range 0 to 250°C. The sections are used to insulate against frost damage. For hot pipes, the limiting temperature of the outer foil face is 80°C to maintain facing bond strength.

pH neutrality

ROCKWOOL insulation is chemically compatible with all types of pipes, equipment and fittings. (Guidance is given in BS 5970 regarding the treatment of austenitic stainless-steel pipework and fittings). Stone wool insulation is chemically inert. A typical aqueous extract of ROCKWOOL insulation is neutral or slightly alkaline (pH 7 to 9.5).

Durability

ROCKWOOL stone wool insulation products have been proven in service for over 60 years, in a wide range of climates and degrees of exposure. ROCKWOOL insulation will generally perform effectively for the lifetime of the building, plant or structure.

Biological

ROCKWOOL stone wool is a naturally inert and rot-proof material that does not encourage or support the growth of fungi, moulds or bacteria, or offer sustenance to insects or vermin.

Installation

RockLap H&V Pipe Sections are supplied with an integral self-adhesive overlap. Place the section around the pipe and seal accordingly (Figure 1).

All joints between RockLap sections must be sealed with aluminum foil tape (Figure 2).

Handling

RockLap H&V Pipe Sections are easy to cut to any shape with a sharp knife. When stored outside, avoid contact with the ground and cover with a securely anchored waterproof sheet.

Maintenance

Once installed RockLap H&V Pipe Sections shouldn't require any maintenance.


Specification clauses

Typical specification

Pipes to be insulated with *mm thick ROCKWOOL Rocklap H&V Pipe Sections, having a nominal density not less than 120kg/m³, with a factory applied facing which is a laminate of close mesh reinforcement between two layers of foil including integral lap for fixing. The whole to comply with BS 5422:2009 and BS 5970 water vapour permeance and Building Regulation requirements in relation to thermal and fire. Fixing to be in accordance with manufacturer's instructions, by peeling protective tape from self-adhesive lap and pressing lap smoothly over joint. Where adjacent Sections abut, approved 75 mm wide aluminium tape to be used to maintain integrity of the vapour barrier.

For external applications please see HVAC Specification Detail Guide for external finishes.

*insert required thickness

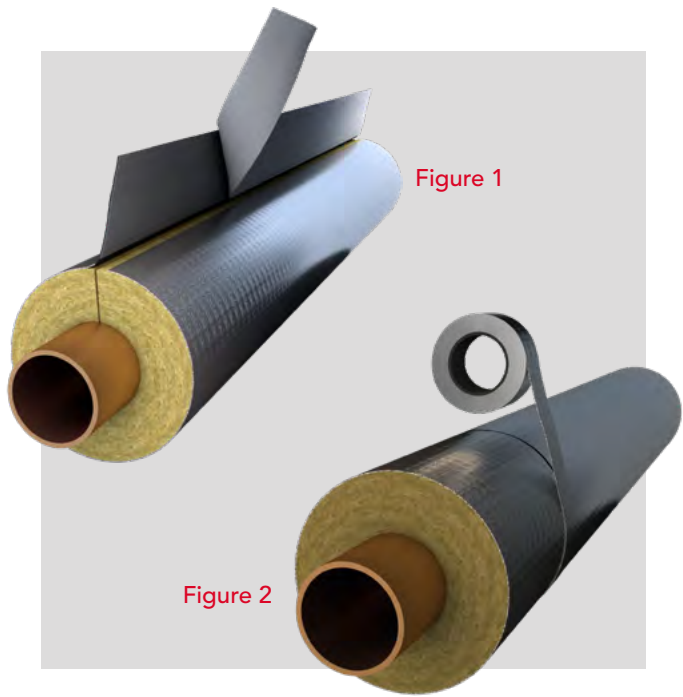



Other guidance

Available standard dimensions and packaging matrix.

To Suit Pipe O.D. / mm	Insulation Thickness / mm										
	20	25	30	35	40	45	50	60	70	80	100
17	42 (1)	30 (1)	25 (1)	20 (1)	16 (1)						
21	36 (1)	30 (1)	20 (1)	13 (1)	13 (1)	9 (1)	9 (1)				
27	30 (1)	25 (1)	20 (1)	12 (1)	12 (1)	9 (1)	9 (1)	6 (2)	4 (2)		
34	25 (1)	20 (1)	16 (1)	12 (1)	9 (1)	8 (1)	8 (1)	5 (2)	4 (2)		
42	20 (1)	16 (1)	12 (1)	9 (1)	9 (1)	6 (1)	6 (1)	4 (2)	4 (2)	■ (2)	■ (2)
48	16 (1)	16 (1)	12 (1)	9 (1)	9 (1)	6 (1)	6 (1)	4 (2)	■ (2)	■ (2)	■ (2)
54	16 (1)	12 (1)	10 (1)	8 (1)	8 (1)	5 (1)	5 (1)	4 (2)	■ (2)	■ (2)	
60	12 (1)	12 (1)	9 (1)	7 (1)	7 (1)	5 (1)	5 (1)	4 (2)	■ (2)	■ (2)	■ (2)
67		9 (2)	9 (2)	6 (2)	6 (2)	4 (2)	4 (2)	■ (2)	■ (2)	■ (2)	■ (2)
76		9 (2)	7 (2)	5 (2)	5 (2)	4 (2)	4 (2)	■ (2)	■ (2)	■ (2)	■ (2)
80		9 (2)	6 (2)	5 (2)	5 (2)	4 (2)	4 (2)	■ (2)	■ (2)	■ (2)	■ (2)
89		6 (2)	6 (2)	4 (2)	4 (2)	4 (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
102		5 (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
108		5 (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
114		4 (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
127		4 (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	
133		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
140		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
150		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)			
154		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	
159		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
169		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
178		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)			
191		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)			
194		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
205		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
219		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
230					■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
245		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
253		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
273		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
279		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
305		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
318		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
324		● (2)	● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
356			● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)
406			● (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)	■ (2)

(1 or 2) Applicable DOP Lambda Curve

■ Size is available to order

■ Size currently not available

42 Number indicates the Linear Metres per carton

■ These sections come "split" and are packed as single lengths which are shrink wrapped in polyethylene

● These sections come "unsplit" and are packed as single lengths which are shrink wrapped in polyethylene


Alternative sizes may be available. For further details please contact ROCKWOOL Customer Support

Distribution losses from a heating or cooling system can account for as much as 20% of the total energy used in a building.





DuctRock® Slab

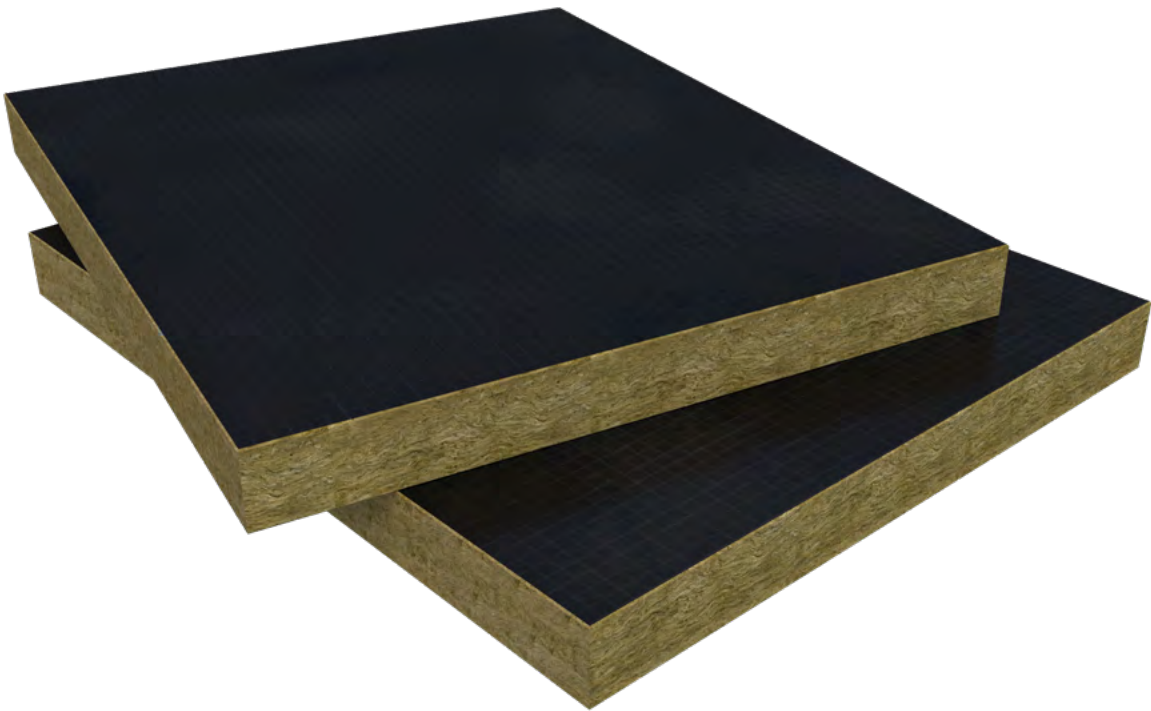

Description

FIREPRO® DuctRock® Slab is manufactured with high density, non-combustible stone wool insulation and finished with a high emissivity black foil facing. Available in three thicknesses DuctRock® Slab is easy to handle, simple to install and capable of achieving fire resistance of up to EI 120.

FIREPRO® Glue and a high performance Black Aluminium Foil Tape are also readily available from ROCKWOOL for sealing all board joints.

Advantages

- EI 120 on Ventilation & Smoke Extract Ducts
- Tested on both vertical and horizontal ducts
- Wide ranging scope for many duct types
- High quality black foil finish
- Patented horizontal penetration detail

Applications

DuctRock® Slab has been designed for use with rectangular and square steel ductwork systems and has been fire tested in conjunction with the following duct types shown in table 1.

Table 1

Ventilation Duct: Type A		Ventilation Duct: Type B		Smoke Extract Duct: Type C
Horizontal	Vertical	Horizontal	Vertical	
✓	✓	✓	✓	✓

Performance

Fire performance

FIREPRO® DuctRock® Slab can achieve fire resistance ratings; Integrity (E) and Insulation (I) of EI 30 to EI 120 with only 3 thicknesses. Table 2 provides a summary of fire performance.

Table 2

FIREPRO® DuctRock® Slab (mm)	Ventilation Duct: Type A		Ventilation Duct: Type B		Smoke Extract Duct: Type C	Ducts with a Combustible Lining
	Horizontal	Vertical	Horizontal	Vertical		
*60	EI 60	EI 60	EI 60	EI 60	EI 60	N/A
80	EI 90	EI 90	EI 90	EI 90	EI 90	N/A
90	EI 120	EI 120	EI 120	EI 120	EI 120	**EI 60

*Use 60mm FIREPRO® DuctRock® Slab for EI 30 fire ratings

**DuctRock slab has been tested in accordance with the criteria set out in section 11.2.2 of BS EN 1366-1:2014 (Ducts with combustible lining) where additional thermocouples were positioned within the duct to record the average and maximum temperature rise. Insulation failure was defined in accordance with EN 1363-1.

Technical information

Length	Width	Thickness	Facing	Fire resistance
1200mm	1000mm	60, 80 & 90mm	Black aluminium foil	Up to EI 120

Standards and approvals

DuctRock® Slab has been tested in accordance with BS EN 1366: Part 1 for ventilation ducts and also BS EN 1366: Part 8 for smoke extraction ducts achieving up to EI 120 minutes.

DuctRock® Slab has been classified in accordance with EN 13501-3:2005 +A1: 2009.

Fire Resistance Classification: up to EI 120 (ve, ho, i ↔ o) S

DuctRock® has been classified in accordance with EN 13501-4:2016.

Fire Resistance Classification: up to EI 120 multi (ho/ve) S 500

pH Neutrality

ROCKWOOL insulation is chemically compatible with all types of pipes, ducts, equipment and fittings. (Guidance is given in BS 5970 regarding the treatment of austenitic stainless-steel pipework and fittings). Stone wool insulation is chemically inert. A typical aqueous extract of ROCKWOOL insulation is neutral or slightly alkaline (pH 7 to 9.5).

Durability

ROCKWOOL stone wool insulation products have been proven in service for over 60 years, in a wide range of climates and degrees of exposure. ROCKWOOL insulation will generally perform effectively for the lifetime of the building, plant or structure.

Biological

ROCKWOOL stone wool is a naturally inert and rot-proof material that does not encourage or support the growth of fungi, moulds or bacteria, or offer sustenance to insects or vermin.



Installation

Fire performance

FIREPRO® Ductrock® Slab can be rapidly installed onto rectangular and square steel ductwork using a combination of Ø2.7 - Ø3.0mm stud welded pins, Ø30mm steel washers and ROCKWOOL FIREPRO® Glue. All board abutments and cross joints must be covered with ROCKWOOL black aluminium foil tape.

DuctRock Slab thickness (mm)	Stud welded pin length (mm)
60	62mm
80	82mm
90	92mm

FIREPRO® DuctRock® is easily cut with a hand saw or alternatively a circular/table saw. The top and bottom slabs should be cut 10mm wider than the width of the duct to ensure a tight cross joint with the side slabs. The side slabs should be cut to the height of the duct (H) + 2 x the insulation thickness as shown in Figure 1.

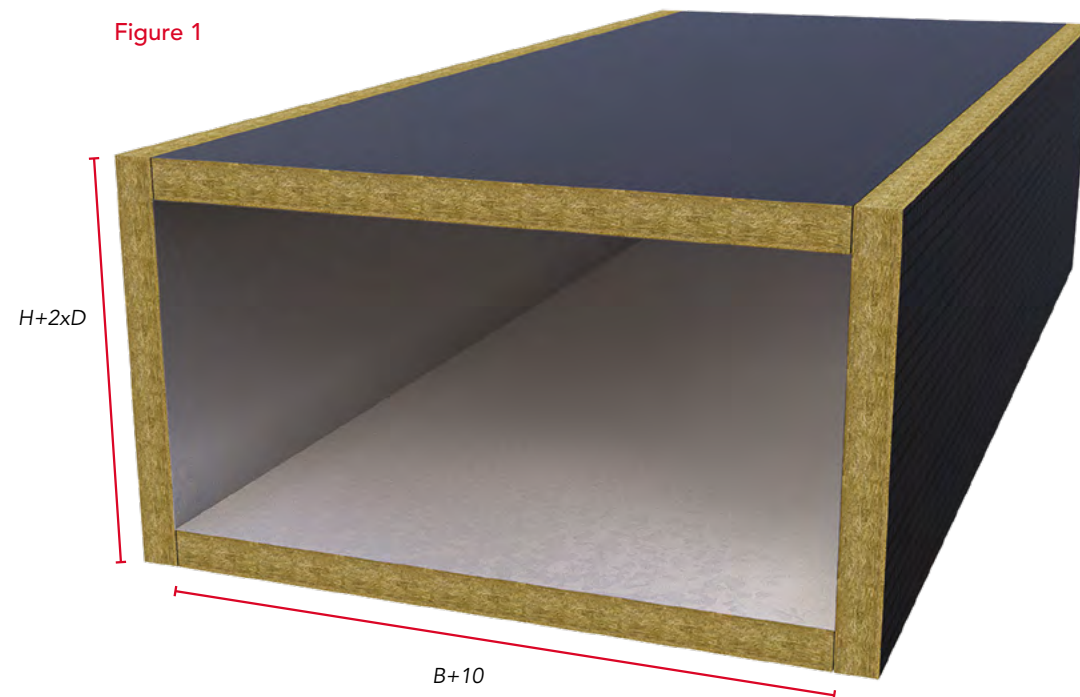


Figure 1

Top slab

When installed within horizontal applications the top boards do not require any stud welded pins and is simply positioned onto the duct with all board joints bonded with FIREPRO® Glue. Board joints must be covered using ROCKWOOL black foil tape.

Side wall slabs

The side wall slabs are installed using stud welded pins with 350mm maximum centres along the length of the duct and 400mm centres across the depth as shown in Figure 2.

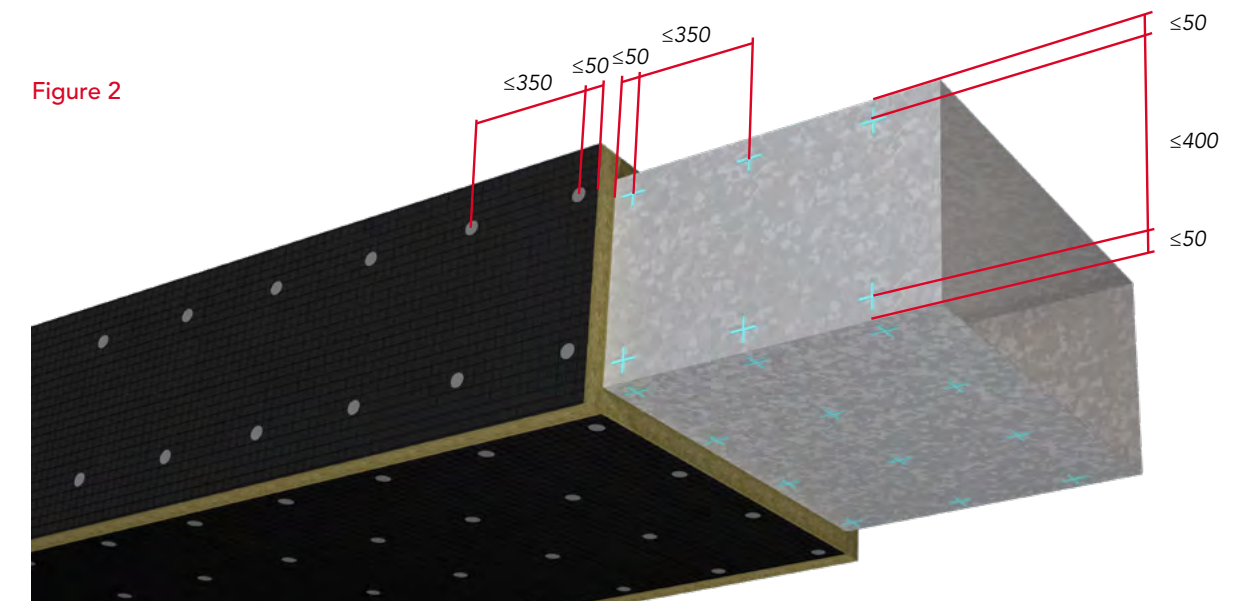


Figure 2

Side wall slabs must overlap the top and bottom boards as shown in Figures 3 & 4. All cross joints must be bonded with ROCKWOOL FIREPRO® Glue.



Figure 3
Cross joint horizontal duct

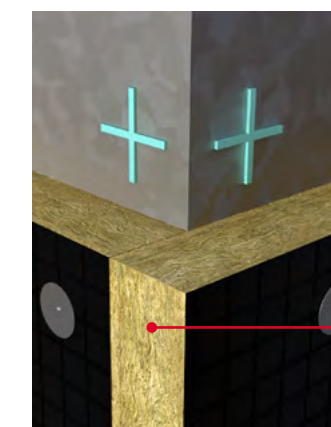


Figure 4
Cross joint vertical duct

Board edges must be covered with ROCKWOOL Black Foil Tape

Note: To ensure that there is a strong bond between the welded pin and the duct, always ensure that the welded pin is sufficiently isolated from the foil surface of the insulation during welding.



Base slab

Install the base slabs with stud welded pins at a maximum of 350mm centres along the length of the duct and 300mm centres across the width of horizontal ducts and 450mm across the width of vertical ducts as shown as shown in Figures 5 and 6.

Figure 5
Horizontal duct


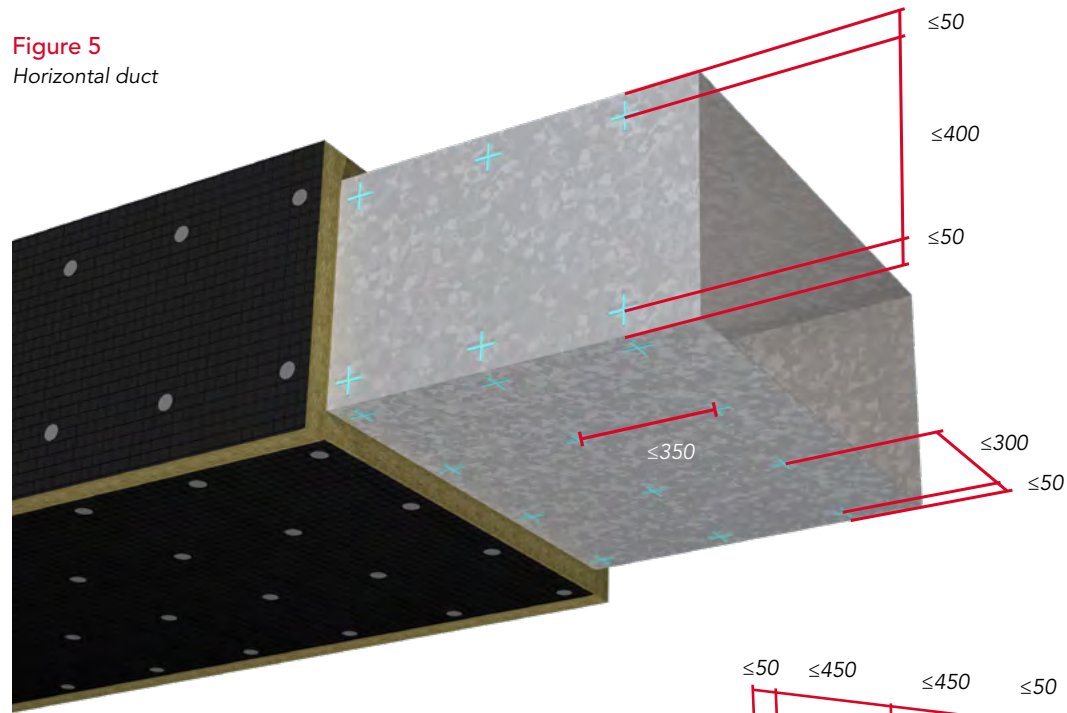


Figure 6
Vertical duct

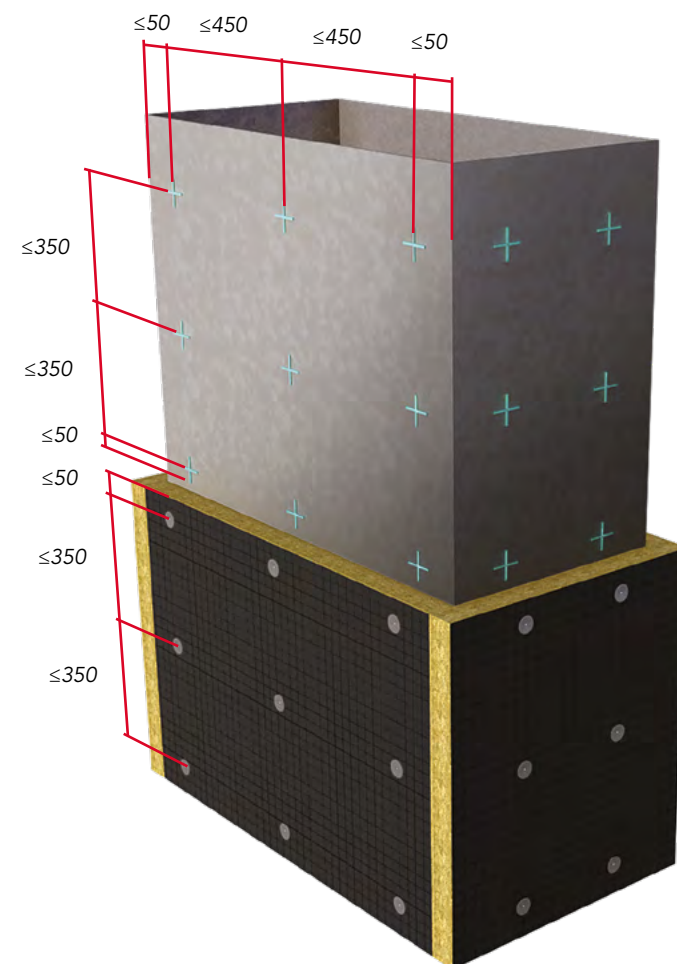

Detailing around flanges and drop rod hangers

Where the DuctRock® Slab bypasses a flange, drop rod hanger or both, cut a notch into the insulation as shown in Figure 7a-c. The insulation can easily be cut with a sharp knife or hand saw.

All board joints must be bonded with FIREPRO® Glue.

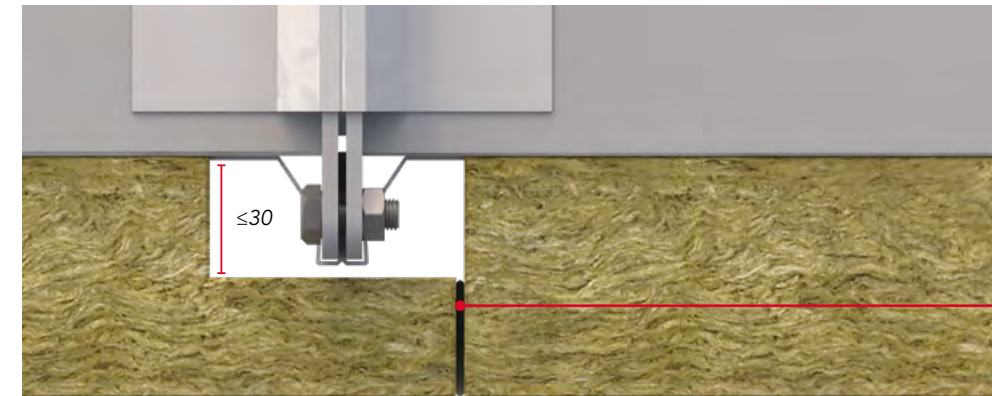


Figure 7a

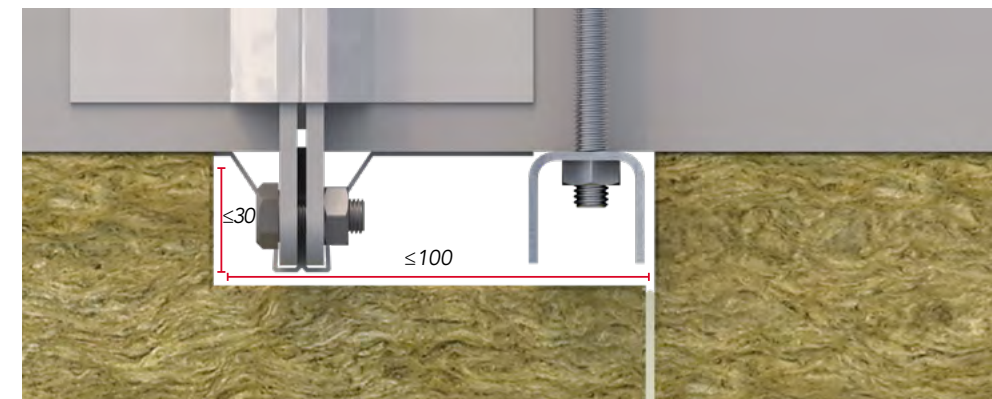


Figure 7b



Figure 7c



Dry wall penetration

In order to maintain fire performance, provide stability and minimise noise transfer, ROCKWOOL have developed a patented solution for installing DuctRock® Slab at the point where the duct penetrates a dry wall system.

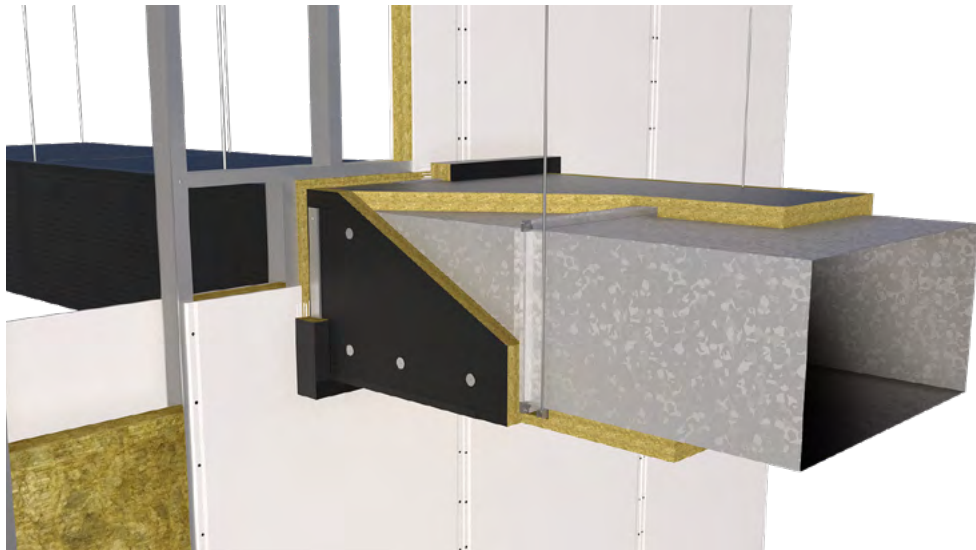


Figure 8
ROCKWOOL Patented
Dry Wall Penetration
Detail


Installation Procedure: Dry wall Penetration

1. A joint in the DuctRock® Slab must be accommodated at the centre point of the aperture, as shown in Figure 10.
2. Fill the remaining annular space between the DuctRock® Slab and supporting structure of the dry wall system with ROCKWOOL RWA45 as shown in Figure 9.
3. To stiffen the duct around the penetration a 1.5mm thick steel u-profile (60 x 25 mm) must be fitted approx. 20mm from the wall, to both the vertical and horizontal sides of the duct (both sides of the aperture) the length of the profile can be determined using the following formula: $\text{Duct Width/Height} + (2 \times \text{Insulation Thickness}) - 50\text{mm}$. Examples shown in table below:

Duct size	Insulation thickness	U-Profile Length (mm)	
		Horizontal	Vertical
1500 (L) x 1000 (W) x 500 (H)	90	1130	630
1500 (L) x 1000 (W) x 250 (H)	90	1130	380

4. Before applying the u-profile to the DuctRock® Slab slits must be cut into the insulation to allow the profile sides to penetrate the insulation (Figure 10). The u-profile can be attached to the ductwork using 100mm self-tapping screws. 4No to the top and bottom slabs and 2No to the vertical slabs.
5. Once the u-profiles have been applied an insulated collar must be installed around the perimeter of the aperture. The collar can be simply cut from the DuctRock® Slab. Fix the collars in place with FIREPRO® Glue as shown in Figure 9. Use nails to temporarily hold the collars in place whilst the glue cures.
6. ROCKWOOL Black foil tape can be used to cover any exposed edges of the collars.

Figure 9

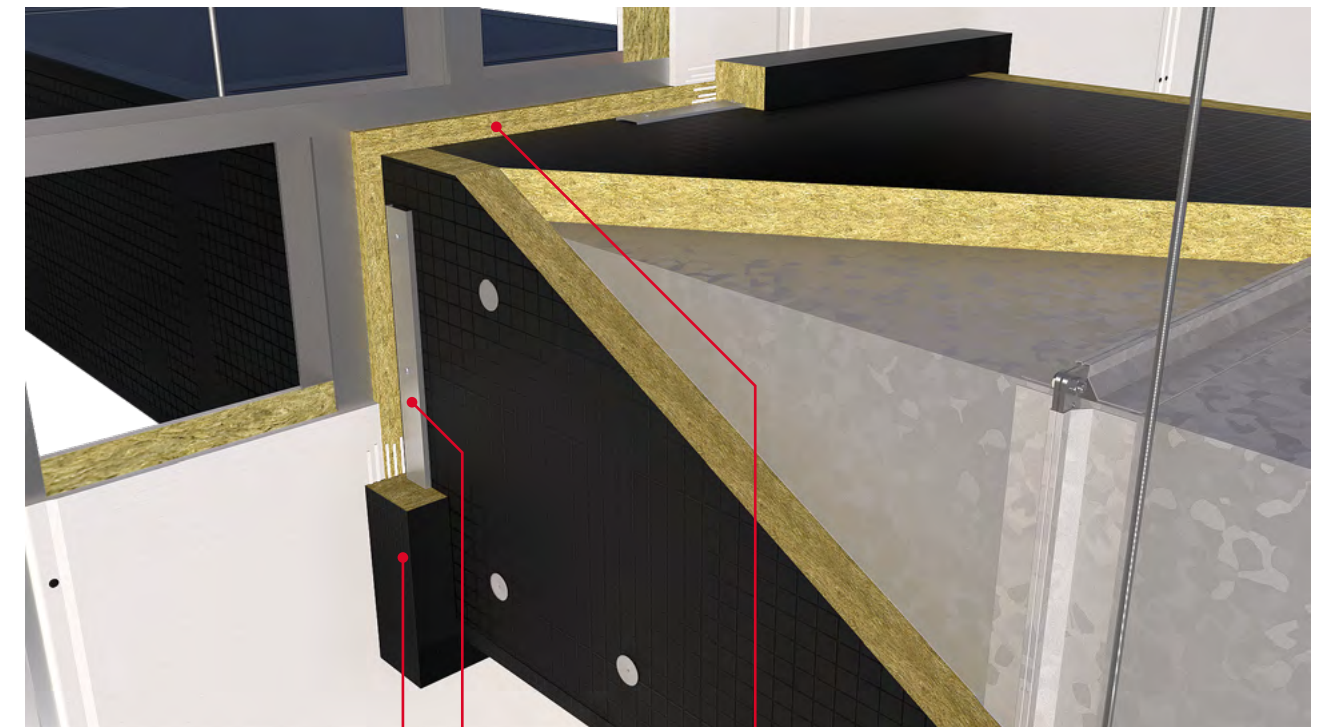


60mm x 100mm DuctRock collars
bonded to the substrate with
FIREPRO® Glue

Steel u-profile fixed
20mm from the wall

Annular space filled with
ROCKWOOL RWA45

Figure 10

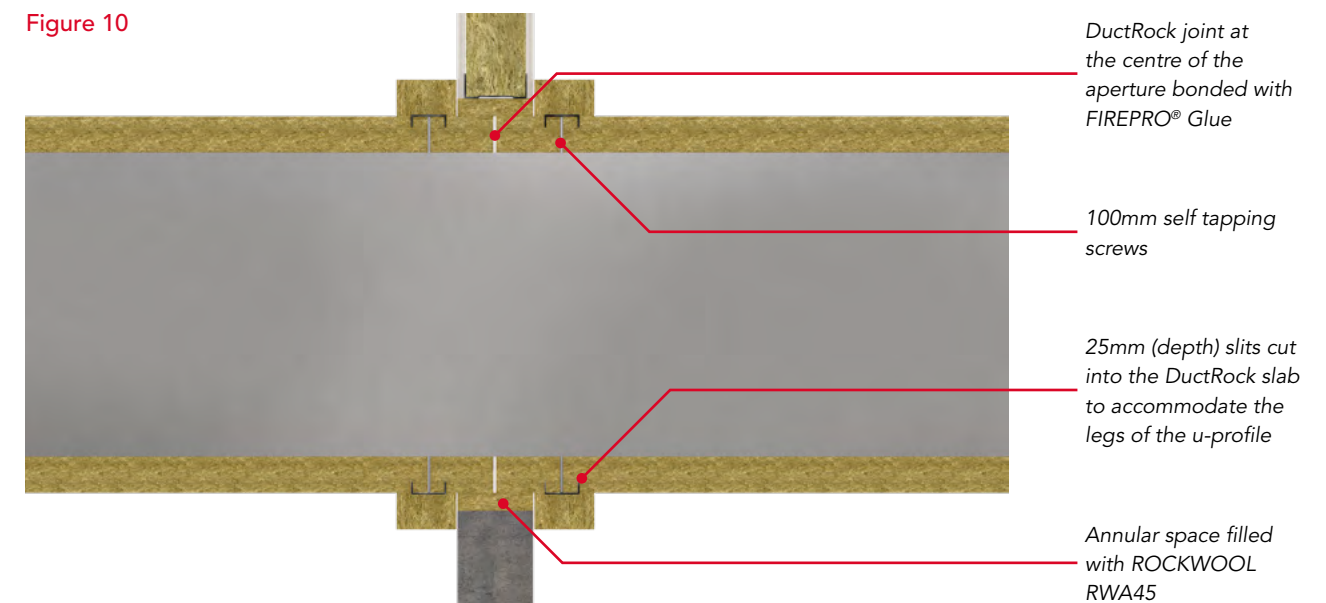

DuctRock joint at
the centre of the
aperture bonded with
FIREPRO® Glue

100mm self tapping
screws

25mm (depth) slits cut
into the DuctRock slab
to accommodate the
legs of the u-profile

Annular space filled
with ROCKWOOL
RWA45



Floor penetration

1. Maintain a 30mm gap between the ductwork and floor structure. Fill the gap between the duct and the floor structure with a ROCKWOOL Slab e.g. ROCKWOOL RWA45 as shown in Figure 11a. The flexible slab can be sealed within the void using FIREPRO® Glue.
2. Secure the duct to the floor structure using 4 no. 50 x 50 x 45 x 2.5mm galvanised steel angles to both sides of the aperture. The angles can be fixed using 2No 3.2 x 25mm self-tapping screws. Alternatively, the duct can be secured with a 40 x 40 x 3mm L profile as shown in Figure 11b. The length of the L profile should be equal to the width of the duct and installed to both sides (duct width).
3. Apply a DuctRock® collar to the perimeter of the aperture and on both sides as shown in Figure 11a. The collars can be fixed using FIREPRO® Glue and temporarily held in place with nails until the glue cures.

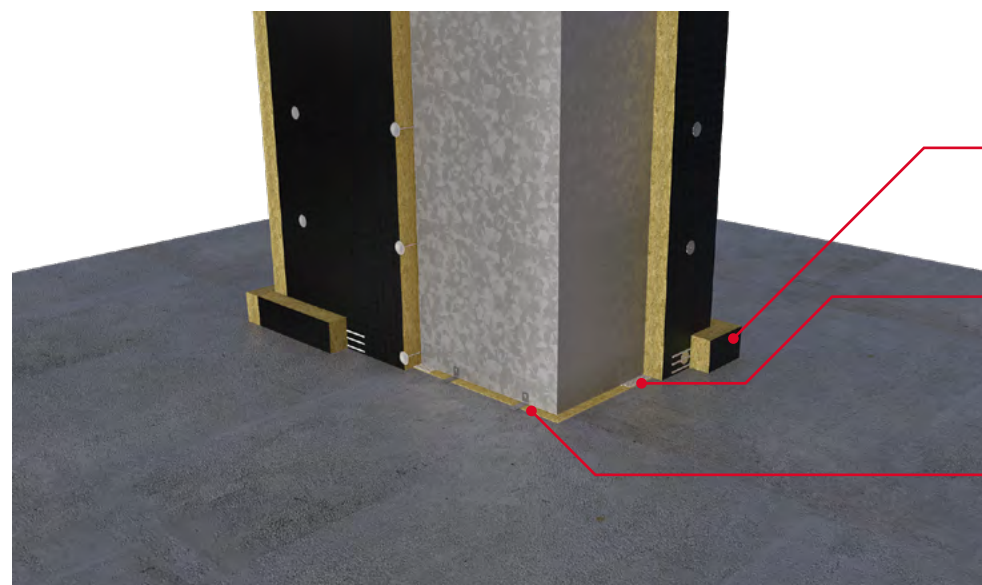


Figure 11a

60mm x 100mm
DuctRock collars
bonded with FIREPRO®
Glue

Seal the ROCKWOOL
Slab within the aperture
space with FIREPRO®
Glue

Secure the duct to the
substrate using 4 no.
50 x 50 x 45 x 2.5mm
galvanised steel angles
fixed with 3.2 x 25mm
self tapping screws

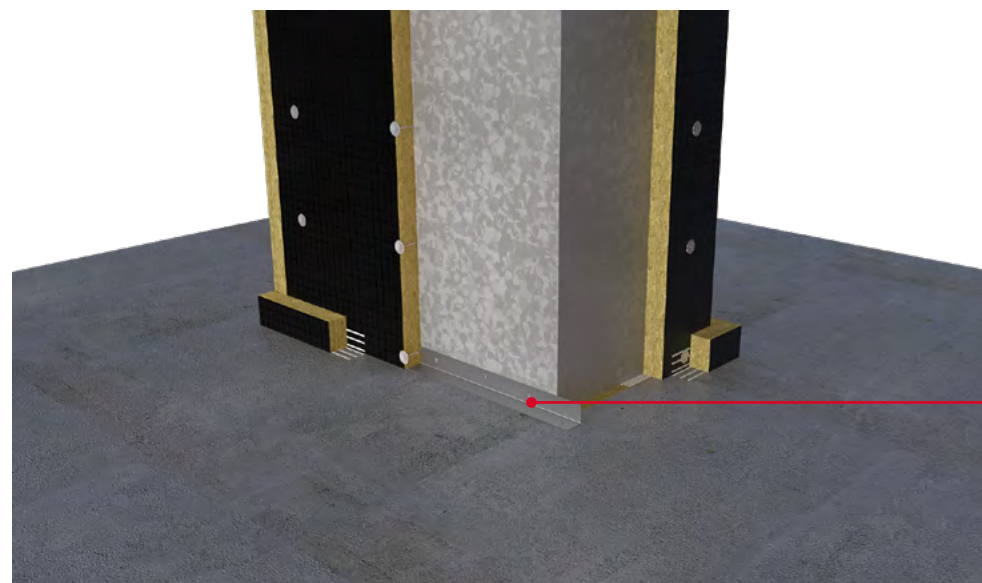


Figure 11b

40 x 40 x 3mm
galvanised steel
L-profile fixed with 3.2
x 15mm self tapping
screws to the duct and
7.5 x 62mm screws to
the floor.

Elbows

Elbows can be protected by cutting the DuctRock® Slab into fan shaped segments as shown in Figure 12a. Alternatively v-shaped slits can be cut into the back of the DuctRock Slab allowing it to wrap around the elbow as shown in Figure 12b. Fill the v-shaped channels with FIREPRO® Glue before applying to the duct and use nails to temporarily hold the insulation in place whilst the glue cures.

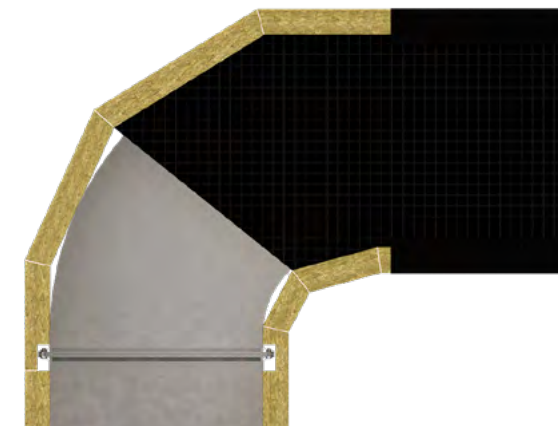


Figure 12a


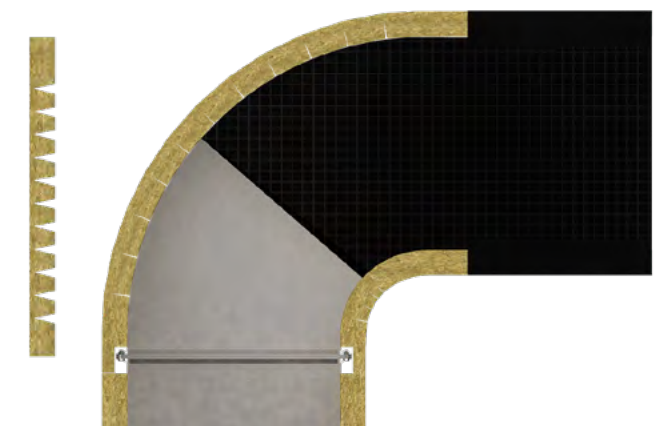



Figure 12b

Access hatches

DuctRock® Slab can be cut and positioned within a steel frame to form a removable cover in the location of the steel access hatch. The insulated cover can be attached to the duct using 4N° M8 threaded rods (Figure 13a) ensuring the rods are secured on both sides of the duct. The cover is then fixed to the rods using steel M8 nuts and washers. The thickness of insulation should be appropriate to the fire resistance required.

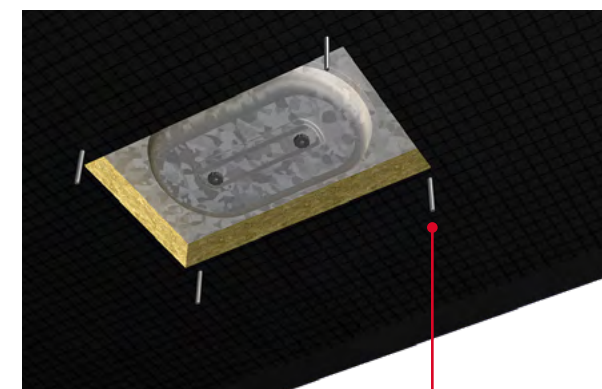

4 x M8 threaded rods secured to
both sides of the duct.

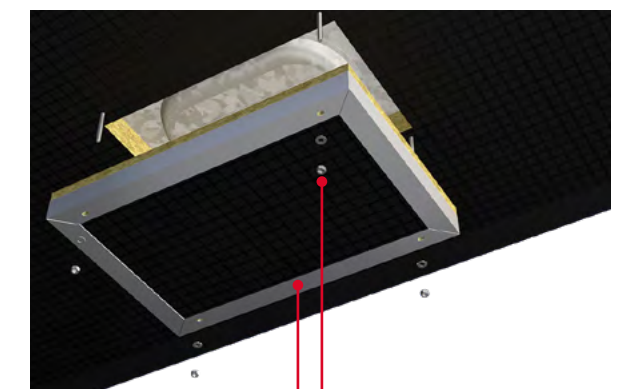

Steel frame for
housing the removable
insulated cover.

Removable cover secured
to the threaded rods with
M8 nuts and washers.



Specification clauses

Typical specification clauses for rectangular and square ducts to be read in conjunction with the installation guidelines provided within this datasheet.

All ductwork is to be insulated with.....* mm ROCKWOOL FIREPRO® DuctRock® Slab, having a factory applied reinforced black aluminium foil to one face and tested in accordance with BS EN 1366: Part 1 and/or BS EN 1366:Part 8.

DuctRock® Slab is to be fixed to the duct using 2.7 - 3.0 mm diameter welded steel pins and 30 mm spring steel washers in accordance with the ROCKWOOL Product Data Sheet 'FIREPRO® DuctRock®'.

All joints are to be filled with FIREPRO® Glue and held tightly closed.

Installed to steel ductwork which complies with the following specification criteria:

- Steel duct dimensions up to 1000x1250 (height x width) and 1500mm in length
- With leakage class B in accordance with EN 1507. Further information on leakage classes can also be found in DW/144: Specification for Sheet Metal Ductwork low, medium and high pressure/velocity air systems.
- With an under-pressure or over-pressure up to 500Pa
- Steel flanges to be spot welded to the duct:
 - Ventilation Duct - 20mm flange
 - Smoke Extract Duct - 30mm flange

Flanges to be held together with either a 20mm flange joint profile (duct types A & B) or 30mm flange joint profile (duct type C). All flange joints to be sealed with sealing grease.

With stiffeners as follows:

- EI 120 – Ventilation Duct: 1 x Ø 15mm steel pipe in each duct segment
- EI 120 – Smoke Extract Duct: 2 x Ø 15mm steel pipe in each duct segment

Sealed with and appropriate duct sealant and 5 x 15mm EPDM tape

The duct suspension system complies with the following specification criteria:

Horizontal ducts:

Fire resistance	Max tensile stress of suspension device	Max shearing stress of screws	Max distance from suspension device to duct joint
EI 30	9 N/mm ²	15 N/mm ²	150mm
EI 60	9 N/mm ²	15 N/mm ²	150mm
EI 90	6 N/mm ²	10 N/mm ²	150mm
EI 120	6 N/mm ²	10 N/mm ²	150mm
EI 120 (Smoke Extract)	6 N/mm ²	10 N/mm ²	150mm

- With distance between suspension devices not exceeding 1500mm
- The lateral distance between the outer vertical surface of the steel duct and the centre line of the suspension rod shall not exceed 50mm

Vertical Ducts:

- With distance between supporting structures not exceeding 5m

Any duct penetrations comply with the following specification criteria:

Horizontal:

- Penetrating in rigid wall constructions or flexible walls with a minimum thickness of:
 - EI30 – 70mm
 - EI 60 – 95mm
 - EI 90 – 95mm
 - EI 120 – 130mm
- **And with a fire resistance equal to or greater than the tested DuctRock® slab thickness.**
- For horizontal penetrations, the gap between the DuctRock® Slab and supporting structure will not exceed 20mm.
- For horizontal penetrations U-profiles 1.5mm thick, with dimensions 60 x 25mm must be installed approximately 20mm from the wall and on both sides of the wall. The legs of the u-profiles are lowered into slits cut into DuctRock®Slab and fixed to the duct by means of
 - Ø 4.8mm x 100mm for EI 30 & EI 120 self-tapping screws; 4 on the top and bottom profiles and 2 on the vertical profiles.

Vertical

- Penetrating rigid floor constructions with a minimum thickness of:
 - EI 30 – 100mm
 - EI 60 – 100mm
 - EI 90 – 150mm
 - EI 120 – 150mm
- **And with a fire resistance equal to or greater than the tested DuctRock® slab thickness.**
- For vertical penetrations the duct is to be stabilised using 4 no. 'L' galvanised steel angles of 50 x 50 x 45 x 2.5mm or a 40 x 40 x 3mm L profile which are fixed to the vertical steel duct and the supporting structure on both sides of the floor.

NBS specification clauses

FIREPRO® DuctRock® Slab is associated with the following NBS specification clauses:

U90 General ventilation - domestic

- 490 Site applied insulation to ductwork

Y30 Mechanical thermal insulation

- 340 Mineral fibre slabs insulation



FIREPRO® Fire Tube



Description

FIREPRO® Fire Tube is a preformed cylindrical section which is manufactured using high density ROCKWOOL stone wool. Fire Tube is available in both plain and foil faced options.

Fire Tube is available to suit common steel structural column and pipe diameters in the range between 21mm - 610mm and is supplied in lengths of 1000mm.

Standard wall thicknesses*: 25, 40, 50, 60 and 70mm (excludes 610 diameter)

* Other wall thicknesses may be available subject to quantity or can be accommodated on site by dual layering one tube over another.

Advantages

- Available in a range of wall thicknesses to accommodate specific fail temperatures
- Manufactured to accommodate pipes and CHS sizes up to 610mm Ø
- Up to 4 hours fire resistance
- Excellent thermal and acoustic insulation
- A1 Non-combustible
- Water repellent

Applications

Fire Tube has been designed to provide fire protection of up to 4 hours and is suitable for use with:

- Structural steel
- Circular Hollow Sections (CHS)
- Solid bars
- Sprinkler pipes
- Process pipework

Performance

Fire performance

Fire report CC 276856A details the expected fire resistance performance relating to critical steel temperatures of 50, 100, 150, 200, 250, 300, 350, 400 and 550°C for periods of up to 4 hours.

The required wall thickness of Fire Tube to provide a particular fire resistance for a specified period depends on the diameter, wall thickness and critical (fail) temperature of the steel column or pipe. However, in the case of pipes, the critical temperature is likely to depend on its contents.

Structural steel fire protection

The section factors A/V (H_p/A) for standard structural steel sections can be found in the ASFP Yellow Book or can be calculated for each element by dividing the perimeter (circumference) exposed to fire (A) by the cross sectional area (V). For circular sections (including pipes), the following, simplified formulae can be used to calculate the A/V section factors:-

- Solid sections: $A/V = 4 / OD$
- Hollow sections: $A/V = OD / (thk (OD - thk))$
- Where OD = outside diameter in m
- Where thk = wall thickness in m

Worked example for hollow section

- Outside diameter: 219.1mm (0.2191m)
- Wall thickness: 8.0mm (0.008m)
- Circumference (A): 0.6884m
- Cross sectional area (V): 0.00531m²
- Section factor (A/V): 130m⁻¹

Tables 1 and 2 provide the wall thickness of Fire Tube necessary to restrict the core design temperature of circular steel elements (based on their limiting section factors) to 400°C and 550°C respectively, during exposure to cellulosic fire test. The design temperature is defined as the mean temperature at which a beam or column is assumed to be capable of supporting a specified load. Similar tables for critical temperatures of 50°C, 100°C, 150°C, 200°C, 250°C, 300°C and 350°C are also available from the ROCKWOOL Technical Solutions Team.



Table 1: Critical steel temp 400°C (for offshore and marine)

Fire Tube wall thickness (mm)	Maximum A/V section factors for 550°C critical temperature – Fire resistance (mins)					
	30	60	90	120	180	240
25	250	91	37	24	X	X
30	250	130	48	29	X	X
40	250	250	74	43	23	X
50	250	250	111	59	31	21
60	250	250	165	79	39	26
70	250	250	250	105	48	31
75	250	250	250	120	53	34
80	250	250	250	137	58	37
90	250	250	250	182	70	43
100	250	250	250	246	84	50

Table 2: Critical steel temp 550°C (for load-bearing structural building frameworks)

Fire Tube wall thickness (mm)	Maximum A/V section factors for 550°C critical temperature – Fire resistance (mins)					
	30	60	90	120	180	240
25	250	250	83	44	23	X
30	250	250	111	56	28	19
40	250	250	193	84	40	26
50	250	250	250	121	53	34
60	250	250	250	172	68	42
70	250	250	250	245	85	52
75	250	250	250	250	95	57
80	250	250	250	250	106	62
90	250	250	250	250	129	73
100	250	250	250	250	158	86

Pipework fire protection

The critical failure temperature of a pipe will depend on the material it is made of, or its contents e.g. water or oil. Table 3 provides the minimum required wall thickness of Fire Tube for a variety of critical failure temperatures to provide 60 minutes fire resistance to a 219.1mm OD steel pipe with an 8mm wall thickness - Section factor (A/V) of 130m-1.

Table 3: Critical steel temp 550°C (for load-bearing structural building frameworks)

Critical temperature of pipe material or contents	Wall thickness of Fire Tube (mm)
100°C	100
150°C	75
200°C	60
250°C	50
300°C	50
350°C	40
400°C	30
550°C	25

Technical information

Standards and approvals

Fire Tube conforms to BS 3958: Part 4, 'Bonded preformed mineral wool pipe sections'.

Full-scale independent test data has been verified and assessed by BRE Global in Fire report number: CC 276856A. The fire performance of Fire Tube has been reviewed by the Fire Test Study Group for inclusion in the ASFP Yellow Book, endorsed by the Steel Construction Institute.

This product has been authorised for use in LUL surface and sub-surface premises when installed in accordance with this datasheet - please refer to the LUL Approved Product Register website www.LU-apr.co.uk for specific details.

Product information

Property	Description
Length	1000mm
Internal diameter range	21 – 610mm
Thickness range	25 – 100mm
Reaction to fire classification	Euroclass A1
Fire resistance	Up to 4 hours

Installation

FIREPRO® Fire Tube is light and easy to cut to shape using a saw or a sharp knife.

Abutted sectional joints/ tube ends of the Fire Tube (including the partially split 'hinge' and the tube ends) are to be applied with FIREPRO® Glue prior to application. All joints should be held firmly together with temporary bands of steel wire, jubilee clips or plastic cable ties at 200mm centres until adhesive within joints and between Tube ends has fully cured.

If installed outdoors, Fire Tube must be protected from the weather. Prior to use, Fire Tube should be stored indoors or protected by a weather proof covering

Specification clauses

FIREPRO® Fire Tube is associated with the following NBS clauses:

P12 Fire stopping systems

- 375 Pipe collar: Insulated wrap

ROCKWOOL®

Firestopping Principles

1. ROCKWOOL will not support mixing fire protection of differing manufacturers systems/ products of any type in line with ASFP recommendations, unless proven by fire testing.
2. ROCKWOOL products should be installed in accordance with the relevant product data sheet and within the field of application identified on the standard details. For applications that fall outside the parameters identified in the standard details or data sheets please contact ROCKWOOL for further guidance.
3. Engineering Judgements are an appraisal of the likely performance of the installed ROCKWOOL products in that application when subjected to a fire resistance test. It is offered in lieu of direct formal testing and is based upon ROCKWOOL's experience of product performance during fire resistance testing. For this reason, before installation engineering judgements used on site should be reviewed and accepted by Building Control and / or the scheme Fire Office or the overseeing body for the project.
4. All penetrations within the dry lining system shall be framed and lined. a pattress fit option with ROCKWOOL Batts is available, but please check for its suitability.
5. Design of the penetration and its fire stopping should consider and correspond to the Integrity and Insulation requirements of the host wall or floor, unless leniency on the insulation rating is provided by the Fire Officer or overseeing body via a derogation.
6. Services of different types can pass through the same penetration, with the exception of ventilation (ducts and dampers) which should pass through exclusively through its own penetration, as per the EN test guidance.
7. Fire dampers and smoke dampers are to be independently supported from the soffit, therefore care should be taken where other services pass above the ventilation penetrations. Please refer to the damper manufacturers details and specification.
8. Support for services passing through walls should be within 500mm on each side. Services passing through floors should be supported at each level, as per industry and ASFP Guidance.
9. With reference to penetration spacings, please refer to the ROCKWOOL Spacing Guidelines Document

To access our range of firestopping standard details and penetration spacing guidelines, visit:

www.rockwool.co.uk/firepro

Sustainability

When it comes to our approach to sustainability, it is, simply put, a matter of living our purpose to address the challenges of modern living in a sustainable manner.

This means using natural materials to make products that have a positive impact on society.



Fire resistance



Acoustic comfort



Sustainable materials



Durability



Health and safety

The safety of ROCKWOOL stone wool is confirmed by current UK and Republic of Ireland health & safety regulations and EU directive 97/69/EC: ROCKWOOL fibres are not classified as a possible human carcinogen.

A Material Safety Data Sheet is available and can be downloaded from www.rockwool.co.uk to assist in the preparation of risk assessments, as required by the Control of Substances Hazardous to Health Regulations (COSHH).

Environment

Made from a renewable and plentiful naturally occurring resource, ROCKWOOL insulation saves fuel costs and energy in use and relies on trapped air for its thermal properties.

ROCKWOOL insulation does not contain (and has never contained) gases that have ozone depletion potential (ODP) or global warming potential (GWP).

ROCKWOOL is approximately 97% recyclable. For waste ROCKWOOL material that may be generated during installation or at end of life, we are happy to discuss the individual requirements of contractors and users considering returning these materials to our factory for recycling.



Interested?

For further information, contact the Technical Solutions Team on 01656 868490 or email technical.solutions@rockwool.co.uk

Visit www.rockwool.co.uk to view our complete range of products and services.

© ROCKWOOL August 2020

Legal disclaimer

The ROCKWOOL Trademark

ROCKWOOL® - our trademark

The ROCKWOOL trademark was initially registered in Denmark as a logo mark back in 1936. In 1937, it was accompanied with a word mark registration; a registration which is now extended to more than 60 countries around the world.

The ROCKWOOL trademark is one of the largest assets in the ROCKWOOL Group, and thus well protected and defended by us throughout the world.

If you require permission to use the ROCKWOOL logo for your business, advertising or promotion. You must apply for a Trade Mark Usage Agreement.

To apply, write to: marketcom@rockwool.com.

Trademarks

The following are registered trademarks of the ROCKWOOL Group: ROCKWOOL®, ROCKCLOSE®, RAINSCREEN DUO SLAB®, HARDROCK®, ROCKFLOOR® FLEXI®, BEAMCLAD®, FIREPRO®

Disclaimer

ROCKWOOL Limited reserves the right to alter or amend the specification of products without notice as our policy is one of constant improvement. The information contained in this brochure is believed to be correct at the date of publication. Whilst ROCKWOOL will endeavour to keep its publications up to date, readers will appreciate that between publications there may be pertinent changes in the law, or other developments affecting the accuracy of the information contained in this brochure. The applications referred to within the brochure do not necessarily represent an exhaustive list of applications. ROCKWOOL Limited does not accept responsibility for the consequences of using ROCKWOOL in applications different from those described within this brochure. Expert advice should be sought where such different applications are contemplated, or where the extent of any listed application is in doubt.

© ROCKWOOL 2020. All rights reserved.

Photography and illustrations

The product illustrations are the property of ROCKWOOL Ltd and have been created for indicative purposes only.

Unless indicated below, the photography and illustrations used in this guide are the property of ROCKWOOL Limited. We reserve all rights to the usage of these images.

If you require permission to use ROCKWOOL images, you must apply for a Usage Agreement.

To apply, write to: marketcom@rockwool.com.



December 2020

ROCKWOOL Limited

Pencoed
Bridgend
CF35 6NY

Tel: 01656 862 621

info@rockwool.co.uk

rockwool.co.uk



Revision No - v2.0

© ROCKWOOL 2020. All rights reserved.