## **DOOR POSITIONS & HANDINGS**


# **ALTERNATIVE PLATFORM SIZES**

# © BES Cibes Lift Group

### CIBES LIFT UK LTD

HEAD OFFICE CHAPEL HOUSE LEICESTER ROAD, LOUGHBOROUGH LE11 2AF TELEPHONE: 01509 436 022

CENTRE OF EXCELLENCE 2 & 3 ENTERPRISE HOUSE, THOMLINSON ROAD, HARTLEPOOL, TS25 INS

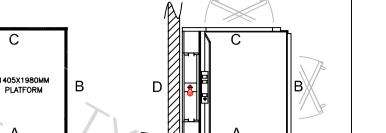


### ALTERNATIVE PLATFORM SIZES

	FOOTPRINT	PLATFORM SIZE	
	1630 WIDE X 2380 LONG	1105 WIDE X 2180 LONG	
*	1930 WIDE X 2180 LONG	1405 WIDE X 1980 LONG	
	1930 WIDE X 2680 LONG	1405 WIDE X 2480 LONG	

<sup>\*</sup>SIZE SHOWN ON THIS DRAWING

DOOR OPENING WIDTH

\*1200mm if fire doors installed

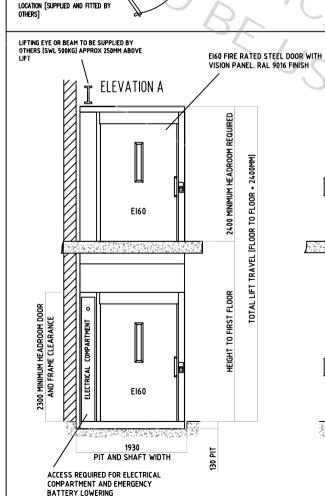

TYPICAL INCOMING POWER SUPPLY


### RAL 9016 FINISH STEEL SHAFT PANEL **RAL 9016 FINISH** STEEL SHAFT PANEL RAL 9016 FINISH STEEL SHAFT PANEL

2180

PIT AND SHAFT LENGTH

**ELEVATION B** 

# ELEVATION C RAL 9016 FINISH STEEL SHAFT PANEL **RAL 9016 FINISH** STEEL SHAFT PANEL RAL 9016 FINISH STEEL SHAFT PANEL RAL 9016 FINISH STEEL SHAFT PANEL RAL 9016 FINISH STEEL SHAFT PANEL

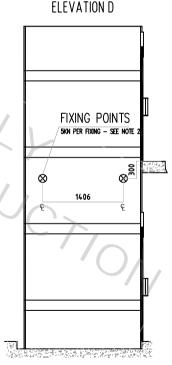

### GENERAL NOTES

1) A 130MM DEEP PIT IS REQUIRED ON SITE FOR THE LIFT TO SIT INTO TO GIVE LEVEL ACCESS AT THE LOWER FLOOR (130MM PIT +6MM/-0MM)

2) IT WILL BE NECESSARY FOR THE BUILDER TO PROVIDE SUPPORT FOR THE LIFT ON SIDE D

3) THE SUPPORT WALL MUST BE PLUMB TO ±5MM. THE RELATIONSHIP BETWEEN THE LIFT BASE AND THE WALL / FIXING LOCATION IS TO BE PLUMB AND SQUARE -0/+10MM.

4) THE FLOOR TO CEILING HEIGHT REQUIRED IS A MINIMUM OF 2300 (WITH PIT - 2430 NO PIT). A CLEAR HEADROOM OF 2400MM WOULD BE REQUIRED ABOVE THE UPPER FLOOR LEVEL IN ORDER TO FIT A STANDARD UNIT.

5) THE STANDARD COLOUR OF THE PLATFORM LIFT SHAFT PANELS IS WHITE RAL 9016 FINISH. OTHER COLOURS ARE AVAILABLE ON REQUEST.

6) THE UNIT IS RATED AT 1000KG AS STANDARD

7) OTHER LIFT SIZES ARE AVAILABLE. PLEASE CONTACT THE OFFICE FOR OTHER OPTIONS.

### ELECTRICS

#### THREE PHASE SUPPLY:

A PERMANENT 415V 3 PHASE 50HZ SUPPLY IS REQUIRED (4 WIRE - NEUTRAL & EARTH) PROTECTED BY A 20 AMP FUSED AND LOCKABLE ISOLATOR ISOLATOR TO BE POSITIONED EXTERNALLY OF THE LIFT ENCLOSURE. SUPPLIED AND FITTED BY OTHERS WITHIN SOMM OF THE ELECTRICAL COMPARTMENT.

A8000

DO NOT SCALE - IF IN DOUBT ASK

Α	24/11/2016	INITIAL DRAWING	DRAWN BY:	CT
ISSUE	DATE	DESCRIPTION	CHECKED BY:	CD

DRAWING A8000 OPEN FRONT 1405 WIDE X TITLE: 1980 LONG PLATFORM [FIRE DOORS]

DIMENSIONS IN MM 🏻

A8 TD 04

A 1 of 1